


ME


BAE 512 Building Service water & Fluid supply system

Test


- ① compute the loss pressure for each branch of simple duct system by using loss coefficient method

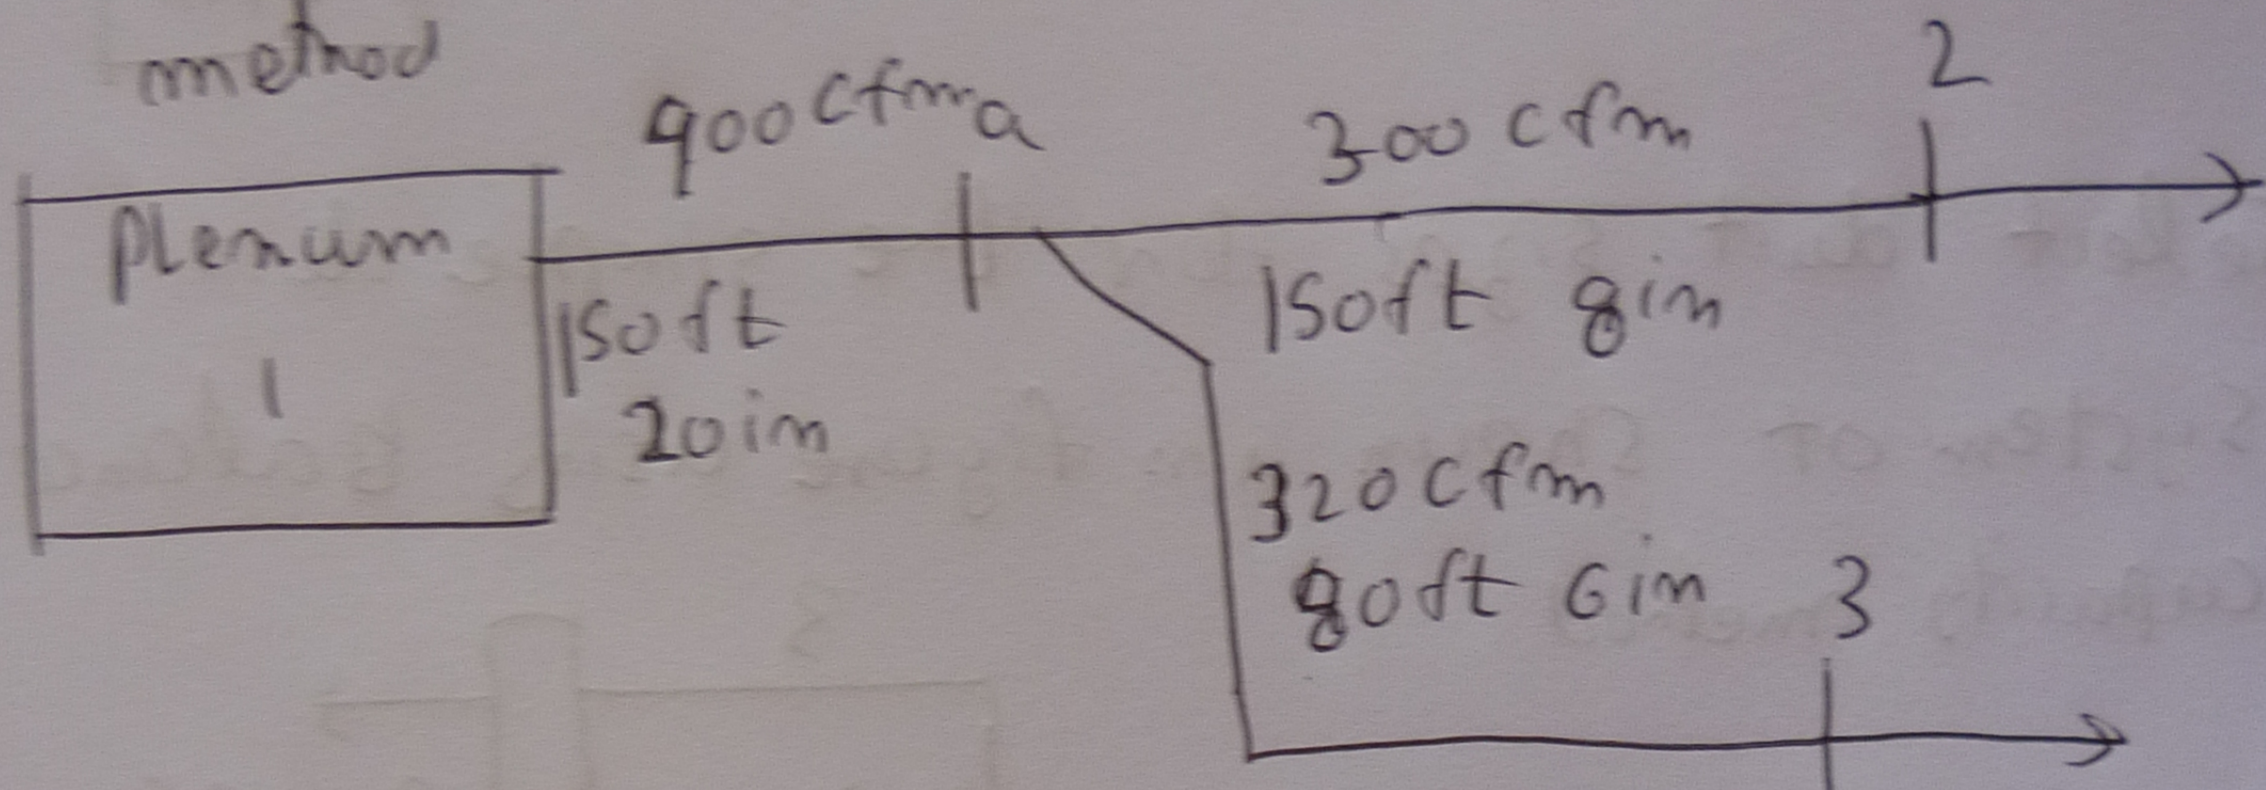

- ② compute the loss pressure for each branch of simple duct system shown by using equivalent length approach

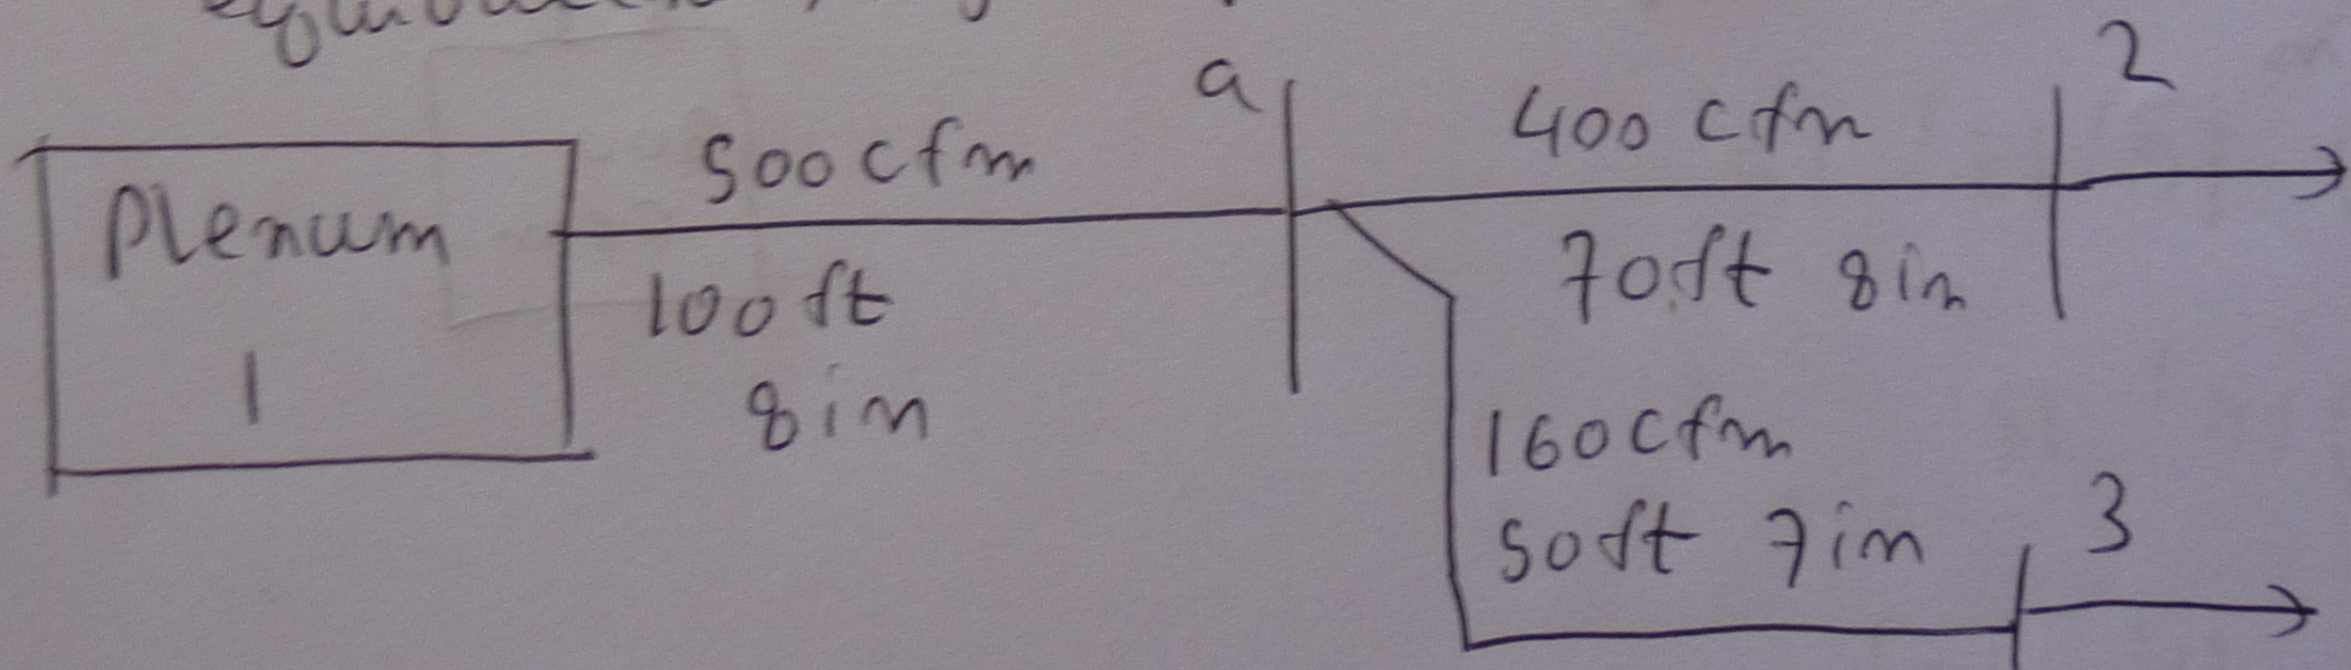

- ③ Select the duct size for given duct system by using equal friction method

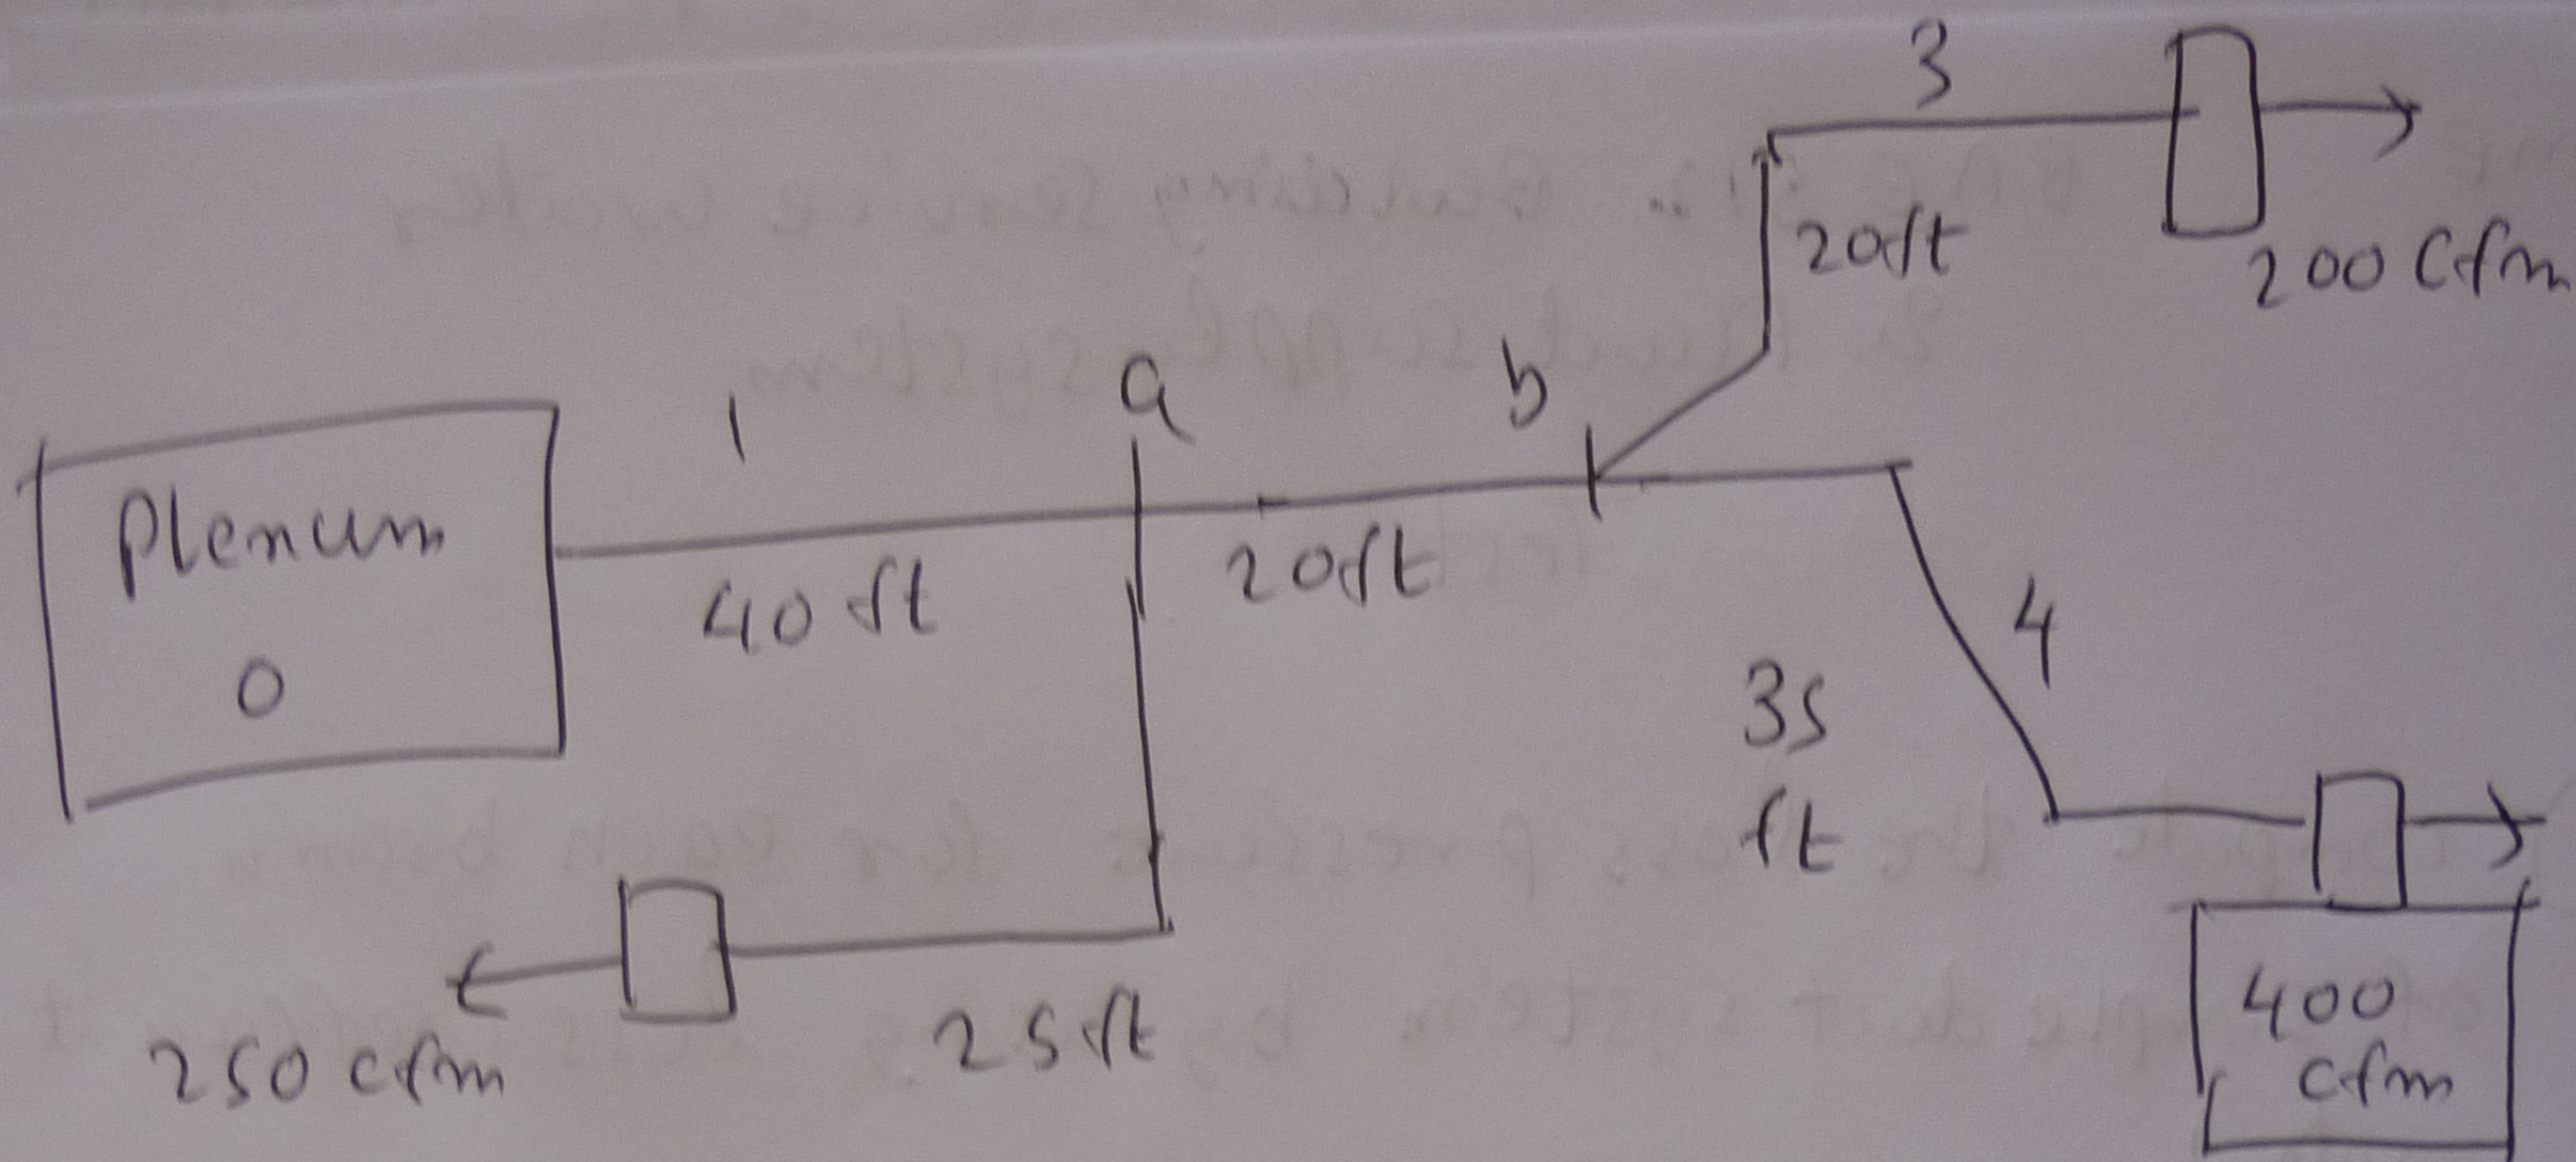

④ Select duct sizes for the simple duct system of shown in figure using Balance capacity method

