

## 2. Phase Control

- (a) Connect up the circuit as shown in Figure 2.



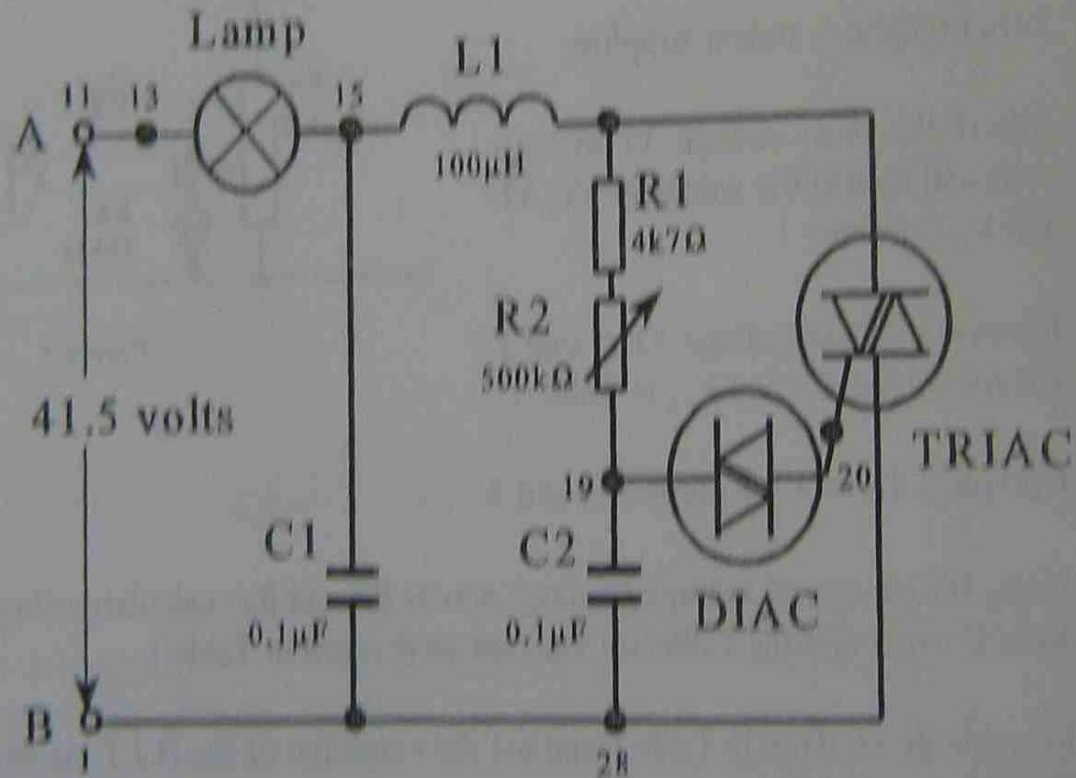





Figure 2

- (b) Turn on the 41.5 volt a.c. supply.



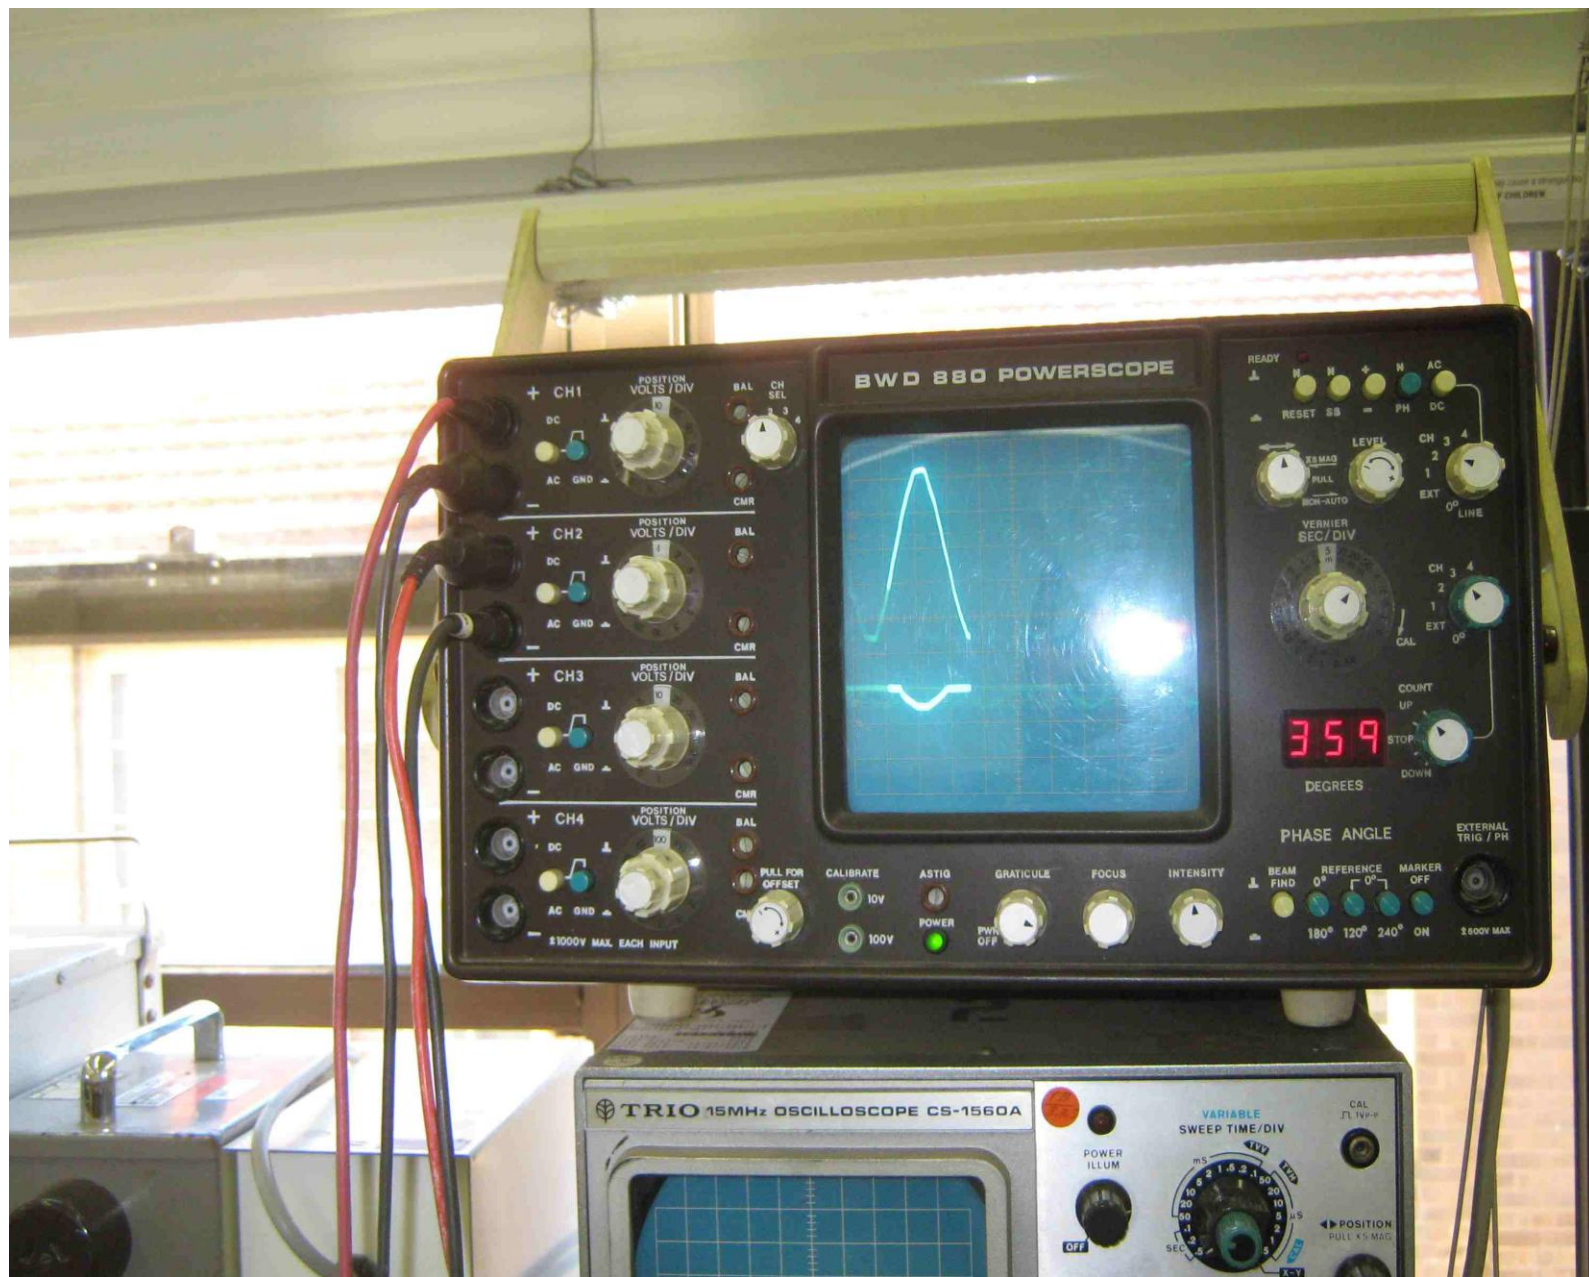

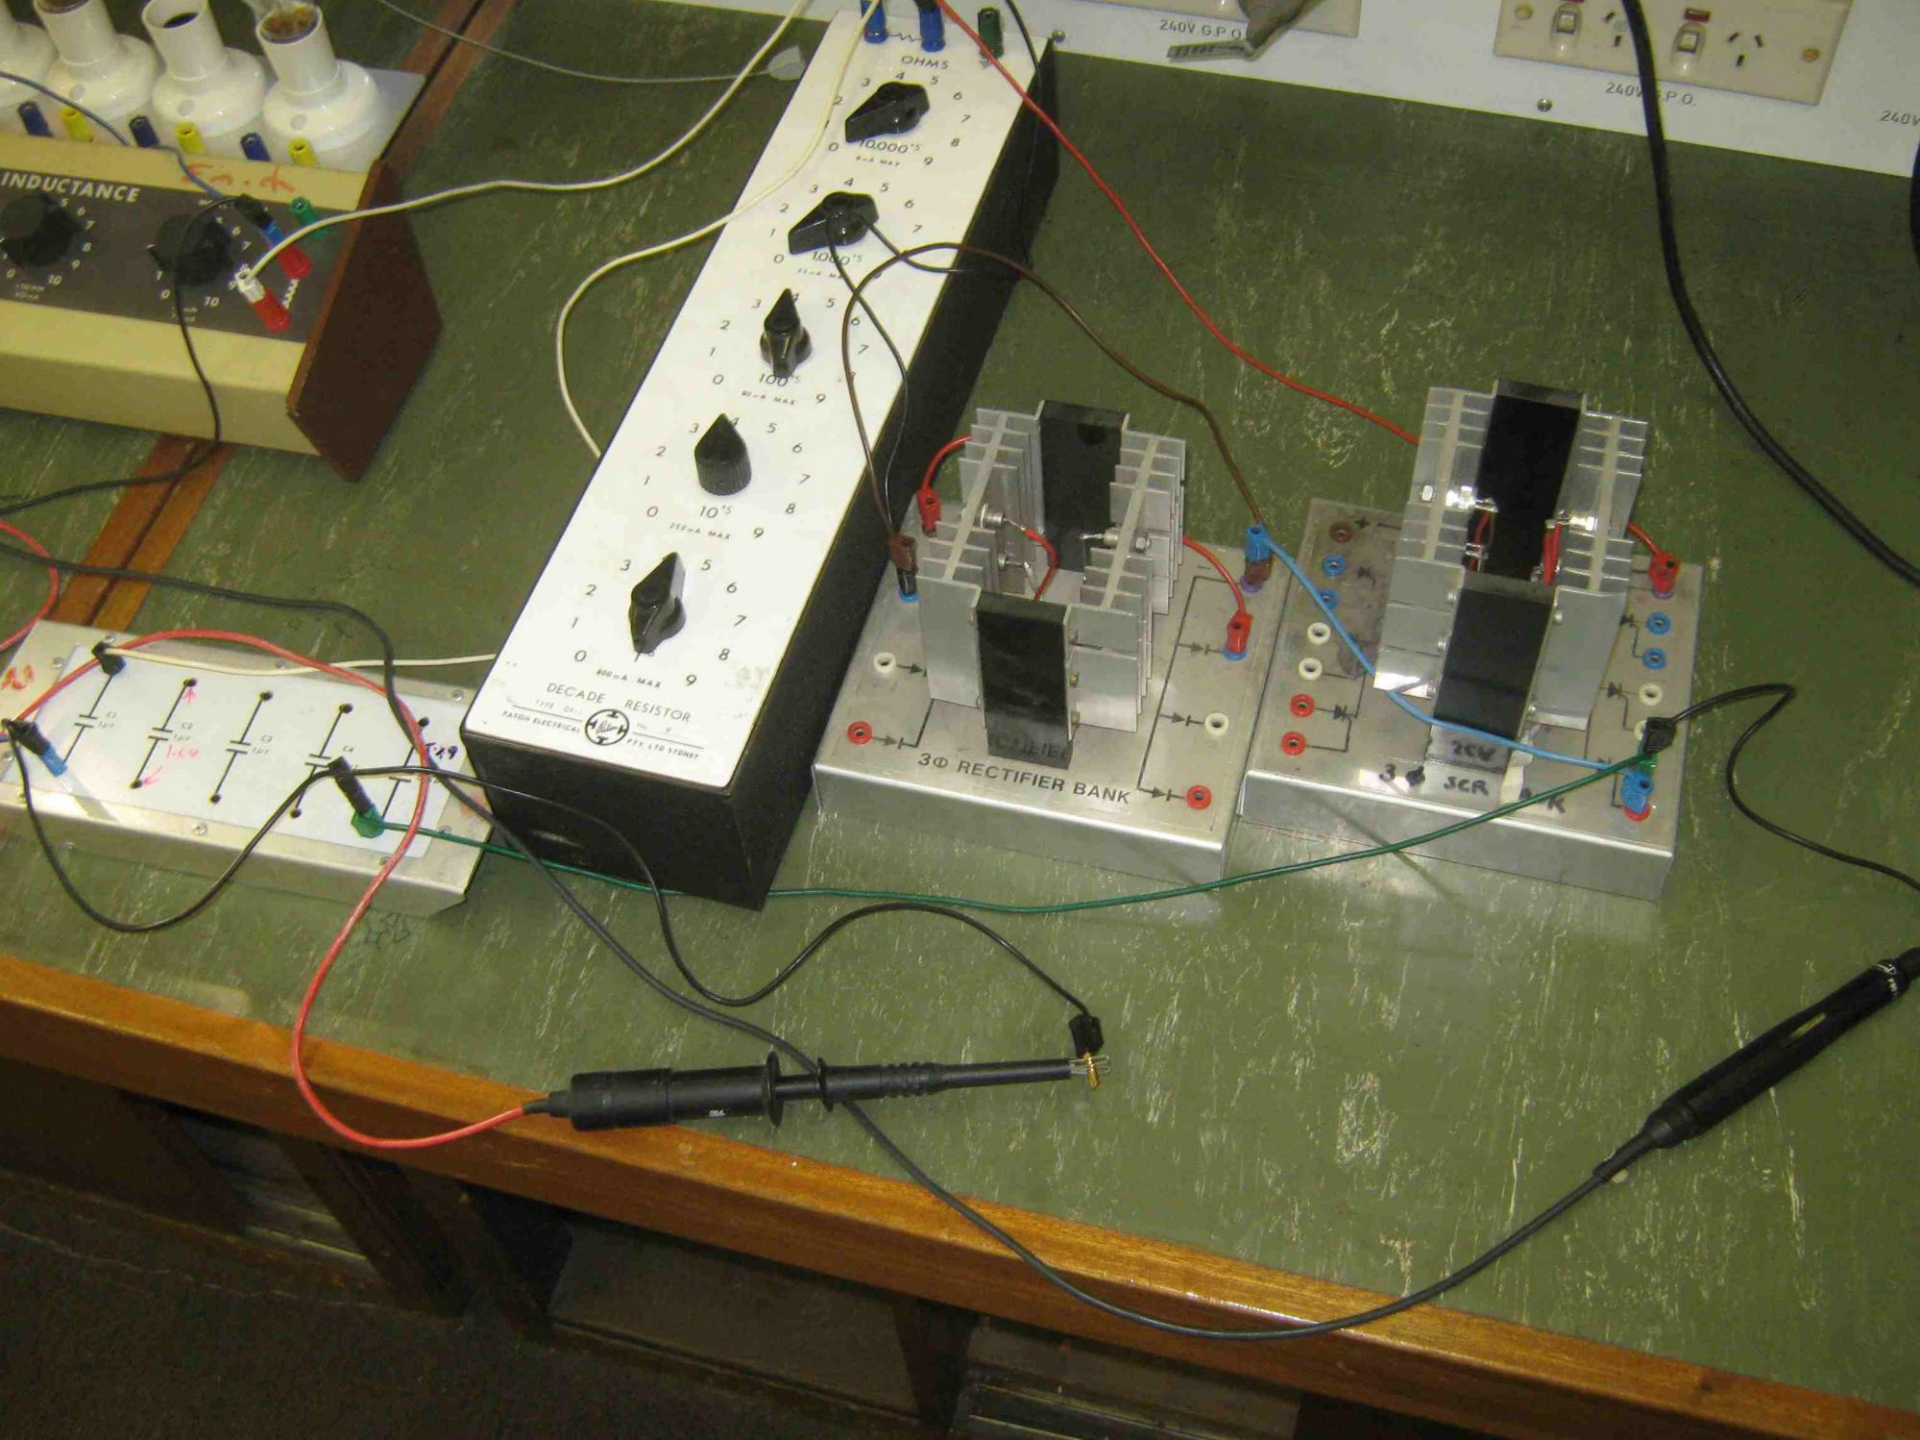

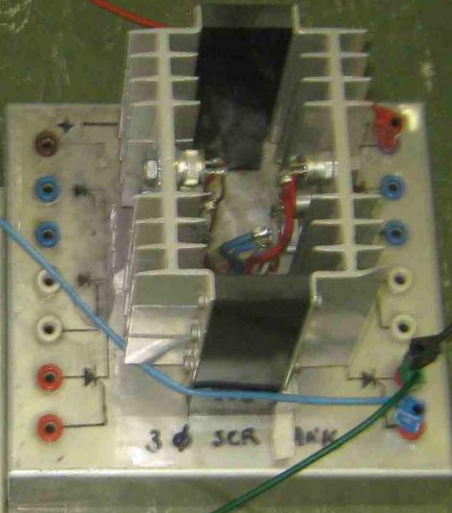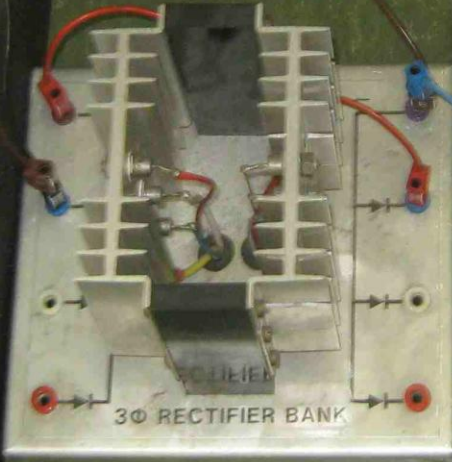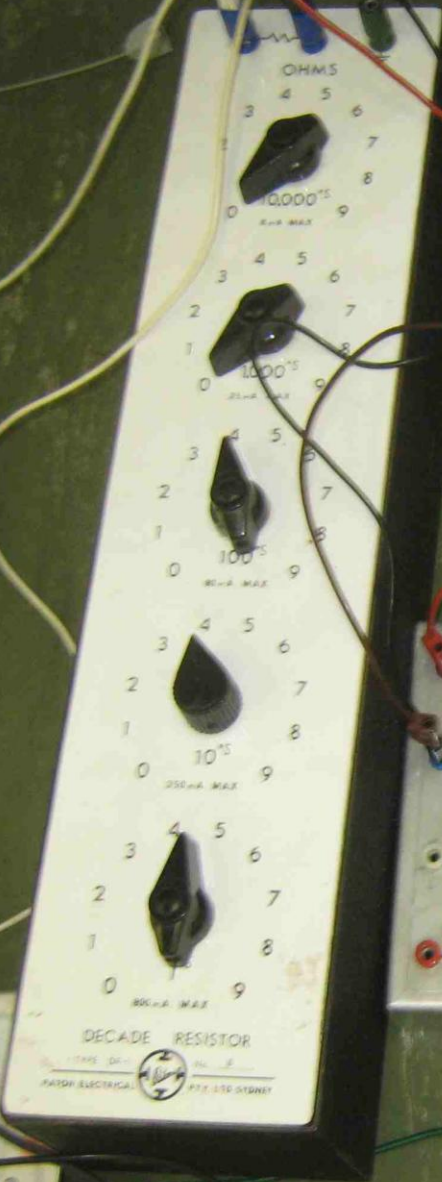

FORWARD  
ELECTRICAL  
LABORATORY  
100-1000 V  
100-1000 A  
100-1000 Hz



