

Australian/New Zealand Standard™

**Electrical installations—Selection of
cables**

**Part 1.1: Cables for alternating voltages
up to and including 0.6/1 kV—Typical
Australian installation conditions**



AS/NZS 3008.1.1:2009

This Joint Australian/New Zealand Standard was prepared by Joint Technical Committee EL-001, Wiring Rules. It was approved on behalf of the Council of Standards Australia on 14 September 2009 and on behalf of the Council of Standards New Zealand on 2 October 2009.

This Standard was published on 26 October 2009.

The following are represented on Committee EL-001:

Association of Consulting Engineers Australia
Australian Building Codes Board
Australian Industry Group
Communications, Electrical and Plumbing Union
Consumers' Federation of Australia
Electrical and Communications Association (Qld)
Electrical Contractors Association of New Zealand
Electrical Regulatory Authorities Council
Electrical Safety Organisation (New Zealand)
ElectroComms & Energy Utilities Industries Skills Council
Energy Networks Australia
Institute of Electrical Inspectors
Ministry of Economic Development (New Zealand)
National Electrical and Communications Association
New Zealand Council of Elders
New Zealand Electrical Institute
Telstra Corporation Limited

Keeping Standards up-to-date

Standards are living documents which reflect progress in science, technology and systems. To maintain their currency, all Standards are periodically reviewed, and new editions are published. Between editions, amendments may be issued. Standards may also be withdrawn. It is important that readers assure themselves they are using a current Standard, which should include any amendments which may have been published since the Standard was purchased.

Detailed information about joint Australian/New Zealand Standards can be found by visiting the Standards Web Shop at www.saiglobal.com.au or Standards New Zealand web site at www.standards.co.nz and looking up the relevant Standard in the on-line catalogue.

For more frequent listings or notification of revisions, amendments and withdrawals, Standards Australia and Standards New Zealand offer a number of update options. For information about these services, users should contact their respective national Standards organization.

We also welcome suggestions for improvement in our Standards, and especially encourage readers to notify us immediately of any apparent inaccuracies or ambiguities. Please address your comments to the Chief Executive of either Standards Australia or Standards New Zealand at the address shown on the back cover.

This Standard was issued in draft form for comment as DR 06745.

Australian/New Zealand Standard™

Electrical installations—Selection of cables

Part 1.1: Cables for alternating voltages up to and including 0.6/1 kV—Typical Australian installation conditions

Originated in Australia as AS 3008.1—1984.
Second edition 1989.
Jointly revised and redesignated AS/NZS 3008.1.1:1998.
Fourth edition 2009.
Reissued incorporating Amendment No. 1 (August 2011).

COPYRIGHT

© Standards Australia Limited/Standards New Zealand

All rights are reserved. No part of this work may be reproduced or copied in any form or by any means, electronic or mechanical, including photocopying, without the written permission of the publisher, unless otherwise permitted under the Copyright Act 1968 (Australia) or the Copyright Act 1994 (New Zealand).

Jointly published by SAI Global Limited under licence from Standards Australia Limited, GPO Box 476, Sydney, NSW 2001 and by Standards New Zealand, Private Bag 2439, Wellington 6140

ISBN 0 7337 9274 X

PREFACE

This Standard was prepared by the Joint Standards Australia/Standards New Zealand Committee EL-001, Wiring Rules, to supersede AS/NZS 3008.1.1:1998, *Electrical installations—Selection of cables*, Part 1.1 *Cables for alternating voltages up to and including 0.6/1 kV—Typical Australian installation conditions*.

This Standard incorporates Amendment No. 1 (August 2011). The changes required by the Amendment are indicated in the text by a marginal bar and amendment number against the clause, note, table, figure or part thereof affected.

This Standard is applicable to Australian installation conditions where the nominal ambient air and soil temperatures are 40°C and 25°C, respectively. Part 1.2 is applicable to New Zealand installation conditions where the nominal air and soil temperatures are 30°C and 15°C respectively. Each Part is a complete Standard and requires no reference to the other.

Part 2 will deal with cables for use with alternating voltages over 1 kV.

The objective of the Standard is to specify current-carrying capacity, voltage drop and short-circuit temperature rise of cables, to provide a method of selection for those types of electric cables and methods of installation that are in common use at working voltages up to and including 0.6/1 kV at 50 Hz a.c.

This Standard differs from the 1998 edition as follows:

- (a) The limitations of the installation of thermoplastic insulated cables have been further clarified.
- (b) An explanation has been provided regarding the properties of cross-linked materials at higher temperatures.
- (c) Information has been included on the effect of harmonic currents on balanced three-phase systems, the effect of parallel cables and the effect of electromagnetic interference.
- (d) Ratings for cables with flexible conductors and cables exposed to the sun have been extended in the tables of current-carrying capacities.
- (e) Thermoplastic insulated cables with temperature ratings of 90°C and 105°C have been included in the tables covering current-carrying capacities of cables with 90°C rated cross-linked insulation materials.
- (f) For cables with conductor sizes up to 10 mm² the values of current-carrying capacities for installation in underground wiring enclosures have also been used for the situation of installations 'buried direct'.
- (g) Current-carrying capacities for cables installed in wiring enclosures have been recalculated according to IEC 60287.
- (h) The values for all current-carrying capacities have been expressed to the nearest ampere to align with current IEC practice.
- (i) Additional values for a.c. resistance and three-phase voltage drop have been included for single-core aerial cables with bare or insulated conductors operating at a conductor temperature of 80°C.
- (j) Table headings have been simplified and now listed in an Appendix for ease of reference.

In the preparation of this Standard, reference was made to IEC 60287 and acknowledgment is made of the assistance received from that source.

Statements expressed in mandatory terms in notes to tables and figures are deemed to be requirements of this Standard.

The term 'informative' has been used in this Standard to define the application of the appendix to which it applies. An 'informative' appendix is only for information and guidance.

CONTENTS

	<i>Page</i>
SECTION 1 SCOPE AND APPLICATION	
1.1 SCOPE.....	6
1.2 APPLICATION	6
1.3 ALTERNATIVE SPECIFICATIONS	7
1.4 REFERENCED AND RELATED DOCUMENTS.....	7
1.5 DEFINITIONS.....	8
SECTION 2 CABLE SELECTION PROCEDURE	
2.1 GENERAL.....	10
2.2 SELECTION PROCESS.....	10
2.3 DETERMINATION OF MINIMUM CABLE SIZE BASED ON CURRENT-CARRYING CAPACITY CONSIDERATIONS.....	10
2.4 DETERMINATION OF MINIMUM CABLE SIZE BASED ON VOLTAGE DROP CONSIDERATIONS	11
2.5 DETERMINATION OF MINIMUM CABLE SIZE BASED ON THE SHORT-CIRCUIT TEMPERATURE CONSIDERATIONS	12
SECTION 3 CURRENT-CARRYING CAPACITY	
3.1 RATINGS.....	13
3.2 TYPES OF CONDUCTORS.....	13
3.3 TYPES OF CABLE	15
3.4 INSTALLATION CONDITIONS.....	16
3.5 EXTERNAL INFLUENCES ON CABLES	20
SECTION 4 VOLTAGE DROP	
4.1 GENERAL.....	86
4.2 DETERMINATION OF VOLTAGE DROP FROM MILLIVOLTS PER AMPERE METRE.....	86
4.3 DETERMINATION OF VOLTAGE DROP FROM CIRCUIT IMPEDANCE	87
4.4 DETERMINATION OF VOLTAGE DROP FROM CABLE OPERATING TEMPERATURE	88
4.5 DETERMINATION OF VOLTAGE DROP FROM LOAD POWER FACTOR.....	89
4.6 DETERMINATION OF VOLTAGE DROP IN UNBALANCED MULTIPHASE CIRCUITS	90
SECTION 5 SHORT-CIRCUIT PERFORMANCE	
5.1 GENERAL.....	113
5.2 FACTORS GOVERNING THE APPLICATION OF THE TEMPERATURE LIMITS.....	113
5.3 CALCULATION OF PERMISSIBLE SHORT-CIRCUIT CURRENTS.....	114
5.4 INFLUENCE OF METHOD OF INSTALLATION.....	115
5.5 MAXIMUM PERMISSIBLE SHORT-CIRCUIT TEMPERATURES	115

APPENDICES

A	EXAMPLES OF THE SELECTION OF CABLES TO SATISFY CURRENT-CARRYING CAPACITY, VOLTAGE DROP AND SHORT-CIRCUIT PERFORMANCE REQUIREMENTS.....	117
B	LIST OF TABLES	126
C	EXAMPLES OF THE APPLICATION OF REDUCTION FACTORS FOR HARMONIC CURRENTS	130
D	RECOMMENDED CIRCUIT CONFIGURATIONS FOR THE INSTALLATION OF SINGLE-CORE CABLES IN PARALLEL.....	131

STANDARDS AUSTRALIA/STANDARDS NEW ZEALAND

Australian/New Zealand Standard
Electrical installations—Selection of cables

**Part 1.1: Cables for alternating voltages up to and including 0.6/1 kV—
Typical Australian installation conditions**

SECTION 1 SCOPE AND APPLICATION

1.1 SCOPE

This Standard sets out a method for cable selection for those types of electrical cables and methods of installation that are in common use at working voltages up to and including 0.6/1 kV at 50 Hz a.c.

Three criteria are given for cable selection, as follows:

- (a) Current-carrying capacity.
- (b) Voltage drop.
- (c) Short-circuit temperature rise.

This Standard provides sustained current-carrying capacities and voltage drop values for those types of electrical cable and installation practices in common use in Australia. A significant amount of explanatory material is also provided on the application of rating factors that arise from the particular installation conditions of a single circuit or groups of circuits. Also, provided in Section 5 is information on cable selection based on short-circuit temperature limits.

NOTE: A number of worked examples on cable selection are included in Appendix A.

This Standard does not take into account the effects that may occur owing to temperature rise at the terminals of equipment and reference is necessary to AS/NZS 3000 and the individual equipment Standards.

NOTE: For ease of reference, an index of the Tables included in this Standard is provided in Appendix B.

1.2 APPLICATION

This Standard is intended to apply to installations made or carried out after the date of publication, but it is recommended that it not be applied on a mandatory basis until 6 months after the date of publication. However, if work on an installation commenced before publication of this edition, the inspecting authority may grant permission for the installation to be carried out in accordance with the superseded edition.

1.3 ALTERNATIVE SPECIFICATIONS

AS/NZS 3000 gives current-carrying capacities for a limited number of cable installation conditions. These conditions are included in this Standard but, in some cases, where recalculations have been performed, the tabulated values differ slightly between the Standards. Where this occurs the current-carrying capacity given in this Standard is considered to be more accurate, but either value is acceptable for the application of any appropriate requirements of AS/NZS 3000, e.g. maximum current rating of a circuit-protective device.

Where the type of cable or method of installation is not specifically covered in the tables of this Standard, current-carrying capacities obtained from alternative specifications such as ERA Report 69.30 may be employed.

ERA Report 69.30, particularly Part III, gives information on the following areas that are not covered by this Standard:

- (a) The d.c. current-carrying capacities of two single-core cables and one two-core cable.
- (b) The current-carrying capacity of armoured single-core cables.
- (c) Group rating factors for underground cables laid in tier formation.

Current-carrying capacities may also be determined by calculation using IEC 60287 or applying correction factors to the published data from IEC 60364-5-52 for local conditions.

The subject of assigning a current-carrying capacity to a cyclically or intermittently loaded cable is not covered in this Standard as it normally relates to HV cable installation. However, reference may be made to ERA Report F/T 186 for information on the determination of such cable ratings by calculation.

1.4 REFERENCED AND RELATED DOCUMENTS

1.4.1 Referenced documents

The following documents are referred to in this Standard:

STANDARDS

AS/NZS

- | | |
|----------|--|
| 1125 | Conductors in insulated electric cables and flexible cords |
| 3000 | Electrical installations (known as the Australian/New Zealand Wiring Rules) |
| 3008 | Electrical installations—Selection of cables |
| 3008.1.2 | Part 1.2: Cables for alternating voltages up to and including 0.6/1 kV—
Typical New Zealand installation conditions |

IEC

- | | |
|------------|--|
| 60287 | Electric cables—Calculation of the current rating (all Parts) |
| 60364 | Electrical installations of buildings |
| 60364-4-43 | Part 4-43: Protection for safety – Protection against overcurrent |
| 60364-5-52 | Part 5-52: Selection and erection of electrical equipment – Wiring systems |

ERA REPORTS

- | | |
|-------|---|
| 69.30 | Current rating standards for distribution cables
Part III: Sustained current ratings for PVC insulated cables to BS 6346:1969
(AC 50 Hz and DC) |
| 69.30 | Current rating standards for distribution cables
Part V: Sustained current ratings for cables with thermo-setting insulation to
BS 5467:1989 and BS 6724:1986 (AC 50 Hz and DC) |

F/T

186 Methods for the calculation of cyclic rating factors and emergency loading for cables laid direct in the ground or in ducts

1.4.2 Related documents

Attention is drawn to the following related documents.

AS

1531 Conductors—Bare overhead—Aluminium and aluminium alloy

1746 Conductors—Bare overhead—Hard-drawn copper

3158 Electric cables—Glass fibre insulated—For working voltages up to and including 0.6/1 (1.2) kV

AS/NZS

3191 Electric flexible cords

3560 Electric cables—Cross-linked polyethylene insulated—Aerial bundled—For up to and including 0.6/1 (1.2) kV

3560.1 Part 1: Aluminium conductors

3560.2 Part 2: Copper conductors

4026 Electric cables—For underground residential distribution systems

4961 Electric cables—Polymeric insulated—For distribution and service applications

5000 Electric cables—Polymeric insulated

5000.1 Part 1: For working voltages up to and including 0.6/1 (1.2) kV

5000.2 Part 2: For working voltages up to and including 450/750 V

5000.3 Part 3: Multicore control cables

60702 Mineral insulated cables and their terminations with a rated voltage not exceeding 750 V

60702.1 Part 1: Cables

IEC

60724 Short-circuit temperature limits of electric cables with rated voltages of 1.0 kV ($U_m = 1,2$ kV) and 3 kV ($U_m = 3,6$ kV)

1.5 DEFINITIONS

For the purpose of this Standard, the definitions in AS/NZS 3000 and those below apply.

1.5.1 Ambient temperature

The temperature of the medium in the immediate neighbourhood of the installed cable—

- (a) including any increase in temperature due to materials or equipment to which the cables are connected, or are to be connected; but
- (b) excluding any increase in temperature that may be due to the heat arising from the cables at that point.

1.5.2 Continuous loading

A continuous constant current (100% load factor) just sufficient to produce asymptotically the maximum conductor temperature, the surrounding ambient conditions being assumed constant.

1.5.3 Installation wiring

A system of wiring in which the cables are fixed or supported in position in accordance with the appropriate requirements of this Standard. Replaces the term 'fixed wiring'.

1.5.4 Ladder support

A support in which the impedance to the air flow around the cable is not greater than 10%, i.e. supporting metalwork under the cable occupies less than 10% of the plan area.

1.5.5 Perforated tray

A tray having not less than 30% of its surface area removed by the perforation.

1.5.6 Route length

The distance measured along a run of wiring from the origin of the circuit to the point of consideration, e.g. the distance measured between a switchboard and a motor.

SECTION 2 CABLE SELECTION PROCEDURE

2.1 GENERAL

The cable selection procedures set out in this Section detail the guidelines to be followed to determine the minimum size of cable required to satisfy a particular installation condition.

2.2 SELECTION PROCESS

The following three main factors influence the selection of a particular cable to satisfy the circuit requirements:

- (a) *Current-carrying capacity* Dependent upon the method of installation and the presence of external influences, such as thermal insulation, which restrict the operating temperature of the cable.
- (b) *Voltage drop* Dependent upon the impedance of the cable, the magnitude of the load current and the load power factor.
- (c) *Short-circuit temperature limit* Dependent upon energy produced during the short-circuit condition.

The minimum cable size will be the smallest cable that satisfies the three requirements. However, with experience it will become apparent that the different nature of installations will determine which of the requirements predominate. The current-carrying capacity requirement will be the most demanding in the relatively shorter route lengths of domestic premises and the like where factors such as cable grouping, and thermal insulation occur. On the other hand the voltage drop limitation is usually the deciding factor for longer route lengths that are not subject to the factors mentioned above. The need to increase cable size to meet the short-circuit temperature rise requirements will only occur in special situations for the voltage ratings of the cables covered by this Standard.

2.3 DETERMINATION OF MINIMUM CABLE SIZE BASED ON CURRENT-CARRYING CAPACITY CONSIDERATIONS

To satisfy the current-carrying capacity requirements of a circuit it is necessary to take into account a number of factors, as follows:

NOTE: Refer to Appendix A for examples, in particular Example 3, which shows the method used in this Clause.

- (a) Determine the current requirements of the circuit.

NOTE: Refer to the Clause in AS/NZS 3000 covering protection against overload current.

$$I_B \leq I_Z$$

I_B = the current for which the circuit is designed, e.g. maximum demand

I_Z = the continuous current-carrying capacity of the cable determined by Clause 2.3(d).

- (b) From Tables 3(1), 3(2), 3(3) and 3(4) determine the cable installation method to be used applicable to the common cross-linked elastomeric or thermoplastic-insulated cables.

NOTE: Determine the current-carrying Table and appropriate column of the Table for use in Clause 2.3(d).

- (i) For a single circuit, determine if the method of installation requires the application of a derating factor selected from Tables 22, 23 or 24. Where applicable, divide the value of current determined in Step (a) by the derating factor so determined.
- (ii) For a group of circuits, determine if the method of installation requires the application of a derating factor selected from Tables 22 to 26. Where applicable, divide the value of current I_B by the derating factor so determined.
- (c) Determine the environmental conditions in the vicinity of the cable installation. Where applicable, divide the value of current determined in Step (b) by—
 - (i) the ambient air or soil temperature rating factor selected from Tables 27(1) and 27(2);
 - (ii) the depth of laying rating factor selected from Tables 28(1) and 28(2); and
 - (iii) the soil thermal resistivity rating factor selected from Table 29.
- (d) The resulting value of current, determined from the calculations in Clauses 2.3(b) and 2.3(c), is used to select a cable from the current-carrying capacity Tables. This ensures that the cable will carry the design current I_B as per Clause 2.3(a) after derating.

Refer to the Tables of current-carrying capacity for the different cable types, Tables 4 to 21. Taking into account the method of installation employed, the smallest conductor size that has a tabulated current-carrying capacity equal to or in excess of this pre-determined minimum value will be considered to be the minimum cable size satisfying the current-carrying capacity requirement.

I_z is the tabulated rating multiplied by the derating factors.

2.4 DETERMINATION OF MINIMUM CABLE SIZE BASED ON VOLTAGE DROP CONSIDERATIONS

To satisfy the voltage drop limitations of a circuit, it is necessary to take into account the current required by the load and the route length of the circuit, as follows:

- (a) Determine the current (I) requirements of the circuit.
- (b) Determine the route length (L) of the circuit.
- (c) Determine the maximum voltage drop (V_d) permitted on the circuit run.

NOTE: Unless otherwise permitted by AS/NZS 3000, the maximum voltage drop between the point of supply for the low voltage electrical installation and any point in that electrical installation should not exceed 5% of the nominal voltage at the point of supply.

- (d) Determine the voltage drop (V_c) in millivolts per ampere metre (mV/A.m) using Equation 4.2(1) and the values of I , L and V_d determined in Steps (a), (b) and (c).
- (e) Refer to the tables of voltage drop (mV/A.m) for the different cable types, Tables 40 to 51. Taking into account the method of installation, maximum conductor operating temperature and load power factor, the smallest conductor size that has a tabulated voltage drop (mV/A.m) value nearest to, but not exceeding, the value determined in Step (d) will be considered to be the minimum cable size satisfying the voltage drop limitation.

This simplified method gives an approximate but conservative solution assuming maximum cable operating temperatures and the most onerous relationship between load and cable power factors. A more accurate assessment can be made of the actual voltage drop (V_d) using the appropriate equation of Clause 4.5, the cable reactance determined from Tables 30 to 33, the cable a.c. resistance determined from Tables 34 to 39 using the approximate conductor operating temperature assessed from Equation 4.4(1), and the load power factor.

NOTES:

- 1 If the value of voltage drop assessed using the appropriate equation of Clause 4.5 is significantly lower than the equivalent value determined using the simplified method suggested in Steps (a) to (e), consideration should be given to the calculation of voltage drop for the next smaller cable size.
- 2 Because of the need to make an initial set of assumptions relating to cable size, the calculation method of Clause 4.5 will normally only be of use to check the accuracy of the simplified method or to check the voltage drop on an existing or known cable installation.

2.5 DETERMINATION OF MINIMUM CABLE SIZE BASED ON THE SHORT-CIRCUIT TEMPERATURE CONSIDERATIONS

To satisfy the short-circuit temperature limit it is necessary to take into account the energy producing the temperature rise (I^2t) and the initial and final temperatures, as follows:

- (a) Determine the maximum duration and value of the prospective short-circuit current.
- (b) Determine the initial and final conductor temperatures and select an appropriate value of the constant (K) from Table 52.
- (c) Calculate the minimum cross-sectional area of the cable using Equation 5.3(1). This cable size represents the minimum size required to satisfy the short-circuit temperature rise requirements.

SECTION 3 CURRENT - CARRYING CAPACITY

3.1 RATINGS

3.1.1 General

The provisions of this Section apply to the selection of conductor sizes with regard to current-carrying capacity.

Clauses 3.2 to 3.5 stipulate conductor and cable requirements and installation conditions in order that the subsequent tables of current-carrying capacity may be applied.

Tables 3(1) to 3(4) give guidance on the appropriate table of current-carrying capacity for different installation methods for the common types of cable insulation covered by Tables 4 to 15. A specific installation condition is defined and illustrated and alternative installation conditions deemed to have the same current-carrying capacity are also given. Attention is drawn to tables of rated current-carrying capacity where the standard installation conditions of Clause 3.4 are varied.

Tables 4 to 21 give the current-carrying capacities for the variety of different cable types described in Clause 3.3.

3.1.2 Basis

The values for current ratings given in Tables 4 to 15 have been calculated using the method described in IEC 60287 except for cables partially or completely surrounded by thermal insulation and flat cables that have been assigned the same ratings as circular cables.

NOTE: Unless otherwise stated, PVC wiring enclosures have been used for installation in air and underground.

Furthermore it should be noted that the current ratings for 110°C rated cables enclosed in conduit in air assume the use of metallic conduit. The use of non-metallic conduits are not recommended.

3.2 TYPES OF CONDUCTORS

3.2.1 Conductor material

The current-carrying capacities are based on conductors of high-conductivity copper and aluminium in sizes, strandings and resistances complying with AS/NZS 1125.

3.2.2 Insulation material operating temperatures

The sustained current-carrying capacities are based on the 'normal use' temperatures specified in Column 2 of Table 1. Where the 'maximum permissible' temperature in Column 3 of Table 1 is greater than the 'normal use' temperature, the 'maximum permissible' temperature may only be used under the conditions described in Note 3 to Table 1 for thermoplastic cables and in Note 7 to Table 1 for MIMS cables.

NOTE: Where cables are consistently operating substantially below the limiting temperature of Table 1, the heat losses (I^2R) and voltage drop (IZ) will also be reduced. These features could be relevant in determining the optimum economic design of a circuit.

TABLE 1
LIMITING TEMPERATURES FOR INSULATED CABLES

1	2	3	4
Type of cable insulation	Operating temperatures of conductors, °C (see Note 1)		
	Normal use	Maximum permissible (see Note 2)	Minimum ambient
Thermoplastic (see Note 3)			
V-75	75	75	0
HFI-75-TP, TPE-75	75	75	-20
V-90	75	90	0
HFI-90-TP, TP-90	75	90	-20
V-90HT	75	105	0
Cross-linked elastomeric (see Note 4)			
R-EP-90	90	90	-40
R-CPE-90, R-HF-90, R-CSP-90	90	90	-20
R-HF-110, R-E-110 (see Note 5)	110	110	*
R-S-150 (see Note 6)	150	150	-50
Cross-linked polyolefin (XLPE) (see Note 4)			
X-90, X-90UV, X-HF-90	90	90	*
X-HF-110 (see Note 5)	110	110	*
Mineral-insulated metal-sheathed (MIMS) (see Note 7)	100 (sheath)	250 (sheath)	—
Other types			
PE, LLDPE	70	70	*
Type 150 fibrous or polymeric (see Note 6)	150	150	—

* Refer to manufacturer's information

NOTES:

- 1 The temperature limits specified in Table 1 relate to the sustained current-carrying capacity and do not represent the maximum permissible temperatures permitted under short-circuit conditions. A guide to the acceptable short-circuit temperature limits is given in Section 5.
- 2 The maximum permissible temperatures given in Column 3 are applicable when there is no chance of thermal deformation or a reasonable chance of human contact in normal use.
For safety reasons, where flexible cords may be exposed and are likely to be touched, the maximum permissible temperature should be limited (see Note 3 to Table 16).
- 3 The normal operating temperature of thermoplastic cables, including flexible cords installed as installation wiring, are based on a conductor temperature of 75°C. This is due to the risk of thermal deformation of insulation if the cables are clipped, fixed or otherwise installed in a manner that exposes the cable to severe mechanical pressure at higher temperatures.
V-90 and V-90HT insulated cables may be operated up to the maximum permissible temperatures 90°C and 105°C provided that the cable is installed in a manner that is not subject to, or is protected against, severe mechanical pressure at temperatures higher than 75°C. Such applications also allow for cables to be used in—
 - (a) locations where the ambient temperatures exceeds the normal 40°C, e.g. equipment wiring in luminaires and heating appliances, or in roof spaces affected by high summer temperatures; and
 - (b) locations affected by bulk thermal insulation that restricts the dissipation of heat from the cable.
- 4 Cross-linked elastomeric and cross-linked polyolefin materials have the property of maintaining their shape at higher temperatures and do not flow under mechanical pressure.
- 5 Cables with an operating temperature of 110°C should only be connected to equipment suitable for this temperature. Consideration should also be given to the voltage drop at this operating temperature.

- 6 The current-carrying capacities given in Table 17 for cables insulated with high temperature cross-linked elastomeric, polymeric or fibrous materials are based on cables operating at temperatures of 150°C in an ambient temperature of 40°C and where the hot cable surfaces are acceptable. However, the cables are generally installed in areas of high ambient temperature, such as equipment wiring, and it will be necessary to apply an appropriate temperature correction factor from Table 27.

The current-carrying capacities for fibrous and polymeric (fluoropolymer) type cables and cords suitable for operation at 200°C are not given in this Standard. As an alternative to the use of the relatively conservative values given in Table 27, advice may be sought from cable manufacturers.

- 7 The current-carrying capacities for MIMS cables are based on an operating temperature of 100°C for the external surface of either bare metal-sheathed cables or served cables. Higher continuous operating temperatures are permissible for bare metal-sheathed cables, particularly stainless steel sheathed cables, dependent upon factors such as the following:
- (a) The suitability of the cable terminations and mountings.
 - (b) The location of the cable away from combustible materials.
 - (c) The location of the cable away from areas where there is a reasonable chance of persons touching the exposed surface.
 - (d) Other environmental and external influences.

3.3 TYPES OF CABLE

3.3.1 Sheathed or unsheathed thermoplastic, cross-linked elastomeric and XLPE insulated cables

3.3.1.1 General

The current-carrying capacity of sheathed or unsheathed thermoplastic, cross-linked elastomeric or XLPE insulated cables shall be determined from Tables 4 to 15.

3.3.1.2 Method of installation

The current-carrying capacity of a given cable depends on the method of installation. Tables 3(1) to 3(4) provide a schedule of the installation methods applicable to sheathed or unsheathed cross-linked elastomeric or thermoplastic insulated cables whose current-carrying capacities are given in Tables 4 to 15. Tables 3(1) to 3(4) also draw attention to the different methods of installation that may be assigned the same current-carrying capacity and refers to tables of derating factors applicable where one circuit is run in close proximity to another circuit or circuits.

3.3.2 Flexible cords and cables

3.3.2.1 Used for installation wiring

The determination of current-carrying capacity of flexible cords and cables used for installation wiring shall be as given in Tables 4 to 15 and 17.

3.3.2.2 Other than installation wiring

The determination of current-carrying capacity of flexible cords and cables used for other than installation wiring shall be as follows:

- (a) *General* Except as provided in Item (b), the current-carrying capacity of flexible cords and cables not used as installation wiring shall be determined from Tables 16 and 17. The current-carrying capacity of flexible cables shall be determined from Tables 4 to 15.
- (b) *Connection of equipment* Where a flexible cord is—
 - (i) used for the connection of equipment to the installation wiring by means of a plug and socket; and
 - (ii) the equipment comes within the scope of associated Standards;
 the current-carrying capacity shall be determined from the appropriate Standard.

3.3.3 Mineral-insulated metal-sheathed (MIMS) cables

The current-carrying capacity of bare or served copper MIMS cables shall be determined from Tables 18 and 19.

NOTE: Current-carrying capacities are not given in this Standard for polyethylene served or other forms of MIMS cable used for heating purposes, such as trace heating, tank heating or floor warming.

3.3.4 Aerial cables

The current-carrying capacity of aerial cables shall be determined from Tables 20 and 21. See Clause 3.3.5 for the determination of the current-carrying capacity of neutral-screened aerial cables.

3.3.5 Neutral-screened cables

The current-carrying capacity of neutral-screened cables shall be determined from the number of cable cores and method of installation as follows:

- (a) For single-core neutral-screened cables Tables 10, 11 and 12.
(i.e. 2-conductors).
- (b) For 2-core, 3-core or 4-core neutral-screened Tables 13, 14 and 15.
cables (i.e. 3-conductor, 4-conductor and 5-
conductor).

However, the current-carrying capacity of neutral-screened aerial cables shall be determined as follows:

- (i) For 2-core (i.e. 3-conductor) neutral- Columns 8 to 10 and 15 to 17 of
screened cable. Table 20 or Table 21, as appropriate.
- (ii) For 2-core, 3-core or 4-core (i.e. 3-, 4- Columns 12 to 14 and 18 to 20 of
or 5-conductor) neutral screened cable. Table 20 or Table 21, as appropriate.

3.3.6 High temperature cross-linked elastomeric, polymeric or fibrous insulated cables and flexible cords

The current-carrying capacity of R-S-150 cross-linked elastomeric insulated cables, Type 150 heat-resisting fibrous insulated cables and 150°C rated fluoropolymer insulated flexible cords shall be determined from Table 17.

3.3.7 Other cable types

This Standard provides current-carrying capacities for types of cables that are considered to be in common use. For cables not included in this Standard, cable manufacturers should be consulted for recommendations on the current-carrying capacity and acceptable methods of installation.

3.4 INSTALLATION CONDITIONS

3.4.1 General

The current-carrying capacity of a cable is dependent on the method of installation to maintain the temperature of the cable within its operating limits. Different methods of installation vary the rate at which the heat generated by the current flow is dissipated to the surrounding medium.

Specific conditions of installation are laid down in Clauses 3.4.2 to 3.4.5 for cables installed with or without wiring enclosures in air, in the ground or embedded in building materials. These conditions have been used to derive the current-carrying capacities tabulated in Section 3. Where a number of installation conditions exist along a cable run or variations to the specific conditions occur, reference shall be made to Clauses 3.4.6 and 3.5 respectively.

3.4.2 Cables installed in air

For cables installed in free air, the current-carrying capacities shall be based on the following conditions of installation and operation:

- (a) *Ambient temperature* An ambient air temperature of 40°C.
- (b) *Unenclosed cables* Cables installed as follows:
 - (i) Directly in air and, except for flexible cables as mentioned in Note 2 to Table 1 and aerial cables, not exposed to direct sunlight and where they are—
 - (A) lying on a horizontal surface;
 - (B) lying across ceiling joists;
 - (C) supported on perforated or unperforated cable trays, ladders, hangers or racks;
 - (D) clipped at intervals to a vertical or horizontal surface, such as a wall or beneath a ceiling;
 - (E) suspended from a catenary wire;
 - (F) lying in the bottom of open trunking; or
 - (G) in an enclosure such as a switchboard.
 - (ii) Directly embedded beneath the surface of plaster, cement render or masonry.

NOTE: Table 3(1) contains a reference to the appropriate current-carrying capacity table for cables installed unenclosed in air.

- (c) *Enclosed cables* Cables installed as follows:
 - (i) In metallic or non-metallic wiring enclosure in—
 - (A) free air;
 - (B) a ventilated or enclosed trench;
 - (C) a concrete slab on or above the surface of the ground; or
 - (D) a concrete, plaster, cement rendered or masonry wall.
 - (ii) In closed trunking.
 - (iii) In an enclosed trench with removable covers.
 - (iv) Directly buried in concrete.

NOTES:

- 1 Table 3(2) contains a reference to the appropriate current-carrying capacity table for enclosed cables installed in air.
- 2 Where an otherwise unenclosed cable run includes short lengths of wiring enclosure that do not restrict the free circulation of air, the current-carrying capacity for unenclosed conditions may be assigned to the cable run provided that the following are complied with:
 - (a) The total above-ground sections do not exceed half the length of the cable run or 6 m, whichever is the shorter dimension.
 - (b) The wiring enclosure is not surrounded by thermal insulation.
 - (c) The wiring enclosure is of adequate size to permit free air circulation to dissipate any heat arising from the enclosed cables. This would be satisfied if the wiring enclosure—
 - (i) has a bore area not less than twice the total cross-sectional area of the enclosed live cables;
 - (ii) is arranged in a substantially vertical direction; and

(iii) has an open upper end or other means that will not restrict the escape of hot air to the surroundings.

- 3 Selection of wiring enclosure material needs to take into account the highest sheath temperature of the cable.

3.4.3 Cables installed in thermal insulation

For cables installed in thermal insulation the current-carrying capacities shall be based on the following conditions of installation and operation:

- (a) *Ambient temperature* An ambient temperature of the air surrounding the thermal insulation of 40°C.
- (b) *Unenclosed cables* Cables installed without further enclosure—
- (i) lying on a horizontal surface;
 - (ii) lying across ceiling joists;
 - (iii) supported on perforated or unperforated cable trays, ladders, hangers or racks;
 - (iv) clipped at intervals to a vertical or horizontal surface such as a wall or ceiling joist; or
 - (v) lying in the bottom of open trunking.
- (c) *Enclosed cables* Cables installed in—
- (i) metallic or non-metallic wiring enclosure; or
 - (ii) closed trunking or ducts.
- (d) *Bulk thermal insulation* Bulk thermal insulation installed as follows:
- (i) *Materials* Building materials installed to provide a thermal insulation including—
 - (A) fibreglass or rockwool batts;
 - (B) cellulose fibre, paper, cork, seagrass or similar organic materials that are normally installed in a loose-fill form; or
 - (C) expanded synthetic foams such as polystyrene, ureaformaldehyde or polyurethane, which may be installed by pumping or injection as a wet foam.

NOTE: Reflective foil laminates are not considered to be bulk thermal insulation.
 - (ii) *Completely surrounded installation* An installation method where bulk thermal insulation surrounds, and is in contact with, unenclosed or enclosed cables.
 - (iii) *Partially surrounded installation* An installation method where bulk thermal insulation is prevented from completely surrounding unenclosed or enclosed cable, such as where an unenclosed or enclosed cable is clipped to a structural member or is lying on a ceiling.

NOTE: Table 3(2) contains a reference to the appropriate current-carrying capacity table for cables installed in thermal insulation.

3.4.4 Cables buried direct in the ground

For cables buried direct in the ground, the current-carrying capacities shall be based on the following conditions of installation and operation:

- (a) *Ambient temperature* An ambient soil temperature of 25°C.

- (b) *Depth of laying* A depth of laying of 0.5 m measured from the ground surface to the centre of a cable, or to the centre of a trefoil group of cables.
- (c) *Thermal resistivity of soil* A soil thermal resistivity of 1.2°C.m/W.
- (d) *Spacing of cables* Cables are spaced as follows:
 - (i) *Single-core cables* Either—
 - (A) three single-core cables laid touching throughout in trefoil formation; or
 - (B) two or three single-core cables laid touching in flat formation.
 - (ii) *Multicore cables* Multicore cables laid singly.

NOTE: Table 3(3) contains a reference to the appropriate current-carrying capacity table for cables buried direct in the ground. See Clause 3.5.2.5 for spacing distances.

3.4.5 Cables installed in underground wiring enclosures

For cables installed in underground wiring enclosures, the current-carrying capacities shall be based on the following conditions of installation and operation:

- (a) *Ambient temperature* An ambient soil temperature of 25°C.
- (b) *Depth of laying* A depth of laying of 0.5 m measured from the ground surface to the centre of a wiring enclosure, or to the centre of a trefoil group of wiring enclosures.
- (c) *Thermal resistivity of soil* A soil thermal resistivity of 1.2°C.m/W.
- (d) *Spacing of wiring enclosures* Wiring enclosures shall be spaced as follows:
 - (i) Single-core cables in separate wiring enclosures with—
 - (A) two ducts side by side touching; or
 - (B) three ducts in trefoil, or in flat formation touching.
 - (ii) Single-core cables as a circuit in a single wiring enclosure.
 - (iii) Multicore cable in a single wiring enclosure.

NOTE: Table 3(4) contains a reference to the appropriate current-carrying capacity table for cables installed in underground wiring enclosures. See Clause 3.5.2.6 for spacing distances.

3.4.6 Variation of installation conditions along cable run

In situations where one method of installation is used for part of a cable run and other methods for the remainder, the current-carrying capacity of the cable run shall be limited to the lowest value of current determined for each method of installation employed, unless precautions to avoid cable overheating are taken.

NOTES:

- 1 An example of appropriate precautions is where long runs of cable buried direct in the ground are enclosed in wiring enclosures when passing beneath roadways and the like. The use of selected backfill materials over the enclosed cables can improve the conduction of heat away from the cables and as a consequence higher current-carrying capacities, in the order of that for buried direct cables, can be sustained by the short lengths of enclosed cables.
- 2 Note 2 to Clause 3.4.2 (c) describes a situation where a short length of suitably arranged enclosure may be disregarded for the assignment of a current-carrying capacity to an otherwise unenclosed cable run in air.
- 3 Attention is drawn to the connection of equipment to an underground cable run by means of short lengths of enclosed or unenclosed cables in air. The current-carrying capacity assigned to the underground portion of the cable run may be assigned to the above-ground portion where the prevailing installation conditions maintain the final operating temperature of the cable within the limits given in Table 1.

3.5 EXTERNAL INFLUENCES ON CABLES

3.5.1 Application of rating factors

The current-carrying capacity of a cable will be affected by the presence of certain external influences as detailed in Clauses 3.5.2 to 3.5.8. Under such conditions the current-carrying capacity given in Tables 4 to 21 shall be corrected by the application of an appropriate rating factor or factors obtained from Tables 22 to 29.

3.5.2 Effect of grouping of cables

3.5.2.1 General

The current-carrying capacities given in Tables 4 to 21 relate to single circuits.

Where a number of circuits are installed in the same group in free air, on a surface, buried direct in the ground or within the same sheath or wiring enclosure, in such a way that they are not independently cooled by the ambient air or the ground, the appropriate derating factor shall be as given in Tables 26 to 30.

Specific guidance on the use of Tables 22 to 26 is given in Clauses 3.5.2.3 to 3.5.2.7 and Table 3.

NOTES:

- 1 The derating factors have been calculated on the basis of sustained operation of all cables within the group. In most instances the loading on all cables in the group will not occur simultaneously and as a result actual factors may vary from those in Tables 22 to 26. Actual values would need to be calculated according to loading.
- 2 Where cables of different temperature rating are grouped, they should be rated at the rating appropriate to the lowest temperature cable, unless adequate spacing is provided in accordance with Figure 1.

3.5.2.2 Installation conditions that avoid derating

The derating factors of Tables 22 to 26 are not applicable to the following conditions of grouped cables:

- (a) *MIMS cables* MIMS cables without serving unless other types of cables are installed in close proximity or within the same wiring enclosure. The higher operating temperature achieved by grouping will not affect the mineral insulation of the unserved cable. However, care must be taken that the cable environment and means of support can withstand the higher temperatures.

NOTE: See Note 5 to Table 1.

- (b) *Limited length of grouping* Groups of cables such as at a switchboard entry, provided that the length of wiring enclosure does not exceed—
 - (i) for conductor sizes smaller than 300 mm² for aluminium or smaller than 150 mm² for copper: 1 m;
 - (ii) for conductor sizes of 300 mm² or larger for aluminium and 150 mm² or larger for copper: 3 m; or
 - (iii) half the length of the cable;
 whichever is the shorter dimension.
- (c) *Groups of circuits in free air* Groups of circuits installed unenclosed under the conditions and circuit arrangements depicted in Figure 1.
- (d) *Cables operating below current-carrying capacity* Cables that, as a result of the conditions of operation of the installation or cable selection practices, are operating at less than 35% of their current-carrying capacity (see Figure 1, Note 3).

Method of installation	Horizontal spacings	Vertical spacings
Cables suspended from a catenary wire where air circulation is unrestricted or spaced from surfaces and supported on ladders, racks, hangers or cleats where the impedance of the air flow around the cable is not greater than 10%		
Cables spaced from surfaces and supported on perforated or unperforated cable trays where air circulation is partially restricted		
Cables fixed directly to a wall, floor, ceiling or similar surface where air circulation is restricted		

(a) Single-core cables

Method of installation	Horizontal spacings	Vertical spacings
Cables suspended from a catenary wire where air circulation is unrestricted or spaced from surfaces and supported on ladders, racks, hangers or cleats where the impedance of the air flow around the cable is not greater than 10%		
Cables spaced from surfaces and supported on perforated or unperforated cable trays where air circulation is partially restricted		
Cables fixed directly to a wall, floor, ceiling or similar surface where air circulation is restricted		

(b) Multicore cables

FIGURE 1 MINIMUM CABLE SPACINGS IN AIR TO AVOID DERATING

NOTES TO FIGURE 1:

- 1 D equals the cable outside diameter or in the case of a flat multicore cable the maximum dimension of the cable.
- 2 For simplicity, the illustrations depict balanced multiphase circuits. Where a neutral conductor is required to be substantially loaded, it shall be placed adjacent to the associated active conductors and the clearance measured as appropriate (see Note 3 for lightly loaded or unloaded conductors).
- 3 The illustrations are intended to depict clearances required between cables operating at or near their sustained current-carrying capacity. Where the loading of any cable is less than 35% of such sustained capacity it may be disregarded from the cable arrangements as its contribution to the mutual heating of the group will be small. Such cables, which would include earthing conductors, lightly loaded neutrals and unloaded control wiring, may be placed adjacent to, or between, groups of associated loaded conductors.
- 4 Where the cables concerned are not of the same size, the spacing will be based on the largest cable diameter in the adjacent groups.
- 5 The spacings are essentially minimum requirements to avoid derating and care should be taken, particularly with smaller spacings, to avoid installation methods that would reduce these clearances. No restriction is placed on the number of circuits that may be arranged horizontally with the spacings given. However, care should be taken if more than three circuits are arranged vertically and full cable utilization is required.
- 6 Where the spacings are not achieved, smaller spacings and derating factors are laid down in the following tables:
 - (a) For circuits installed directly on walls, floors or ceilings Table 22.
 - (b) For circuits installed on trays, ladder supports, racks, hangers or cleats..... Tables 23 and 24.
- 7 Proportionally smaller spacings would be acceptable where the cables in the group are not loaded to the full current-carrying capacity. In such cases appropriate rating factors may be obtained from ERA Report 69-30.

3.5.2.3 Cables run horizontally

For cables installed horizontally the following shall apply:

- (a) *Unenclosed on cable tray, ladder support, rack hanger or cleat* Where a single-core or multicore cable is installed horizontally in close proximity to a cable or cables of another circuit and—
 - (i) it is on perforated or unperforated trays, ladder supports, racks, hangers or cleats; and
 - (ii) it is either—
 - (A) touching the other cable or cables; or
 - (B) in terms of its spacing from the other cable or cables, less than that specified in Clause 3.5.2.2(c) and Figure 1;

the appropriate derating factor shall be as given in Table 23 or Table 24.
- (b) *Enclosed, fixed to a surface, or bunched in free air* Where a single-core or multicore cable is installed horizontally in close proximity to a cable or cables of another circuit—
 - (i) within a wiring enclosure;
 - (ii) on a surface, wall, floor or ceiling, spaced or touching;
 - (iii) bunched in free air; or
 - (iv) suspended from a catenary;

the appropriate derating factor shall be as given in Table 22.

3.5.2.4 Cables run vertically

Where a cable is installed vertically, the appropriate current-carrying capacities and derating factors shall be—

- (a) obtained from Tables 22 to 24 as for cables run horizontally; and

- (b) determined in accordance with Clause 3.5.3 using the highest ambient air temperature up the cable run, if a barrier is not provided at intervals of 3.5 m or less to prevent the vertical flow of air along the cable.

3.5.2.5 *Cables buried direct in the ground*

Where a single-core or multicore cable is buried directly in the ground and is separated by not less than 2 m from a cable or cables of another circuit carrying substantial currents, no derating factor need be applied. Where the circuits are separated by less than 2 m, the appropriate derating factor shall be obtained from Table 25 or, for installation methods not covered in this Standard, alternative specifications as recommended in Clause 1.3.

NOTE: The derating factors have been determined from the hottest cable in the group and assume that all cables are of the same thermal grade of insulation.

3.5.2.6 *Cables in wiring enclosures*

For cables in enclosures the following shall apply:

- (a) *Underground wiring enclosures* Where a single-core or multicore cable is installed in an underground wiring enclosure and is separated by not less than 2 m from a cable or cables of another enclosed circuit carrying substantial currents, no derating factor need be applied. Where the enclosed circuits are separated by less than 2 m, the appropriate derating factor shall be as given in Table 26 or, for installation methods not covered in this Standard, alternative specifications as recommended in Clause 1.3.
- (b) *Other enclosures* Where cables are installed in an enclosure such as a switchboard, the current-carrying capacity shall be determined from the unenclosed in air conditions in Tables 4 to 10 with due regard being given to the derating factors when circuits are bunched.

NOTE: The selection of the derating factor should be based on the number of circuits that would be loaded; for example, where nine circuits are bunched but only six are loaded at any one time, a derating factor of 0.57 from Table 22 would be applicable.

3.5.2.7 *Conductors connected in parallel or passing more than once within a group or enclosure*

In applying the derating factors of Tables 22 to 26 where—

- (a) a group of conductors forming a circuit passes more than once through the same wiring enclosure, group of cables or group of enclosures; or
- (b) groups of conductors are connected in parallel;

each separate group of conductors shall be regarded as a separate circuit.

3.5.2.8 *Cables on drums or reels*

Where layers of flexible cables are wound on a cylindrical-type drum or reel, the current-carrying capacity of the cable shall be derated by the appropriate factor, as follows:

<i>Number of layers:</i>	1	2	3	4
<i>Derating factor:</i>	0.85	0.65	0.45	0.35

Where a single spiral layer of flexible cable is accommodated on a radial-type drum, the current-carrying capacity of the cable shall be derated by a factor of 0.85 for ventilated drums and 0.75 for unventilated drums.

3.5.3 **Effect of ambient temperature**

The current-carrying capacities given in the tables of this Standard are based on a consistent ambient air temperature of 40°C and an ambient soil temperature of 25°C. Where other ambient temperatures apply, the appropriate rating factors shall be as given in Table 27.

NOTES:

- 1 In New Zealand the conditions of installation specify an ambient temperature of 30°C and a soil temperature of 15°C. A complete set of current rating tables, calculated for New Zealand conditions, is given in AS/NZS 3008.1.2.
- 2 Particular consideration should be given to the existence of higher ambient air temperatures in confined roof spaces, boiler rooms, cable tunnels, vertical shafts and the like. Similarly, lower ambient temperatures may apply for cables installed in concrete slabs on or above the surface of the ground.
- 3 In practice the ambient air temperature may be measured by one of the following simple methods:
 - (a) *Before installation of cables* Measurement may be made by temperature sensors placed in free air as close as practicable to the position at which the cables are to be installed.
 - (b) *After installation of cables* Measurement may be made by temperature sensors placed in free air in the vicinity of the cables in such a position that readings are not influenced by heat arising from the cables. Where the measurements are made while the cables are loaded, e.g. as may be required by Clause 3.5.2.4 for vertical cable runs, the sensors should be placed approximately 500 mm, or 10 times the overall diameter of the cable, from the cables in a horizontal plane, or 150 mm below the cables.

If at the cable position, the ambient temperature, including any increase of temperature due to heat arising from equipment to which the cables are connected, does not exceed 40°C except for infrequent combinations of weather and load currents, then the current-carrying capacities given in the tables apply without correction.

3.5.4 Effect of depth of laying

The current-carrying capacities given in the tables of this Standard are based on a depth of laying of 0.5 m as specified in Clauses 3.4.4 and 3.4.5. Where other depths of laying apply, the appropriate rating factors shall be as given in Table 28.

NOTE: The rating factors are based on the assumption that the effective thermal resistivity of the ground is constant from a depth of 0.5 m to 3 m. Above and below these respective limits it is considered that a reduction in effective thermal resistivity occurs due to the composition and moisture content of the soil.

3.5.5 Effect of thermal resistivity of soil

The current-carrying capacities given in the tables of this Standard are based on a soil thermal resistivity of 1.2°C.m/W.

Soil thermal resistivity varies greatly with soil composition, moisture retention qualities and seasonal weather patterns as well as the variation in load carried by the cable. Higher current-carrying capacities are obtained in clay or peat soils, which may have resistivities as low as 0.8°C.m/W. Similarly, values as high as 2.5°C.m/W may be associated with well drained sands for constantly loaded cables. The value of 1.2°C.m/W has been selected as an average figure on the basis of soil types and assumes maximum thermal resistivity at times of maximum load.

If possible the actual value should be measured along the cable route as it can greatly affect the current-carrying capacity of the cable. Where values for soil resistivities other than 1.2°C.m/W apply, the appropriate rating factors may be obtained from Table 29.

NOTE: Where the soil is known to be of poor quality and has a thermal resistivity greater than 1.2°C.m/W throughout much of the year, consideration should be given to the use of a selected or stabilized backfill material around the cables or wiring enclosures.

Such backfill should completely surround the cable with a minimum thickness of 200 mm and could be used in lieu of the bedding required in AS/NZS 3000.

The following two types of material have a worst-case or dried-out thermal resistivity in the order of 1.2°C.m/W:

- (a) *Cement-bound sand* A mixture of sand bound with cement in the ratio of 14:1 by volume, with water added to enable adequate compaction to be achieved.
- (b) *Gravel/sand* A mixture of a selected sand having a dried-out thermal resistivity of not greater than 2.7°C.m/W, with an equal quantity of 10 mm coarse aggregate.

3.5.6 Effect of varying loads

The current-carrying capacities given in the tables of this Standard and the derating factors given in Clauses 3.5.2 to 3.5.5 are based on continuous loading on all conductors. Where it can be shown that intermittent load variations will occur or that all conductors cannot be loaded simultaneously, appropriate uprating factors may be applied.

In many installations, groups of cables comprise a mixture of loaded and unloaded cables at any one time and the designer may justify the use of alternative derating factors to those specified in Tables 22 to 26, if the connected loads have a known diversity. If the diversity is unknown or unobtainable by experiment, the design may have to be based on worst-case analysis of the possible load combinations at any one time. Some information on the diversity of certain loads may be obtained from the determination of maximum demand in AS/NZS 3000.

3.5.7 Effect of thermal insulation

Current-carrying capacities are given in Tables 4 to 15 of this Standard for unenclosed or enclosed cables surrounded by bulk thermal insulating materials that affect the rate of heat dissipation from the cables.

The rate of heat dissipation varies with the type and thickness of material used. A comparative measure of the performance of different materials is known as the R-factor.

The current-carrying capacity values in the tables are based upon typical installation conditions and a range of different materials as described in Clause 3.4.3. Where different materials or installation conditions are used such that the rate of heat dissipation is adversely or favourably affected, lower or higher current-carrying capacities may be obtained respectively.

NOTES:

- 1 Where a length of cable not exceeding 150 mm passes through bulk thermal insulation, e.g. for the connection of a lighting point, the cable need not be considered as being surrounded by thermal insulation.
- 2 A cable is considered to be affected by thermal insulation if it is embedded in, or surrounded by, insulating material. Cables lying on top of suitably rigid material do not in general come into this consideration.

3.5.8 Effect of direct sunlight

Current-carrying capacities are given in Tables 4 to 15, 20 and 21 for cables exposed to direct sunlight. For other types of cable installed in locations exposed to direct solar radiation it will be necessary to make some provision for the effects of the increased heating. This may be achieved by one of the following means:

- (a) Provision of a shield, screen or enclosure that allows for the natural ventilation of the cable.
- (b) Reduction of the current-carrying capacity of the cable by an appropriate amount in accordance with the higher air temperature. As a rule-of-thumb alternative to any recommendation from a cable manufacturer, a correction factor obtained from Table 27(1) for a temperature 20° higher than the ambient air temperature may be applied.

NOTE: For further information on the effects of ultraviolet radiation, it is recommended that the cable manufacturer be consulted.

3.5.9 Effect of harmonic currents on balanced three-phase systems

Where the neutral conductor carries current without a corresponding reduction in load of the phase conductors, the current flowing in the neutral conductor shall be taken into account in ascertaining the current-carrying capacity of the circuit.

This clause is intended to cover the situation where there is current flowing in the neutral of a balanced three-phase system. Such neutral currents are due to the line currents having a harmonic content that does not cancel in the neutral. The most significant harmonic that does not cancel in the neutral is usually the third harmonic. The magnitude of the neutral current due to the third harmonic may exceed the magnitude of the power frequency phase current. The neutral current will then have a significant effect on the current-carrying capacity of the cables in the circuit.

The reduction factors given in this Clause apply to balanced three-phase circuits; it is recognized that the situation is more onerous if only two of the three phases are loaded. In this situation the neutral conductor will carry the harmonic currents in addition to the unbalanced current. Such a situation can lead to overloading of the neutral conductor.

Equipment likely to cause significant harmonic currents are, for example, fluorescent lighting banks and d.c. power supplies such as those found in computers.

The reduction factors given in Table 2 only apply to cables where the neutral conductor is within a four- or five-core cable and is of the same material and cross-sectional area as the phase conductors. These reduction factors have been calculated based on third harmonic currents. If significant, more than 10%, higher harmonics, 9th, 12th, etc. are expected then lower reduction factors are applicable. Where there is an unbalance between phases of more than 50% then lower reduction factors may be applicable.

The tabulated reduction factors, when applied to the current-carrying capacity of a cable with three loaded conductors, will give the current-carrying capacity of a cable with four loaded conductors where the current in the fourth conductor is due to harmonics. The reduction factors also take the heating effect of the harmonic current in the phase conductors into account.

Where the neutral current is expected to be higher than the phase current then the cable size should be selected on the basis of the neutral current.

Where the cable size selection is based on a neutral current that is not significantly higher than the phase current, it is necessary to reduce the tabulated current-carrying capacity for three loaded conductors.

If the neutral current is more than 135% of the phase current and the cable size is selected on the basis of the neutral current then the three-phase conductors will not be fully loaded. The reduction in heat generated by the phase conductors offsets the heat generated by the neutral conductor to the extent that it is not necessary to apply any reduction factor to the current-carrying capacity for three loaded conductors.

TABLE 2
REDUCTION FACTORS FOR HARMONIC CURRENTS
IN 4- AND 5-CORE CABLES

Third harmonic content of phase current %	Reduction factor	
	Size selection is based on phase current	Size selection is based on neutral current
0 – 15	1.0	—
15 – 33	0.86	—
33 – 45	—	0.86
> 45	—	1.0

NOTE: Examples of the application of reduction factors for harmonic currents are provided in Appendix C.

3.5.10 Effect of parallel cables

Current-carrying capacities for circuits comprising parallel multicore cables or groups of single-core cables can be determined from the sum of the current-carrying capacity of the various cables provided that consideration is given to—

- (a) grouping cables and the effect of cooling by the ambient air or the ground on each parallel cable or group; and
- (b) load current sharing between each parallel cable or group so as to prevent overheating of any cable or group.

Equal load current sharing is generally achieved by the selection and installation of cables to give the same impedance, i.e. by using cables of the same conductor material and construction installed over the same route. Mutual impedance is also affected by the configuration of cables within and between each group.

NOTES:

- 1 Table D1 of Appendix D provides recommended circuit configurations for the installation of parallel single-core cables in electrically symmetric groups. The recommended method is to use trefoil groups containing each of the three-phase conductors and neutral in each group.
- 2 Unequal load current sharing between cables or groups may be permitted provided that the design current and overcurrent protection requirements for each cable or group are considered individually. IEC 60364-4-43 provides further information on the conditions under which this is permitted.

3.5.11 Effect of electromagnetic interference

Certain types of electrical installations, e.g. those containing sensitive electronic equipment or systems, may require minimization of electromagnetic interference arising from magnetic fields developed from current flowing in cables. This may be addressed by—

- (a) selection of cables designed for low magnetic field emissions; or
- (b) installation of cables in enclosures that contain or shield magnetic fields; or
- (c) installation of cables in configurations that produce low magnetic fields.





NOTE: Table D1 of Appendix D provides recommended circuit configurations for the installation of parallel single-core cables in groups that produce reduced levels of magnetic field.

TABLE 3(1)
SCHEDULE OF INSTALLATION METHODS FOR CABLES DEEMED TO HAVE
THE SAME CURRENT-CARRYING CAPACITY AND CROSS-REFERENCES TO
APPLICABLE DERATING TABLES—UNENCLOSED IN AIR

1	2	3	4	5	6
Item No.	Cable details (see Note 2)	Reference drawing (see Note 3)	Current-carrying capacity table reference	Methods of installation for cables deemed to have the same current-carrying capacity (See Notes 4, 5 and 6)	Derating table
1	Two single-core cables		Tables 4 and 5 Columns 2 to 4 Table 6 Columns 2 and 3	Cables with minimum cable separation in air as shown for horizontal and vertical mounting and installed— (a) spaced from a wall or vertical surface; (b) supported on ladders, racks, perforated trays, cleats or hanger; or (c) suspended from a catenary wire.	23
2	Three single-core cables		Tables 7 and 8 Columns 2 to 4 Table 9 Columns 2 and 3		22
3					
4	Two single-core cables		Tables 4 and 5 (see Note 5) Columns 5 to 7 Table 6 Columns 2 and 3	Cables with minimum cable spacings in air as shown and installed— (a) spaced from a wall or vertical surface; (b) supported on ladders, racks, perforated or unperforated trays, cleats or hangers; (c) in a switchboard or similar enclosure; or (d) suspended from a catenary wire.	23
5	Three single-core cables		Tables 7 and 8 (see Note 5) Columns 5 to 7 Table 9 Columns 4 and 5		22
6					
7	Two single-core cables		Tables 4 and 5 (see Note 4) Columns 8 to 10 Table 6 Columns 6 and 7	Cables of the one circuit touching and installed— (a) clipped direct to a wall, floor, ceiling or similar surface; (b) in a ventilated trench or open trunking; (c) buried directly in a plaster or render on a wall; or (d) in a switchboard or similar enclosure.	22
8	Three single-core cables		Tables 7 and 8 (see Note 4) Columns 8 to 10 Table 9 Columns 6 and 7.		

(continued)









TABLE 3(1) (continued)

1	2	3	4	5	6
Item No.	Cable details (see Note 2)	Reference drawing (see Note 3)	Current-carrying capacity table reference	Methods of installation for cables deemed to have the same current-carrying capacity (See Notes 4, 5 and 6)	Derating table
9	Two-core cables		Tables 10 and 11 (see Note 5) Columns 2 to 4 Table 12 Columns 2 and 3	Cables with minimum spacings in air as shown and installed— (a) spaced from a wall or vertical surface; (b) supported on ladders, racks, perforated or unperforated trays, cleats or hangers; (c) in a switchboard or similar enclosure; or (d) suspended from a catenary or as a self-supported overhead cable.	24
10	Three-core cables		Tables 13 and 14 (see Note 5) Columns 2 to 4 Table 15 Columns 2 and 3		
11			(d) suspended from a catenary or as a self-supported overhead cable.		
12	Two-core cables		Tables 10 and 11 (see Note 4) Columns 5 to 7 Table 12 Columns 4 and 5	Cables installed— (a) clipped direct to a wall, floor, ceiling or similar surface; (b) buried directly in concrete or masonry above the ground or in plaster or render on a wall; (c) in a ventilated trench or open trunking; or (d) in a switchboard or similar enclosure	22
13	Three-core cables		Tables 13 and 14 (see Note 4) Columns 5 to 7 Table 15 Columns 4 and 5		

NOTES:







- D equals the cable outside diameter or in the case of a flat multicore cable the maximum dimension of the cable.
- Earthing conductors, lightly loaded neutral conductors of three-phase circuits and conductors subject only to momentary loading, such as control wiring, shall not be counted in the number of cable cores.
- See column headings of Tables 4 to 15.
- See Table 22 for the derating factor applicable to a single circuit fixed to the underside of a ceiling or similar horizontal surface.
- See Tables 23 and 24 for the derating factors applicable to a single circuit fixed to perforated or unperforated trays.
- See AS/NZS 3000 for the restricted installation conditions of certain types of cable, e.g. unarmoured cables in plaster or cement render on walls.

TABLE 3(2)
SCHEDULE OF INSTALLATION METHODS FOR CABLES DEEMED TO HAVE
THE SAME CURRENT-CARRYING CAPACITY AND CROSS-REFERENCES TO
APPLICABLE DERATING TABLES—ENCLOSED

1	2	3	4	5	6
Item No.	Cable details (see Note 1)	Reference drawing (see Note 2)	Current-carrying capacity table reference	Methods of installation for cables deemed to have the same current-carrying capacity (See Note 3)	Derating table for more than one circuit
1	Two single-core cables		Tables 4 and 5 Columns 15 to 17 Table 6 Columns 11 and 12	Cables in wiring enclosures installed in— (a) air; (b) plaster, cement render, masonry or concrete in a wall or floor; (c) a concrete slab on or above the surface of the ground; or (d) a ventilated trench. Cables installed in— (a) a wiring enclosure on a wall; or (b) an enclosed trench with a removable cover.	22
2	Three single-core cables		Tables 7 and 8 Columns 15 to 17 Table 9 Columns 11 and 12		
3	Two single-core cables	 	Tables 4 and 5 Columns 18 and 19 Table 6 Column 13	Cables enclosed or unenclosed— (a) partially surrounded by thermal insulation material; or (b) in an enclosed trench.	22
4	Three single-core cables	 	Tables 7 and 8 Columns 18 and 19 Table 9 Column 13		
5	Two single-core cables		Tables 4 and 5 Columns 20 and 21 Table 6 Column 14	Unenclosed cables completely surrounded by thermal insulation.	22
6	Three single-core cables		Tables 7 and 8 Columns 20 and 21 Table 9 Column 14		

(continued)





TABLE 3(2) (continued)

1	2	3	4	5	6
Item No.	Cable details (see Note 1)	Reference drawing (see Note 2)	Current-carrying capacity table reference	Methods of installation for cables deemed to have the same current-carrying capacity (See Note 3)	Derating table for more than one circuit
7	Two-core cables		Tables 10 and 11 Columns 11 to 13 Table 12 Columns 9 and 10	Cables in wiring enclosures installed in— (a) air; (b) plaster, cement render, masonry or concrete in a wall or floor; (c) a concrete slab on or above the surface of the ground; or (d) a ventilated trench. Cables installed in— (a) closed trunking, or wiring enclosures on a wall; or (b) an enclosed trench with a removable cover.	22
8	Three-core cables		Tables 13 and 14 Columns 11 to 13 Table 15 Columns 9 and 10		
9	Two-core cables		Tables 10 and 11 Columns 15 to 18 Table 12 Column 11	Enclosed or unenclosed cables partially surrounded by thermal insulation.	22
10	Three-core cables		Tables 13 and 14 Columns 15 to 18 Table 15 Column 11		
11	Two-core cables		Tables 10 and 11 Columns 19 to 22 Table 12 Column 12	Enclosed or unenclosed cables completely surrounded by thermal insulation.	22
12	Three-core cables		Tables 13 and 14 Columns 19 to 22 Table 15 Column 12		

NOTES:

- 1 Earthing conductors, lightly loaded neutral conductors of three-phase circuits and conductors subject only to momentary loading, such as control wiring, shall not be counted in the number of cable cores.
- 2 See column headings of Tables 4 to 15.
- 3 See AS/NZS 3000 for the restricted installation conditions of certain types of cables, e.g. insulated or insulated and sheathed cables in metallic and non-metallic conduits.

TABLE 3(3)
SCHEDULE OF INSTALLATION METHODS FOR CABLES DEEMED TO HAVE THE SAME CURRENT-CARRYING CAPACITY AND CROSS-REFERENCES TO APPLICABLE DERATING TABLES—BURIED DIRECT IN THE GROUND







1	2	3	4	5	6	
Item No.	Cable details (see Note 1)	Reference drawing (see Note 2)	Current-carrying capacity table reference	Methods of installation for cables deemed to have the same current-carrying capacity (see Note 3)	Derating table for more than one circuit	
1	Two single-core cables		Tables 4 and 5 Columns 22 and 23 Table 6 Column 15	Cables with a minimum depth of laying of— (a) 0.3 m under continuous concrete paved areas; or (b) 0.5 m in other locations.	25(1)	
2	Three single-core cables		Tables 7 and 8 Columns 22 and 23 Table 9 Column 15		Cables with a minimum depth of laying of— (a) 0.3 m under continuous concrete paved areas; or (b) 0.5 m in other locations.	25(2)
3	Two-core cables		Tables 10 and 11 Columns 23 and 24 Table 12 Column 13			
4	Three-core cables		Tables 13 and 14 Columns 23 and 24 Table 15 Column 13			

NOTES:

- 1 Earthing conductors, lightly loaded neutral conductors of three-phase circuits and conductors subject only to momentary loading, such as control wiring, shall not be counted in the number of cable cores.
- 2 See column headings of Tables 4 to 15.
- 3 See Tables 27 and 28 for rating factors applicable to different ambient soil temperatures and depths of laying.

TABLE 3(4)

SCHEDULE OF INSTALLATION METHODS FOR CABLES DEEMED TO HAVE THE SAME CURRENT-CARRYING CAPACITY AND CROSS-REFERENCES TO APPLICABLE DERATING TABLES—UNDERGROUND WIRING ENCLOSURES





1 Item No.	2 Cable details (see Note 1)	3 Reference drawing (see Note 2)	4 Current-carrying capacity table reference	5 Methods of installation for cables deemed to have the same current-carrying capacity (see Note 3)	6 Derating table for more than one circuit	
					in same enclosure	in separate enclosures
1	Two single-core cables		Tables 4 and 5 Columns 24 to 26 Table 6 Columns 16 and 17	Cables in a single enclosure laid— (a) a minimum of 0.3 m below continuous concrete paved areas; or (b) minimum 0.5 m in other locations.	22	26(2)
2	Three single-core cables		Tables 7 and 8 Columns 24 to 26 Table 9 Columns 16 and 17			
3	One two-core cable		Tables 10 and 11 Columns 25 to 27 Table 12 Columns 14 and 15			
4	One three-core cable		Tables 13 and 14 Columns 25 to 27 Table 15 Column 14 and 15			
5	Single-core cables		Tables 4 and 5 Columns 27 and 28 Table 6 Column 18	Two enclosures laid— (a) directly under continuous concrete paved areas; or (b) minimum 0.5 m in other locations.	26(1)	
6			Tables 7 and 8 Columns 27 and 28 Table 9 Column 18	Three enclosures laid— (a) directly under continuous concrete paved areas; or (b) minimum 0.5 m in other locations.		

NOTES:

- 1 Earthing conductors, lightly loaded neutral conductors of three-phase circuits and conductors subject only to momentary loading, such as control wiring, shall not be counted in the number of cable cores.
- 2 See column headings of Tables 4 to 15.
- 3 See Tables 27 and 28 for rating factors applicable to different ambient soil temperatures and depths of laying.

TABLE 4
CURRENT-CARRYING CAPACITIES

CABLE TYPE: TWO SINGLE-CORE (See Note 1)
INSULATION TYPE: THERMOPLASTIC (See Note 2)
MAXIMUM CONDUCTOR TEMPERATURE: 75°C
REFERENCE AMBIENT TEMPERATURE: 40°C IN AIR, 25°C IN GROUND

1	2	3	4	5	6	7	8	9	10	11	12	13
Current-carrying capacity, A												
Unenclosed												
Conductor size	Spaced			Spaced from surface			Touching			Exposed to sun		
												
	Cu		Al	Cu		Al	Cu		Al	Cu		Al
mm ²	Solid/ Stranded	Flexible		Solid/ Stranded	Flexible		Solid/ Stranded	Flexible		Solid/ Stranded	Flexible	
1	16	17	—	16	17	—	13	13	—	8	8	—
1.5	21	21	—	21	21	—	16	17	—	10	10	—
2.5	30	29	—	29	28	—	23	22	—	13	13	—
4	40	38	—	39	38	—	31	30	—	18	17	—
6	51	49	—	49	48	—	40	38	—	22	21	—
10	69	69	—	67	67	—	54	54	—	30	29	—
16	92	91	72	89	88	69	72	71	56	39	38	30
25	124	121	96	119	115	92	97	94	75	50	49	39
35	153	150	119	145	143	113	119	117	92	61	59	47
50	187	189	145	177	179	137	146	147	113	72	73	56
70	238	238	184	223	224	173	184	185	143	89	89	69
95	295	287	229	276	269	214	230	223	178	107	104	83
120	344	341	267	321	317	249	267	265	208	122	120	95
150	395	393	307	367	365	285	308	306	239	137	135	106
185	459	450	357	424	416	331	358	351	279	154	150	120
240	549	541	427	505	498	394	428	422	334	177	173	138
300	636	624	495	582	571	456	495	486	388	198	192	155
400	744	752	583	676	682	535	577	583	456	221	218	175
500	867	876	685	780	787	624	668	675	535	245	240	196
630	1014	1036	808	897	914	730	770	785	627	269	266	219

(continued)

TABLE 4 (continued)

14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	
Current-carrying capacity, A															
Conductor size	Enclosed		Thermal insulation				Buried direct		Underground wiring enclosure						
	Wiring enclosure in air		Partially surrounded by thermal insulation		Completely surrounded by thermal insulation										
mm ²	Cu		Al	Cu	Al	Cu	Al	Cu	Al	Cu		Al	Cu	Al	
	Solid/Stranded	Flexible								Solid/Stranded	Flexible				
1	13	14	—	11	—	6	—	18	—	18	19	—	21	—	
1.5	18	18	—	14	—	8	—	23	—	23	23	—	26	—	
2.5	24	24	—	20	—	12	—	32	—	32	31	—	36	—	
4	32	31	—	25	—	16	—	41	—	41	40	—	47	—	
6	41	40	—	33	—	20	—	52	—	52	50	—	58	—	
10	54	54	—	44	—	27	—	69	—	69	68	—	77	—	
16	70	69	54	56	43	36	28	122	95	89	87	69	99	77	
25	94	91	73	75	58	48	37	158	123	116	112	90	129	100	
35	112	110	87	90	70	59	46	190	147	139	136	108	155	120	
50	138	139	107	110	86	—	—	225	174	168	168	130	186	145	
70	170	169	132	136	105	—	—	277	215	206	205	160	228	177	
95	212	206	164	169	131	—	—	332	257	252	244	195	278	215	
120	242	237	188	193	150	—	—	378	294	287	282	223	316	245	
150	282	278	219	225	175	—	—	424	329	329	324	255	354	274	
185	320	312	249	256	199	—	—	480	374	373	363	291	408	317	
240	381	373	298	305	238	—	—	556	434	438	429	342	472	368	
300	—	—	—	—	—	—	—	628	491	496	493	388	546	425	
400	—	—	—	—	—	—	—	713	564	575	572	454	621	487	
500	—	—	—	—	—	—	—	805	644	649	663	520	721	570	
630	—	—	—	—	—	—	—	904	737	750	754	611	816	652	





NOTES:

- 1 Applies to non-armoured, sheathed or unsheathed cables.
- 2 The normal operating temperature of thermoplastic cables, including flexible cords installed as installation wiring, are based on a conductor temperature of 75°C. This is due to the risk of thermal deformation of insulation if the cables are clipped, fixed or otherwise installed in a manner which exposes the cable to severe mechanical pressure at higher temperatures.
V-90 and V-90HT insulated cables may be operated up to the maximum permissible temperatures 90°C and 105°C provided that the cable is installed in a manner that is not subject to, or is protected against, severe mechanical pressure at temperatures higher than 75°C. Such applications also allow for cables to be used in—
 - (a) locations where the ambient temperature exceeds the normal 40°C, e.g. equipment wiring in luminaires and heating appliances, or in roof spaces affected by high summer temperatures; and
 - (b) locations affected by bulk thermal insulation that restricts the dissipation of heat from the cable.
- 3 Refer to Tables 3(1), 3(2), 3(3) and 3(4) for cable configurations deemed to have the same current-carrying capacities as those illustrated.
- 4 Derating factors may apply as follows:
 - (a) The current-carrying capacities apply to single circuits. For grouped cable circuits, see Clause 3.5.2 and Tables 22, 23, 25 and 26 for appropriate derating factors.

- (b) For a single circuit fixed to the underside of a ceiling or similar horizontal surface, see Table 22 for the derating factor to be applied to the current-carrying capacities given in Columns 8 to 10.
 - (c) For a single circuit fixed to perforated or unperforated cable tray, see Table 23 for the derating factor to be applied to the current-carrying capacities given in Columns 5 to 7.
 - (d) For ambient temperature and depth of laying factors, see Tables 27 and 28.
- 5 To calculate the single-phase voltage drop of these configurations, multiply the appropriate three-phase voltage drop value in Table 40, Table 43 or Table 46 by 1.155.
 - 6 These ratings are based on 40°C ambient air temperature and 25°C ambient soil temperature. For other conditions, see Clause 3.5.3.
 - 7 For conductor sizes up to 10mm² in Column 22 the values are based on ratings for wiring in underground wiring enclosures.
 - 8 Cables within the scope of AS/NZS 5000.2 (up to 16 mm²) may be rated to the values in the Tables covering 90°C insulated cables, subject to—
 - (a) information provided in Note 2; and
 - (b) any other relevant requirements of AS/NZS 3000.

TABLE 5
CURRENT-CARRYING CAPACITIES

CABLE TYPE: TWO SINGLE-CORE (See Note 1)
INSULATION TYPES: X-90, X-HF-90, R-EP-90, R-CPE-90, R-HF-90 OR R-CSP-90
MAXIMUM CONDUCTOR TEMPERATURE: 90°C (See Note 2)
REFERENCE AMBIENT TEMPERATURE: 40°C IN AIR, 25°C IN GROUND

1	2	3	4	5	6	7	8	9	10	11	12	13
Current-carrying capacity, A												
Unenclosed												
Conductor size	Spaced		Spaced from surface				Touching			Exposed to sun		
												
	Cu		Al	Cu		Al	Cu		Al	Cu		Al
mm ²	Solid/ Stranded	Flexible	Al	Solid/ Stranded	Flexible	Al	Solid/ Stranded	Flexible	Al	Solid/ Stranded	Flexible	Al
1	20	21	—	20	21	—	16	16	—	12	13	—
1.5	26	26	—	25	26	—	20	20	—	15	16	—
2.5	36	35	—	36	34	—	28	27	—	21	21	—
4	48	46	—	47	46	—	37	36	—	28	27	—
6	61	59	—	60	58	—	47	46	—	36	34	—
10	84	83	—	82	81	—	65	64	—	48	48	—
16	112	110	87	108	106	84	86	85	67	64	63	50
25	151	147	117	145	141	112	117	114	91	86	83	66
35	186	183	144	177	174	137	144	141	111	105	103	81
50	228	231	177	216	218	167	176	178	136	127	128	99
70	291	292	226	273	274	212	224	225	174	160	161	124
95	361	351	280	338	328	262	278	271	216	197	192	153
120	422	418	328	393	389	305	325	322	253	229	226	178
150	486	483	377	451	448	350	375	373	291	262	260	204
185	565	555	439	522	512	406	436	428	340	303	296	236
240	678	668	527	622	613	485	522	515	408	359	353	280
300	787	772	612	718	705	562	605	594	473	413	404	323
400	923	933	723	836	843	660	708	715	559	478	480	377
500	1078	1090	850	966	975	772	821	830	656	550	552	439
630	1261	1288	1003	1113	1135	904	950	969	772	629	639	511

(continued)

TABLE 5 (continued)

14	15	16	17	18	19	20	21	22	23	24	25	26	27	28
Current-carrying capacity, A														
Conductor size	Enclosed		Thermal insulation				Buried direct		Underground wiring enclosure					
	Wiring enclosure in air		Partially surrounded by thermal insulation		Completely surrounded by thermal insulation									
	Cu		Al	Cu	Al	Cu	Al	Cu	Al	Cu		Al	Cu	Al
mm ²	Solid/Stranded	Flexible								Solid/Stranded	Flexible			
1	16	17	—	13	—	8	—	20	—	20	21	—	24	—
1.5	21	21	—	16	—	10	—	26	—	26	26	—	30	—
2.5	30	28	—	24	—	14	—	36	—	36	35	—	41	—
4	38	37	—	30	—	19	—	46	—	46	45	—	53	—
6	47	46	—	38	—	24	—	58	—	58	56	—	66	—
10	65	64	—	52	—	32	—	78	—	78	77	—	87	—
16	84	82	65	67	52	43	33	139	107	100	98	78	112	87
25	113	109	87	90	70	58	45	179	139	131	127	102	146	114
35	135	132	105	108	84	72	56	215	167	157	154	122	175	136
50	166	167	129	133	103	—	—	255	198	189	190	147	211	164
70	204	204	159	164	127	—	—	313	243	233	232	181	258	200
95	255	248	198	204	158	—	—	375	291	285	276	221	309	239
120	292	286	226	233	181	—	—	427	332	325	319	252	358	278
150	329	336	255	263	204	—	—	480	372	365	368	283	401	311
185	387	377	301	309	241	—	—	543	423	423	412	329	463	359
240	461	452	360	369	288	—	—	630	492	497	486	388	536	417
300	—	—	—	—	—	—	—	711	556	562	548	440	620	482
400	—	—	—	—	—	—	—	808	638	653	650	516	706	553
500	—	—	—	—	—	—	—	913	729	739	733	590	800	632
630	—	—	—	—	—	—	—	1026	833	856	860	695	930	740





NOTES:

- 1 Applies to non-armoured, sheathed or unsheathed cables.
- 2 The normal operating temperature of thermoplastic cables, including flexible cords installed as installation wiring, is based on a conductor temperature of 75°C. This is due to the risk of thermal deformation of insulation if the cables are clipped, fixed or otherwise installed in a manner that exposes the cable to severe mechanical pressure at higher temperatures.
V-90 and V-90HT insulated cables may be operated up to the maximum permissible temperatures 90°C and 105°C provided that the cable is installed in a manner that is not subject to, or is protected against, severe mechanical pressure at temperatures higher than 75°C. Such applications also allow for cables to be used in—
(a) locations where the ambient temperatures exceed the normal 40°C, e.g. equipment wiring in luminaires and heating appliances, or in roof spaces affected by high summer temperatures; and
(b) locations affected by bulk thermal insulation that restricts the dissipation of heat from the cable.
- 3 For cables with a maximum conductor temperature of 105°C the applicable current ratings are those provided for copper conductors up to and including 10mm² size.
- 4 Refer to Tables 3(1), 3(2), 3(3) and 3(4) for cable configurations deemed to have the same current-carrying capacities as those illustrated.

- 5 Derating factors may apply as follows:
 - (a) The current-carrying capacities apply to single circuits. For grouped cable circuits, see Clause 3.5.2 and Tables 22, 23, 25 and 26 for appropriate derating factors.
 - (b) For a single circuit fixed to the underside of a ceiling or similar horizontal surface, see Table 22 for the derating factor to be applied to the current-carrying capacities given in Columns 8 to 10.
 - (c) For a single circuit fixed to perforated or unperforated cable tray, see Table 23 for the derating factor to be applied to the current-carrying capacities given in Columns 5 to 7.
 - (d) For ambient temperature and depth of laying factors, see Tables 27 and 28.
- 6 To calculate the single-phase voltage drop of these configurations, multiply the appropriate three-phase voltage drop value in Table 40 or Table 43 by 1.155.
- 7 These ratings are based on 40°C ambient air temperature and 25°C ambient soil temperature. For other conditions, see Clause 3.5.3.
- 8 For conductor sizes up to 10 mm² in Column 22, the values are based on ratings for wiring in underground wiring enclosures.







TABLE 6
CURRENT-CARRYING CAPACITIES

CABLE TYPE: TWO SINGLE-CORE (See Note 1)
INSULATION TYPES: R-HF-110, R-E-110 OR X-HF-110
MAXIMUM CONDUCTOR TEMPERATURE: 110°C
REFERENCE AMBIENT TEMPERATURE: 40°C IN AIR, 25°C IN GROUND

1	2	3	4	5	6	7	8	9
Current-carrying capacity, A								
Unenclosed								
Conductor size	Spaced		Spaced from surface		Touching		Exposed to sun	
								
	Cu		Cu		Cu		Cu	
mm ²	Solid/ Stranded	Flexible	Solid/ Stranded	Flexible	Solid/ Stranded	Flexible	Solid/ Stranded	Flexible
1	25	26	24	26	20	21	17	18
1.5	32	32	31	32	25	26	21	22
2.5	45	43	44	42	36	34	30	29
4	59	57	58	56	47	45	39	38
6	75	73	73	70	59	57	50	48
10	103	102	99	98	81	80	68	67
16	137	135	131	129	107	105	89	88
25	183	178	175	170	143	139	119	116
35	225	221	214	210	176	172	146	143
50	276	279	261	263	215	218	178	179
70	349	351	328	329	272	273	224	224
95	434	422	406	395	339	329	277	269
120	505	500	471	466	394	390	321	318
150	581	577	540	536	454	450	369	366
185	673	660	624	611	527	516	427	418
240	806	794	743	732	630	621	508	500
300	934	916	857	841	730	716	586	575
400	1094	1105	998	1006	853	860	682	687
500	1278	1290	1155	1164	990	999	789	794
630	1498	1529	1334	1359	1146	1168	909	925

(continued)

TABLE 6 (continued)

10	11	12	13	14	15	16	17	18	
Current-carrying capacity, A									
Conductor size	Enclosed		Thermal insulation		Buried direct	Underground wiring enclosure			
	Wiring enclosure in air		Partially surrounded by thermal insulation	Completely surrounded by thermal insulation					
									
	Cu		Cu	Cu	Cu	Cu		Cu	
mm ²	Solid/ Stranded	Flexible				Solid/ Stranded	Flexible		
1	20	21	16	10	23	23	24	26	
1.5	25	25	20	13	29	29	30	33	
2.5	35	33	28	18	40	40	39	46	
4	46	45	37	23	53	53	51	59	
6	58	56	46	30	66	66	64	74	
10	78	77	62	40	88	88	86	97	
16	104	102	83	53	154	115	112	127	
25	137	133	109	72	198	148	143	163	
35	165	167	132	88	238	177	176	195	
50	205	207	164	—	282	214	215	236	
70	255	263	204	—	346	262	266	288	
95	321	312	257	—	416	321	312	352	
120	369	364	296	—	473	366	359	400	
150	430	426	344	—	531	420	414	448	
185	493	481	394	—	601	477	464	517	
240	594	583	476	—	698	561	548	600	
300	—	—	—	—	789	648	631	694	
400	—	—	—	—	898	738	734	790	
500	—	—	—	—	1018	837	855	921	
630	—	—	—	—	1148	973	977	1045	

NOTES:

- 1 Applies to non-armoured, sheathed or unsheathed cables.
- 2 Refer to Tables 3(1), 3(2), 3(3) and 3(4) for cable configurations deemed to have the same current-carrying capacities as those illustrated.
- 3 Derating factors may apply as follows:
 - (a) The current-carrying capacities apply to single circuits. For grouped cable circuits, see Clause 3.5.2 and Tables 22, 23, 25 and 26 for appropriate derating factors.
 - (b) For a single circuit fixed to the underside of a ceiling or similar horizontal surface, see Table 22 for the derating factor to be applied to the current-carrying capacities given in Columns 6 and 7.
 - (c) For a single circuit fixed to perforated or unperforated cable tray, see Table 23 for the derating factor to be applied to the current-carrying capacities given in Columns 4 and 5.
 - (d) For ambient temperature and depth of laying factors, see Tables 27 and 28.
- 4 To determine the single-phase voltage drop of these configurations, refer to the appropriate value in Table 40, Table 41 or Table 46.
- 5 These ratings are based on 40°C ambient air temperature and 25°C ambient soil temperature. For other conditions, see Clause 3.5.3.
- 6 For conductor sizes up to 10 mm² in Column 15, the values are based on ratings for wiring in underground wiring enclosures.

TABLE 7
CURRENT-CARRYING CAPACITIES

CABLE TYPE: THREE SINGLE-CORE (See Note 1)
INSULATION TYPE: THERMOPLASTIC (See Note 2)
MAXIMUM CONDUCTOR TEMPERATURE: 75°C
REFERENCE AMBIENT TEMPERATURE: 40°C IN AIR, 25°C IN GROUND

1	2	3	4	5	6	7	8	9	10	11	12	13
Current-carrying capacity, A												
Unenclosed												
Conductor size	Spaced			Spaced from surface			Touching			Exposed to sun		
	Cu		Al	Cu		Al	Cu		Al	Cu		Al
mm ²	Solid/ Stranded	Flexible		Solid/ Stranded	Flexible		Solid/ Stranded	Flexible		Solid/ Stranded	Flexible	
1	16	16	—	14	14	—	13	13	—	8	8	—
1.5	20	21	—	17	18	—	16	17	—	10	10	—
2.5	29	27	—	25	24	—	23	22	—	13	13	—
4	38	37	—	33	32	—	31	30	—	18	17	—
6	49	47	—	42	41	—	40	38	—	22	21	—
10	67	66	—	58	57	—	54	54	—	30	29	—
16	89	88	69	77	75	59	72	71	56	39	38	30
25	120	117	93	103	100	80	97	94	75	50	49	39
35	148	145	115	127	125	98	119	117	92	61	59	47
50	181	183	141	156	157	121	146	147	113	72	73	56
70	230	231	179	197	198	153	184	185	143	89	89	69
95	287	279	222	246	239	191	230	223	178	107	104	83
120	335	331	260	287	284	223	267	264	208	122	120	95
150	385	383	298	330	328	256	308	305	239	137	135	106
185	447	438	347	383	376	299	357	350	278	154	149	120
240	535	528	417	457	451	358	426	420	334	176	172	138
300	620	609	483	529	519	415	492	484	387	197	191	155
400	726	734	570	615	621	488	573	578	455	219	216	175
500	846	855	669	710	717	571	661	668	532	242	237	196
630	990	1011	789	817	833	668	760	775	622	265	262	219

(continued)

TABLE 7 (continued)

14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	
Current-carrying capacity, A															
Conductor size	Enclosed		Thermal insulation				Buried direct		Underground wiring enclosure						
	Wiring enclosure in air		Partially surrounded by thermal insulation		Completely surrounded by thermal insulation										
mm ²	Cu		Al	Cu	Al	Cu	Al	Cu	Al	Cu		Al	Cu	Al	
	Solid/Stranded	Flexible								Solid/Stranded	Flexible				
1	12	13	—	10	—	6	—	16	—	16	16	—	19	—	
1.5	15	15	—	12	—	8	—	20	—	20	20	—	24	—	
2.5	21	20	—	17	—	12	—	27	—	27	26	—	33	—	
4	28	27	—	23	—	16	—	36	—	36	35	—	43	—	
6	35	34	—	28	—	20	—	45	—	45	43	—	53	—	
10	47	46	—	37	—	27	—	59	—	59	58	—	70	—	
16	62	61	48	50	39	36	28	104	81	78	76	60	90	70	
25	81	78	63	64	50	48	38	134	104	100	97	78	117	91	
35	100	98	78	80	62	59	46	160	124	122	119	94	140	108	
50	119	120	92	95	74	—	—	190	147	144	145	112	168	131	
70	152	152	118	122	94	—	—	233	181	180	180	140	205	159	
95	183	178	142	147	114	—	—	279	216	217	210	168	250	194	
120	217	213	169	173	135	—	—	317	247	252	247	196	283	220	
150	244	241	190	195	152	—	—	356	276	283	279	220	317	246	
185	284	277	222	227	177	—	—	402	313	325	316	253	365	284	
240	331	336	269	265	207	—	—	465	364	377	376	295	422	329	
300	388	379	305	311	244	—	—	524	412	434	423	341	488	380	
400	442	461	351	353	281	—	—	593	471	492	504	391	553	434	
500	523	520	421	418	337	—	—	668	537	571	566	459	641	507	
630	588	592	481	471	385	—	—	748	612	639	641	523	723	578	





NOTES:

- Applies to non-armoured, sheathed or unsheathed cables.
- The normal operating temperature of thermoplastic cables, including flexible cords installed as installation wiring, is based on a conductor temperature of 75°C. This is due to the risk of thermal deformation of insulation if the cables are clipped, fixed or otherwise installed in a manner that exposes the cable to severe mechanical pressure at higher temperatures.
V-90 and V-90HT insulated cables may be operated up to the maximum permissible temperatures 90°C and 105°C provided that the cable is installed in a manner that is not subject to, or is protected against, severe mechanical pressure at temperatures higher than 75°C. Such applications also allow for cables to be used in—
 - locations where the ambient temperatures exceed the normal 40°C, e.g. equipment wiring in luminaires and heating appliances, or in roof spaces affected by high summer temperatures; and
 - locations affected by bulk thermal insulation that restricts the dissipation of heat from the cable.
- Refer to Tables 3(1), 3(2), 3(3) and 3(4) for cable configurations deemed to have the same current-carrying capacities as those illustrated.
- Derating factors may apply as follows:
 - The current-carrying capacities apply to single circuits. For grouped cable circuits, see Clause 3.5.2 and Tables 22, 23, 25 and 26 for appropriate derating factors.

- (b) For a single circuit fixed to the underside of a ceiling or similar horizontal surface, see Table 22 for the derating factor to be applied to the current-carrying capacities given in Columns 8 to 10.
 - (c) For a single circuit fixed to perforated or unperforated cable tray, see Table 23 for the derating factor to be applied to the current-carrying capacities given in Columns 5 to 7.
 - (d) For ambient temperature and depth of laying factors, see Tables 27 and 28.
- 5 To determine the three-phase voltage drop of these configurations, refer to the appropriate value in Table 40, Table 41, Table 43, Table 44 or Table 46.
- A1 | 6 These ratings are based on 40°C ambient air temperature and 25°C ambient soil temperature. For other conditions, see Clause 3.5.3.
- 7 For conductor sizes up to 10mm² in Column 22, the values are based on ratings for wiring in underground wiring enclosures.
- 8 Cables within the scope of AS/NZS 5000.2 (up to 16 mm²) may be rated to the values in the Tables covering 90°C insulated cables, subject to—
- (a) information provided in Note 2; and
 - (b) any other relevant requirements of AS/NZS 3000.

TABLE 8
CURRENT-CARRYING CAPACITIES

CABLE TYPE: THREE SINGLE-CORE (See Note 1)
INSULATION TYPES: X-90, X-HF-90, R-EP-90, R-CPE-90, R-HF-90 OR R-CSP-90
MAXIMUM CONDUCTOR TEMPERATURE: 90°C AND 105°C (See Note 2)
REFERENCE AMBIENT TEMPERATURE: 40°C IN AIR, 25°C IN GROUND

1	2	3	4	5	6	7	8	9	10	11	12	13
Current-carrying capacity, A												
Unenclosed												
Conductor size	Spaced			Spaced from surface			Touching			Exposed to sun		
												
	Cu		Al	Cu		Al	Cu		Al	Cu		Al
mm ²	Solid/ Stranded	Flexible	Al	Solid/ Stranded	Flexible	Al	Solid/ Stranded	Flexible	Al	Solid/ Stranded	Flexible	Al
1	19	20	—	16	17	—	16	16	—	12	13	—
1.5	25	25	—	21	22	—	20	20	—	15	16	—
2.5	35	33	—	30	29	—	28	27	—	21	21	—
4	46	45	—	40	38	—	37	36	—	28	27	—
6	59	57	—	50	49	—	47	46	—	36	34	—
10	81	80	—	69	69	—	65	64	—	48	48	—
16	108	106	84	92	91	71	86	85	67	64	63	50
25	146	142	113	125	121	97	117	114	91	86	83	66
35	180	177	140	154	151	119	144	141	111	105	103	81
50	221	223	171	188	191	146	176	178	136	127	128	99
70	282	283	219	240	241	186	224	225	174	160	161	124
95	350	341	271	298	290	232	278	271	216	197	192	153
120	410	406	318	349	346	271	325	322	253	229	226	178
150	472	470	366	403	400	313	375	372	291	262	260	203
185	560	540	427	468	459	365	435	427	339	302	296	235
240	660	651	513	560	553	438	521	514	407	358	352	280
300	766	752	596	648	637	508	602	591	472	410	402	322
400	899	909	705	756	764	599	702	709	557	474	477	376
500	1051	1062	829	874	884	703	812	821	652	544	546	437
630	1230	1256	978	1010	1030	824	938	956	765	621	630	507

(continued)

TABLE 8 (continued)

14	15	16	17	18	19	20	21	22	23	24	25	26	27	28
Current-carrying capacity, A														
Conductor size	Enclosed		Thermal insulation				Buried direct		Underground wiring enclosure					
	Wiring enclosure in air		Partially surrounded by thermal insulation		Completely surrounded by thermal insulation									
	Cu		Al	Cu	Al	Cu	Al	Cu	Al	Cu		Al	Cu	Al
mm ²	Solid/Stranded	Flexible								Solid/Stranded	Flexible			
1	15	15	—	12	—	8	—	18	—	18	19	—	22	—
1.5	18	19	—	15	—	10	—	22	—	22	23	—	27	—
2.5	25	24	—	20	—	14	—	31	—	31	30	—	38	—
4	33	31	—	26	—	19	—	40	—	40	38	—	49	—
6	42	41	—	34	—	24	—	50	—	50	49	—	60	—
10	56	55	—	45	—	32	—	67	—	67	66	—	79	—
16	72	73	56	58	45	43	33	117	91	86	85	66	101	79
25	97	94	75	77	60	58	45	151	117	113	109	87	132	103
35	120	118	93	96	75	72	56	180	140	137	134	106	158	122
50	143	144	111	114	89	—	—	214	166	163	163	126	190	147
70	183	183	142	146	114	—	—	262	203	203	203	158	232	180
95	220	214	171	176	137	—	—	313	243	244	237	190	276	214
120	261	256	203	209	162	—	—	356	277	284	279	221	320	248
150	295	291	229	236	183	—	—	400	310	320	316	249	358	277
185	335	334	261	268	209	—	—	452	352	363	357	283	413	321
240	399	391	312	320	250	—	—	523	409	426	416	333	477	371
300	469	458	368	375	294	—	—	589	463	491	479	385	552	430
400	534	533	424	427	339	—	—	668	530	557	554	442	626	491
500	633	630	509	506	407	—	—	752	604	648	642	520	707	559
630	714	719	583	571	466	—	—	843	688	727	729	593	820	654

NOTES:

- 1 Applies to non-armoured, sheathed or unsheathed cables.
- 2 The normal operating temperature of thermoplastic cables, including flexible cords installed as installation wiring, is based on a conductor temperature of 75°C. This is due to the risk of thermal deformation of insulation if the cables are clipped, fixed or otherwise installed in a manner that exposes the cable to severe mechanical pressure at higher temperatures.
V-90 and V-90HT insulated cables may be operated up to the maximum permissible temperatures 90°C and 105°C provided that the cable is installed in a manner that is not subject to, or is protected against, severe mechanical pressure at temperatures higher than 75°C. Such applications also allow for cables to be used in—
(a) locations where the ambient temperatures exceed the normal 40°C, e.g. equipment wiring in luminaires and heating appliances, or in roof spaces affected by high summer temperatures; and
(b) locations affected by bulk thermal insulation that restricts the dissipation of heat from the cable.
- 3 For cables with a maximum conductor temperature of 105°C, the applicable current ratings are those provided for copper conductors up to and including 10mm² size.
- 4 Refer to Tables 3(1), 3(2), 3(3) and 3(4) for cable configurations deemed to have the same current-carrying capacities as those illustrated.

- 5 Derating factors may apply as follows:
 - (a) The current-carrying capacities apply to single circuits. For grouped cable circuits, see Clause 3.5.2 and Tables 22, 23, 25 and 26 for appropriate derating factors.
 - (b) For a single circuit fixed to the underside of a ceiling or similar horizontal surface, see Table 22 for the derating factor to be applied to the current-carrying capacities given in Columns 8 to 10.
 - (c) For a single circuit fixed to perforated or unperforated cable tray, see Table 23 for the derating factor to be applied to the current-carrying capacities given in Columns 5 to 7.
 - (d) For ambient temperature and depth of laying factors, see Tables 27 and 28.
- 6 To determine the three-phase voltage drop of these configurations, refer to the appropriate value in Table 40, Table 41, Table 43, Table 44 or Table 46.
- 7 These ratings are based on 40°C ambient air temperature and 25°C ambient soil temperature. For other conditions, see Clause 3.5.3.
- 8 For conductor sizes up to 10mm² in Column 21, the values are based on ratings for wiring in underground wiring enclosures.







TABLE 9
CURRENT-CARRYING CAPACITIES

CABLE TYPE: THREE SINGLE-CORE (See Note 1)
INSULATION TYPES: R-HF-110, R-E-110 OR X-HF-110
MAXIMUM CONDUCTOR TEMPERATURE: 110°C
REFERENCE AMBIENT TEMPERATURE: 40°C IN AIR, 25°C IN GROUND

1	2	3	4	5	6	7	8	9
Current-carrying capacity, A								
Conductor size	Unenclosed							
	Spaced	Spaced from surface		Touching		Exposed to sun		
	Cu	Cu		Cu		Cu		
mm ²	Solid/ Stranded	Flexible	Solid/ Stranded	Flexible	Solid/ Stranded	Flexible	Solid/ Stranded	Flexible
1	24	25	21	22	20	21	17	18
1.5	31	31	27	27	25	26	21	22
2.5	43	42	38	36	36	34	30	29
4	57	55	50	48	47	45	39	38
6	73	70	63	61	59	57	50	48
10	99	99	86	85	81	80	68	67
16	132	130	114	112	107	105	89	88
25	177	173	153	149	143	139	119	116
35	218	214	188	184	176	172	146	143
50	267	270	230	233	215	217	178	179
70	339	340	291	292	272	273	224	224
95	422	410	363	353	339	329	277	269
120	492	487	422	418	394	390	321	317
150	565	562	486	482	453	450	368	365
185	656	644	564	553	526	516	426	417
240	786	775	674	665	629	620	507	499
300	912	895	780	766	727	714	584	572
400	1069	1079	910	918	847	855	678	682
500	1248	1260	1053	1064	981	990	782	786
630	1462	1493	1217	1240	1132	1154	898	913

(continued)

TABLE 9 (continued)

10	11	12	13	14	15	16	17	18
Current-carrying capacity, A								
Conductor size	Enclosed		Thermal insulation		Buried direct	Underground wiring enclosure		
	Wiring enclosure in air		Partially surrounded by thermal insulation	Completely surrounded by thermal insulation				
								
mm ²	Cu		Cu	Cu	Cu	Cu		Cu
	Solid/ Stranded	Flexible				Solid/ Stranded	Flexible	
1	17	18	14	10	20	20	21	24
1.5	22	23	18	13	25	25	26	30
2.5	32	31	25	18	36	36	34	42
4	41	40	33	23	46	46	44	54
6	51	50	41	30	57	57	55	67
10	71	70	57	40	77	77	76	88
16	93	91	74	53	130	99	97	115
25	125	121	100	72	168	130	125	148
35	151	148	121	88	201	155	151	176
50	182	190	146	—	237	184	188	212
70	234	234	187	—	291	230	229	259
95	285	277	228	—	348	277	268	315
120	337	331	269	—	396	322	316	357
150	382	378	306	—	445	362	357	400
185	449	438	359	—	503	415	404	461
240	548	538	439	—	583	492	481	533
300	626	612	501	—	657	556	542	617
400	718	757	575	—	746	631	648	700
500	865	864	692	—	843	736	729	815
630	983	993	787	—	947	827	828	920

NOTES:

- 1 Applies to non-armoured, sheathed or unsheathed cables.
- 2 Refer to Tables 3(1), 3(2), 3(3) and 3(4) for cable configurations deemed to have the same current-carrying capacities as those illustrated.
- 3 Derating factors may apply as follows:
 - (a) The current-carrying capacities apply to single circuits. For grouped cable circuits, see Clause 3.5.2 and Tables 22, 23, 25 and 26 for appropriate derating factors.
 - (b) For a single circuit fixed to the underside of a ceiling or similar horizontal surface, see Table 22 for the derating factor to be applied to the current-carrying capacities given in Columns 6 and 7.
 - (c) For a single circuit fixed to perforated or unperforated cable tray, see Table 23 for the derating factor to be applied to the current-carrying capacities given in Columns 4 and 5.
 - (d) For ambient temperature and depth of laying factors, see Tables 27 and 28.
- 4 To determine the three-phase voltage drop of these configurations, refer to the appropriate value in Table 40, Table 41 or Table 46.
- 5 These ratings are based on 40°C ambient air temperature and 25°C ambient soil temperature. For other conditions, see Clause 3.5.3.
- 6 For conductor sizes up to 10mm² in Column 15 the values are based on ratings for wiring in underground wiring enclosures.

TABLE 10
CURRENT-CARRYING CAPACITIES

CABLE TYPE: TWO-CORE SHEATHED (See Note 1)
INSULATION TYPE: THERMOPLASTIC (See Note 2)
MAXIMUM CONDUCTOR TEMPERATURE: 75°C
REFERENCE AMBIENT TEMPERATURE: 40°C IN AIR, 25°C IN GROUND

1	2	3	4	5	6	7	8	9	10	11	12	13
Current-carrying capacity, A												
Conductor size	Unenclosed						Enclosed					
	Spaced			Touching			Exposed to sun			Wiring enclosure in air		
	Cu		Al	Cu		Al	Cu		Al	Cu		Al
mm²	Solid/ Stranded	Flexible	Solid/ Stranded	Flexible	Solid/ Stranded	Flexible	Solid/ Stranded	Flexible	Solid/ Stranded	Flexible	Solid/ Stranded	Flexible
1	15	16	—	14	15	—	11	12	—	13	13	—
1.5	19	20	—	18	18	—	14	14	—	16	17	—
2.5	27	26	—	26	25	—	20	19	—	23	23	—
4	37	35	—	34	33	—	27	26	—	30	29	—
6	46	45	—	44	42	—	34	32	—	39	38	—
10	64	63	—	60	59	—	46	45	—	52	51	—
16	85	83	66	80	78	62	60	59	47	68	68	52
25	113	110	88	107	104	83	79	77	62	90	87	70
35	139	137	108	131	128	101	97	94	75	112	109	87
50	170	171	132	159	161	124	116	117	90	133	134	103
70	215	215	167	201	202	156	145	145	112	170	169	132
95	265	257	205	248	241	192	175	170	136	204	198	158
120	307	304	239	288	285	224	202	199	157	241	236	187
150	351	348	272	328	326	255	227	225	177	271	267	210
185	403	395	314	377	370	294	258	252	201	313	305	244
240	477	470	373	446	439	349	300	294	235	364	368	285
300	547	537	429	511	502	401	339	331	266	424	415	333
400	631	636	500	589	593	467	384	384	305	482	500	383
500	716	728	575	668	678	536	429	431	345	561	564	451

(continued)

TABLE 10 (continued)

14	15	16	17	18	19	20	21	22	23	24	25	26	27
Current-carrying capacity, A													
Conductor size	Thermal insulation								Buried direct		Underground wiring enclosure		
	Partially surrounded by thermal insulation, unenclosed		Partially surrounded by thermal insulation, in a wiring enclosure		Completely surrounded by thermal insulation, unenclosed		Completely surrounded by thermal insulation, in a wiring enclosure						
mm ²	Cu	Al	Cu	Al	Cu	Al	Cu	Al	Cu	Al	Cu		Al
											Solid/ Stranded	Flexible	
1	11	—	10	—	7	—	6	—	17	—	17	18	—
1.5	14	—	13	—	9	—	8	—	21	—	21	22	—
2.5	20	—	19	—	13	—	12	—	30	—	30	29	—
4	27	—	24	—	17	—	15	—	39	—	39	38	—
6	35	—	31	—	22	—	20	—	50	—	50	48	—
10	48	—	42	—	30	—	26	—	66	—	66	65	—
16	64	49	54	42	40	31	34	26	114	88	86	85	66
25	85	66	72	56	53	41	45	35	147	114	112	108	87
35	105	81	90	70	65	51	56	43	178	138	136	133	106
50	127	99	107	83	—	—	—	—	211	163	162	163	126
70	161	125	136	105	—	—	—	—	259	201	202	202	157
95	198	154	163	127	—	—	—	—	311	241	243	236	189
120	230	179	192	150	—	—	—	—	355	276	282	277	220
150	263	204	217	168	—	—	—	—	398	309	317	313	246
185	302	235	250	195	—	—	—	—	449	350	363	353	283
240	357	279	291	228	—	—	—	—	520	406	421	419	329
300	409	321	340	266	—	—	—	—	586	460	483	472	379
400	471	373	386	306	—	—	—	—	663	526	548	560	434
500	534	429	449	360	—	—	—	—	741	595	628	629	504

NOTES:

- 1 Applies to cables with or without earth core, armoured or unarmoured, including neutral screened cables.
- 2 The normal operating temperature of thermoplastic cables, including flexible cords installed as installation wiring, is based on a conductor temperature of 75°C. This is due to the risk of thermal deformation of insulation if the cables are clipped, fixed or otherwise installed in a manner that exposes the cable to severe mechanical pressure at higher temperatures.

V-90 and V-90HT insulated cables may be operated up to the maximum permissible temperatures 90°C and 105°C provided that the cable is installed in a manner that is not subject to, or is protected against, severe mechanical pressure at temperatures higher than 75°C. Such applications also allow for cables to be used in—





- (a) locations where the ambient temperatures exceed the normal 40°C, e.g. equipment wiring in luminaires and heating appliances, or in roof spaces affected by high summer temperatures; and
 - (b) locations affected by bulk thermal insulation that restricts the dissipation of heat from the cable.
- 3 Refer to Tables 3(1), 3(2), 3(3) and 3(4) for cable configurations deemed to have the same current-carrying capacities as those illustrated.
 - 4 Derating factors may apply as follows:
 - (a) The current-carrying capacities apply to single circuits. For grouped cable circuits, see Clause 3.5.2 and Tables 22, 23, 25 and 26 for appropriate derating factors.

- (b) For a single circuit fixed to the underside of a ceiling or similar horizontal surface, see Table 23 for the derating factor to be applied to the current-carrying capacities given in Columns 5 to 7.
 - (c) For a single circuit fixed to unperforated cable tray, see Table 24 for the derating factor to be applied to the current-carrying capacities given in Columns 2 to 4.
 - (d) For ambient temperature and depth of laying factors, see Tables 27 and 28.
- 5 To calculate the single-phase voltage drop of these configurations, multiply the appropriate three-phase voltage drop value in Table 42, Table 45 or Table 48 by 1.155.
- 6 These ratings are based on 40°C ambient air temperature and 25°C ambient soil temperature. For other conditions, see Clause 3.5.3.
- 7 For conductor sizes up to 10mm² in Column 21, the values are based on ratings for wiring in underground wiring enclosures.
- 8 Cables within the scope of AS/NZS 5000 (up to 25 mm² and with a maximum permissible conductor operating temperature of not less than 90°C) may be rated to the values in the Table 11 covering 90°C insulated cables, subject to—
- (a) information provided in Note 2; and
 - (b) any other relevant requirements of AS/NZS 3000.

Refer to Paragraph C3 of AS/NZS 3000 for details on simplified protective device selection (MCBs) for overload protection.

TABLE 11
CURRENT-CARRYING CAPACITIES

CABLE TYPE: TWO-CORE SHEATHED (See Note 1)
INSULATION TYPES: X-90, X-HF-90, R-EP-90, R-CPE-90, R-HF-90 OR R-CSP-90
MAXIMUM CONDUCTOR TEMPERATURE: 90°C AND 105°C (See Note 2)
REFERENCE AMBIENT TEMPERATURE: 40°C IN AIR, 25°C IN GROUND

1	2	3	4	5	6	7	8	9	10	11	12	13
Current-carrying capacity, A												
Conductor size	Unenclosed						Enclosed					
	Spaced			Touching			Exposed to sun			Wiring enclosure in air		
												
mm ²	Cu		Al	Cu		Al	Cu		Al	Cu		Al
	Solid/ Stranded	Flexible		Solid/ Stranded	Flexible		Solid/ Stranded	Flexible		Solid/ Stranded	Flexible	
1	18	19	—	17	18	—	15	16	—	16	16	—
1.5	24	24	—	22	23	—	19	20	—	20	20	—
2.5	34	32	—	31	30	—	27	26	—	28	27	—
4	45	43	—	42	40	—	36	35	—	37	35	—
6	57	55	—	53	51	—	46	44	—	46	44	—
10	78	78	—	73	72	—	63	62	—	63	62	—
16	104	103	81	97	96	75	83	82	64	82	80	63
25	140	136	109	131	128	102	111	108	86	110	106	85
35	173	169	134	162	158	125	136	134	106	132	129	102
50	211	213	163	197	199	153	165	167	128	162	163	126
70	268	269	208	250	251	194	208	209	162	200	207	155
95	331	322	257	309	300	239	255	248	198	250	242	194
120	385	381	299	359	355	279	295	292	230	285	289	222
150	441	438	342	411	408	319	336	333	261	332	328	257
185	509	499	396	473	464	369	385	377	300	377	375	293
240	604	596	472	562	554	439	454	446	354	448	439	350
300	694	682	544	645	633	505	518	507	406	523	511	410
400	804	811	636	745	751	590	594	597	470	596	595	472
500	915	932	734	848	862	680	671	679	538	695	699	557

(continued)

TABLE 11 (continued)

14	15	16	17	18	19	20	21	22	23	24	25	26	27
Current-carrying capacity, A													
Conductor size	Thermal insulation								Buried direct		Underground wiring enclosure		
	Partially surrounded by thermal insulation, unenclosed		Partially surrounded by thermal insulation, in a wiring enclosure		Completely surrounded by thermal insulation, unenclosed		Completely surrounded by thermal insulation, in a wiring enclosure						
mm ²	Cu	Al	Cu	Al	Cu	Al	Cu	Al	Cu	Al	Cu		Al
											Solid/ Stranded	Flexible	
1	14	—	12	—	9	—	8	—	19	—	19	20	—
1.5	18	—	16	—	11	—	10	—	24	—	24	25	—
2.5	25	—	23	—	16	—	14	—	34	—	34	33	—
4	33	—	29	—	21	—	18	—	45	—	45	43	—
6	42	—	37	—	27	—	23	—	56	—	56	54	—
10	58	—	51	—	36	—	32	—	75	—	75	74	—
16	78	60	66	51	49	38	41	32	132	102	98	95	75
25	105	81	88	68	66	51	55	43	170	132	128	124	99
35	129	100	106	82	81	63	66	51	205	159	154	150	119
50	158	122	130	101	—	—	—	—	244	189	185	186	144
70	200	155	160	124	—	—	—	—	300	233	228	231	177
95	247	192	200	155	—	—	—	—	360	279	279	271	216
120	287	223	228	177	—	—	—	—	410	319	318	318	247
150	328	255	265	206	—	—	—	—	460	357	365	360	283
185	379	295	301	235	—	—	—	—	520	405	413	407	322
240	449	351	358	280	—	—	—	—	603	471	485	475	379
300	516	404	418	328	—	—	—	—	680	533	558	544	437
400	596	472	477	378	—	—	—	—	771	610	633	631	501
500	678	544	556	446	—	—	—	—	862	691	728	729	583

NOTES:




- Applies to cables with or without earth core, armoured or unarmoured, including neutral screened cables.
- The normal operating temperature of thermoplastic cables, including flexible cords installed as installation wiring, is based on a conductor temperature of 75°C. This is due to the risk of thermal deformation of insulation if the cables are clipped, fixed or otherwise installed in a manner that exposes the cable to severe mechanical pressure at higher temperatures.
V-90 and V-90HT insulated cables may be operated up to the maximum permissible temperatures 90°C and 105°C provided that the cable is installed in a manner that is not subject to, or is protected against, severe mechanical pressure at temperatures higher than 75°C. Such applications also allow for cables to be used in—
 - locations where the ambient temperatures exceed the normal 40°C, e.g. equipment wiring in luminaires and heating appliances, or in roof spaces affected by high summer temperatures; and
 - locations affected by bulk thermal insulation that restricts the dissipation of heat from the cable.
- For cables with a maximum conductor temperature of 105°C the applicable current ratings are those provided for copper conductors up to and including 10mm² size.
- Refer to Tables 3(1), 3(2), 3(3) and 3(4) for cable configurations deemed to have the same current-carrying capacities as those illustrated.

- 5 Derating factors may apply as follows:
- (a) The current-carrying capacities apply to single circuits. For grouped cable circuits, see Clause 3.5.2 and Tables 22, 24, 25 and 26 for appropriate derating factors.
 - (b) For a single circuit fixed to the underside of a ceiling or similar horizontal surface, see Table 22 for the derating factor to be applied to the current-carrying capacities given in Columns 5 to 7.
 - (c) For a single circuit fixed to unperforated cable tray, see Table 24 for the derating factor to be applied to the current-carrying capacities given in Columns 2 to 4.
 - (d) For ambient temperature and depth of laying factors, see Tables 27 and 28.
- 6 To calculate the single-phase voltage drop of these configurations, multiply the appropriate three-phase voltage drop value in Table 42, Table 45 or Table 48 by 1.155.
- 7 These ratings are based on 40°C ambient air temperature and 25°C ambient soil temperature. For other conditions, see Clause 3.5.3.
- 8 For conductor sizes up to 10mm² in Column 21, the values are based on ratings for wiring in underground wiring enclosures.
- 9 Cables within the scope of AS/NZS 5000 (up to 25 mm²) may be rated to the values in this Table covering 90°C insulated cables, subject to—
- (a) information provided in Note 2; and
 - (b) any other relevant requirements of AS/NZS 3000.

Refer to Paragraph C3 of AS/NZS 3000 for details on simplified protective device selection (MCBs) for overload protection.






TABLE 12
CURRENT-CARRYING CAPACITIES

CABLE TYPE: TWO-CORE SHEATHED (See Note 1)
INSULATION TYPES: R-HF-110, R-E-110 OR X-HF-110
MAXIMUM CONDUCTOR TEMPERATURE: 110°C
REFERENCE AMBIENT TEMPERATURE: 40°C IN AIR, 25°C IN GROUND

1	2	3	4	5	6	7
Current-carrying capacity, A						
Unenclosed						
Conductor size	Spaced		Touching		Exposed to sun	
						
	Cu		Cu		Cu	
mm²	Solid/ Stranded	Flexible	Solid/ Stranded	Flexible	Solid/ Stranded	Flexible
1	23	24	22	23	20	21
1.5	29	30	28	28	25	26
2.5	41	40	39	38	36	34
4	55	53	51	50	47	45
6	69	67	65	63	59	57
10	95	94	89	88	81	80
16	126	124	118	116	107	105
25	168	163	158	154	142	138
35	206	202	194	190	174	170
50	251	254	236	238	211	213
70	317	318	298	299	265	266
95	392	381	367	357	326	317
120	455	450	426	421	377	372
150	519	515	486	482	429	425
185	598	586	559	547	491	481
240	708	698	662	652	580	570
300	815	799	760	745	664	650
400	941	949	878	884	763	767
500	1074	1091	1000	1014	866	877

(continued)

TABLE 12 (continued)

Conductor size	8	9	10	11	12	13	14	15
	Current-carrying capacity, A							
	Enclosed		Thermal insulation		Buried direct	Underground wiring enclosure		
	Metallic wiring enclosure in air		Partially surrounded by thermal insulation	Completely surrounded by thermal insulation				
								
mm ²	Cu		Cu	Cu	Cu	Cu		
	Solid/Stranded	Flexible				Solid/Stranded	Flexible	
A1	1	19	20	15	11	22	22	23
	1.5	24	24	19	14	28	28	29
	2.5	33	32	27	19	39	39	37
	4	45	43	36	26	51	51	49
	6	56	54	45	33	64	64	62
	10	76	75	60	45	85	85	84
	16	102	100	81	59	145	111	109
	25	133	129	107	79	188	144	139
	35	166	163	133	97	226	175	171
	50	200	202	160	—	268	208	209
	70	256	257	205	—	330	260	259
	95	312	303	250	—	396	313	304
	120	368	362	294	—	452	363	357
	150	417	412	333	—	507	409	403
	185	486	474	389	—	573	468	456
	240	588	577	470	—	665	554	541
	300	670	656	536	—	751	626	611
	400	768	801	615	—	853	711	727
	500	905	913	724	—	957	819	820

NOTES:

- Applies to cables with or without earth core, armoured or non-armoured, including neutral screened cables.
- Refer to Tables 3(1), 3(2), 3(3) and 3(4) for cable configurations deemed to have the same current-carrying capacities as those illustrated.
- Derating factors may apply as follows:
 - The current-carrying capacities apply to single circuits. For grouped cable circuits, see Clause 3.5.2 and Tables 22, 24, 25 and 26 for approximate derating factors.
 - For a single circuit fixed to the underside of a ceiling or similar horizontal surface, see Table 22 for the derating factor to be applied to the current-carrying capacities given in Column 4 and 5.
 - For a single circuit fixed to unperforated cable tray, see Table 24 for the derating factor to be applied to the current-carrying capacities given in Columns 2 and 3.
 - For ambient temperature and depth of laying factors, see Tables 27 and 28.
- To calculate the single-phase voltage drop of these configurations, multiply the appropriate three-phase voltage drop value in Table 42 or Table 48 by 1.155.
- These ratings are based on 40°C ambient air temperature and 25°C ambient soil temperature. For other conditions, see Clause 3.5.3.
- For conductor sizes up to 10mm² in Column 13 the values are based on ratings for wiring in underground wiring enclosures.







TABLE 13
CURRENT-CARRYING CAPACITIES

CABLE TYPES: THREE-CORE AND FOUR-CORE (See Note 1)
INSULATION TYPE: THERMOPLASTIC (See Note 2)
MAXIMUM CONDUCTOR TEMPERATURE: 75°C
REFERENCE AMBIENT TEMPERATURE: 40°C IN AIR, 25°C IN GROUND

1	2	3	4	5	6	7	8	9	10	11	12	13
Current-carrying capacity, A												
Conductor size	Unenclosed									Enclosed		
	Spaced			Touching			Exposed to sun			Wiring enclosure in air		
mm ²	Cu		Al	Cu		Al	Cu		Al	Cu		Al
	Solid/ Stranded	Flexible		Solid/ Stranded	Flexible		Solid/ Stranded	Flexible		Solid/ Stranded	Flexible	
1	13	13	—	12	13	—	9	10	—	11	11	—
1.5	16	17	—	15	16	—	12	12	—	14	14	—
2.5	23	22	—	22	21	—	17	16	—	20	19	—
4	31	30	—	29	28	—	23	22	—	25	24	—
6	40	38	—	37	36	—	29	28	—	33	32	—
10	54	54	—	51	51	—	39	38	—	44	43	—
16	72	71	56	68	67	53	51	50	40	58	57	45
25	97	94	75	91	89	71	67	65	52	76	73	59
35	120	117	93	112	110	87	82	80	64	94	92	73
50	146	148	113	137	138	106	99	100	77	112	112	87
70	185	185	143	172	173	134	123	123	96	142	142	111
95	228	222	177	213	207	165	150	145	116	177	172	137
120	265	262	206	247	244	192	172	169	134	202	199	157
150	303	301	235	282	280	219	194	192	151	228	229	177
185	348	342	272	324	318	253	220	215	172	263	257	206
240	412	407	323	383	378	301	256	251	200	316	309	248
300	472	464	372	438	430	345	288	282	227	—	—	—
400	544	549	434	504	508	402	326	326	260	—	—	—
500	616	627	498	571	580	461	363	365	294	—	—	—

(continued)

TABLE 13 (continued)

14	15	16	17	18	19	20	21	22	23	24	25	26	27
Current-carrying capacity, A													
Conductor size	Thermal insulation								Buried direct		Underground wiring enclosure		
	Partially surrounded by thermal insulation, unenclosed		Partially surrounded by thermal insulation, in a wiring enclosure		Completely surrounded by thermal insulation, unenclosed		Completely surrounded by thermal insulation, in a wiring enclosure						
													
mm ²	Cu	Al	Cu	Al	Cu	Al	Cu	Al	Cu	Al	Cu		Al
											Solid/ Stranded	Flexible	
1	9	—	9	—	6	—	5	—	14	—	14	15	—
1.5	12	—	11	—	8	—	7	—	18	—	18	18	—
2.5	17	—	16	—	11	—	10	—	25	—	25	24	—
4	23	—	20	—	15	—	13	—	33	—	33	32	—
6	30	—	26	—	19	—	16	—	42	—	42	40	—
10	41	—	35	—	25	—	22	—	55	—	55	54	—
16	54	42	47	36	34	26	29	23	96	75	73	71	56
25	73	57	60	47	46	35	38	29	125	97	94	91	73
35	90	69	75	58	56	43	47	36	150	117	114	112	89
50	109	85	89	69	—	—	—	—	178	138	136	137	105
70	138	107	114	88	—	—	—	—	219	170	170	169	132
95	170	132	142	110	—	—	—	—	263	204	208	201	161
120	198	154	162	126	—	—	—	—	300	233	237	232	184
150	226	175	182	142	—	—	—	—	336	261	266	265	207
185	259	203	211	165	—	—	—	—	379	296	304	296	237
240	307	240	253	198	—	—	—	—	438	344	359	351	281
300	—	—	—	—	—	—	—	—	493	388	404	394	318
400	—	—	—	—	—	—	—	—	557	444	468	467	374
500	—	—	—	—	—	—	—	—	620	501	522	523	422

NOTES:

- Applies to cables with or without earth core, armoured or non-armoured, including neutral screened cables.
- The normal operating temperature of thermoplastic cables, including flexible cords installed as installation wiring, is based on a conductor temperature of 75°C. This is due to the risk of thermal deformation of insulation if the cables are clipped, fixed or otherwise installed in a manner that exposes the cable to severe mechanical pressure at higher temperatures.
V-90 and V-90HT insulated cables may be operated up to the maximum permissible temperatures 90°C and 105°C provided that the cable is installed in a manner that is not subject to, or is protected against, severe mechanical pressure at temperatures higher than 75°C. Such applications also allow for cables to be used in—
 - locations where the ambient temperatures exceed the normal 40°C, e.g. equipment wiring in luminaires and heating appliances, or in roof spaces affected by high summer temperatures; and
 - locations affected by bulk thermal insulation that restricts the dissipation of heat from the cable.
- Refer to Tables 3(1), 3(2), 3(3) and 3(4) for cable configurations deemed to have the same current-carrying capacities as those illustrated.
- Derating factors may apply as follows:
 - The current-carrying capacities apply to single circuits. For grouped cable circuits, see Clause 3.5.2 and Tables 22, 24, 25 and 26 for appropriate derating factors.

- (b) For a single circuit fixed to the underside of a ceiling or similar horizontal surface, see Table 22 for the derating factor to be applied to the current-carrying capacities given in Columns 5 to 7.
 - (c) For a single circuit fixed to unperforated cable tray, see Table 24 for the derating factor to be applied to the current-carrying capacities given in Columns 2 to 4.
 - (d) For ambient temperature and depth of laying factors, see Tables 27 and 28.
- 5 To determine the three-phase voltage drop of these configurations, refer to the appropriate value in Table 42, Table 45 or Table 48.
- 6 These ratings are based on 40°C ambient air temperature and 25°C ambient soil temperature. For other conditions, see Clause 3.5.3.
- 7 For conductor sizes up to 10mm² in Column 21, the values are based on ratings for wiring in underground wiring enclosures.
- 8 Cables within the scope of AS/NZS 5000 (up to 25 mm²) may be rated to the values in the Table 14 covering 90°C insulated cables, subject to—
- (a) information provided in Note 2; and
 - (b) any other relevant requirements of AS/NZS 3000.

Refer to Paragraph C3 of AS/NZS 3000 for details on simplified protective device selection (MCBs) for overload protection.

TABLE 14
CURRENT-CARRYING CAPACITIES

CABLE TYPES: THREE-CORE AND FOUR-CORE (See Note 1)
INSULATION TYPES: X-90, X-HF-90, R-EP-90, R-CPE-90, R-HF-90 OR R-CSP-90
MAXIMUM CONDUCTOR TEMPERATURE: 90°C AND 105°C (See Note 2)
REFERENCE AMBIENT TEMPERATURE: 40°C IN AIR, 25°C IN GROUND

1	2	3	4	5	6	7	8	9	10	11	12	13
Current-carrying capacity, A												
Conductor size	Unenclosed									Enclosed		
	Spaced			Touching			Exposed to sun			Wiring enclosure in air		
mm ²	Cu		Al	Cu		Al	Cu		Al	Cu		Al
	Solid/ Stranded	Flexible		Solid/ Stranded	Flexible		Solid/ Stranded	Flexible		Solid/ Stranded	Flexible	
1	16	16	—	14	15	—	13	13	—	13	14	—
1.5	20	20	—	19	19	—	16	17	—	16	17	—
2.5	28	27	—	26	26	—	23	22	—	24	23	—
4	38	36	—	35	34	—	30	29	—	30	29	—
6	48	46	—	45	43	—	39	37	—	38	37	—
10	66	66	—	62	61	—	53	52	—	53	52	—
16	88	87	68	83	81	64	70	69	54	68	67	53
25	119	116	93	111	108	86	94	92	73	91	89	71
35	147	144	114	137	135	106	115	113	89	114	111	88
50	180	182	140	168	170	130	140	142	109	136	136	105
70	229	230	178	213	214	165	177	177	137	173	173	134
95	283	275	220	263	256	204	217	211	168	209	202	162
120	330	327	256	306	303	238	251	248	195	246	242	192
150	377	375	293	350	348	272	285	283	222	277	274	216
185	436	428	340	404	396	315	327	320	255	322	314	251
240	517	511	405	479	472	375	385	379	302	386	379	303
300	594	584	467	549	539	432	439	430	345	—	—	—
400	685	692	546	632	638	504	502	504	400	—	—	—
500	779	794	629	718	730	579	566	573	457	—	—	—

(continued)

TABLE 14 (continued)

14	15	16	17	18	19	20	21	22	23	24	25	26	27
Current-carrying capacity, A													
Conductor size	Thermal insulation								Buried direct		Underground wiring enclosure		
	Partially surrounded by thermal insulation, unenclosed		Partially surrounded by thermal insulation, in a wiring enclosure		Completely surrounded by thermal insulation, unenclosed		Completely surrounded by thermal insulation, in a wiring enclosure						
mm ²	Cu	Al	Cu	Al	Cu	Al	Cu	Al	Cu	Al	Cu		Al
											Solid/ Stranded	Flexible	
1	12	—	10	—	7	—	6	—	16	—	16	17	—
1.5	15	—	13	—	9	—	8	—	20	—	20	21	—
2.5	21	—	19	—	13	—	12	—	29	—	29	28	—
4	28	—	24	—	18	—	15	—	37	—	37	36	—
6	36	—	30	—	22	—	19	—	46	—	46	45	—
10	49	—	42	—	31	—	26	—	63	—	63	62	—
16	66	51	55	42	41	32	34	26	110	85	81	79	63
25	89	69	73	57	56	43	46	36	143	111	107	103	83
35	110	85	91	71	69	53	57	44	172	133	130	127	101
50	134	104	108	84	—	—	—	—	204	159	155	155	120
70	170	132	138	107	—	—	—	—	251	195	193	193	150
95	210	163	167	129	—	—	—	—	302	234	233	226	181
120	245	190	197	153	—	—	—	—	344	267	270	266	210
150	280	218	222	172	—	—	—	—	385	299	304	300	236
185	323	252	257	201	—	—	—	—	435	340	348	339	272
240	383	300	309	242	—	—	—	—	504	395	411	402	322
300	—	—	—	—	—	—	—	—	567	446	463	452	365
400	—	—	—	—	—	—	—	—	640	510	524	537	417
500	—	—	—	—	—	—	—	—	714	577	601	602	485

NOTES:

- Applies to cables with or without earth core, armoured or non-armoured, including neutral screened cables.
- The normal operating temperature of thermoplastic cables, including flexible cords installed as installation wiring, is based on a conductor temperature of 75°C. This is due to the risk of thermal deformation of insulation if the cables are clipped, fixed or otherwise installed in a manner that exposes the cable to severe mechanical pressure at higher temperatures.
V-90 and V-90HT insulated cables may be operated up to the maximum permissible temperatures 90°C and 105°C provided that the cable is installed in a manner that is not subject to, or is protected against, severe mechanical pressure at temperatures higher than 75°C. Such applications also allow for cables to be used in—
 - locations where the ambient temperatures exceed the normal 40°C, e.g. equipment wiring in luminaires and heating appliances, or in roof spaces affected by high summer temperatures; and
 - locations affected by bulk thermal insulation that restricts the dissipation of heat from the cable.
- For cables with a maximum conductor temperature of 105°C the applicable current ratings are those provided for copper conductors up to and including 10mm² size.
- Refer to Tables 3(1), 3(2), 3(3) and 3(4) for cable configurations deemed to have the same current-carrying capacities as those illustrated.

- 5 Derating factors may apply as follows:
- (a) The current-carrying capacities apply to single circuits. For grouped cable circuits, see Clause 3.5.2 and Tables 22, 24, 25 and 26 for appropriate derating factors.
 - (b) For a single circuit fixed to the underside of a ceiling or similar horizontal surface, see Table 26 for the derating factor to be applied to the current-carrying capacities given in Columns 5 to 7.
 - (c) For a single circuit fixed to unperforated cable tray, see Table 24 for the derating factor to be applied to the current-carrying capacities given in Columns 2 to 4.
 - (d) For ambient temperature and depth of laying factors, see Tables 27 and 28.
- 6 To determine the three-phase voltage drop of these configurations, refer to the appropriate value in Table 42, Table 45 or Table 48.
- 7 These ratings are based on 40°C ambient air temperature and 25°C ambient soil temperature. For other conditions, see Clause 3.5.3.
- 8 For conductor sizes up to 10mm² in Column 21, the values are based on ratings for wiring in underground wiring enclosures
- 9 Cables within the scope of AS/NZS 5000 (up to 25 mm²) may be rated to the values in Table 11 covering 90°C insulated cables, subject to—
- (a) information provided in Note 2; and
 - (b) any other relevant requirements of AS/NZS 3000.

Refer to Paragraph C3 of AS/NZS 3000 for details on simplified protective device selection (MCBs) for overload protection.






TABLE 15
CURRENT-CARRYING CAPACITIES

CABLE TYPES: THREE-CORE AND FOUR-CORE SHEATHED (See Note 1)
INSULATION TYPES: R-HF-110, R-E-110 OR X-HF-110
MAXIMUM CONDUCTOR TEMPERATURE: 110°C
REFERENCE AMBIENT TEMPERATURE: 40°C IN AIR, 25°C IN GROUND

1	2	3	4	5	6	7
Current-carrying capacity, A						
Unenclosed						
Conductor size	Spaced		Touching		Exposed to sun	
	Cu		Cu		Cu	
mm²	Solid/ Stranded	Flexible	Solid/ Stranded	Flexible	Solid/ Stranded	Flexible
1	20	21	18	19	17	18
1.5	25	26	24	24	22	22
2.5	35	34	33	32	30	29
4	47	45	44	42	40	39
6	59	57	56	54	50	49
10	81	80	76	75	69	68
16	107	106	101	99	91	89
25	144	140	135	131	121	118
35	177	173	166	162	148	145
50	216	218	202	204	180	182
70	272	273	255	255	227	227
95	337	327	314	306	278	271
120	391	387	364	360	322	318
150	447	444	416	413	367	364
185	515	505	479	470	421	412
240	611	602	567	559	496	488
300	701	688	650	638	567	555
400	810	817	751	756	651	655
500	921	936	852	865	737	746

(continued)

TABLE 15 (continued)

Conductor size	8	9	10	11	12	13	14	15
	Current-carrying capacity, A							
	Enclosed		Thermal insulation		Buried direct	Underground wiring enclosure		
	Metallic wiring enclosure in air		Partially surrounded by thermal insulation	Completely surrounded by thermal insulation				
								
mm ²	Cu		Cu	Cu	Cu	Cu		
	Solid/Stranded	Flexible				Solid/Stranded	Flexible	
A1	1	16	17	13	9	19	19	20
	1.5	20	21	16	12	24	24	24
	2.5	29	27	23	17	33	33	31
	4	38	36	30	22	43	43	41
	6	47	46	38	28	53	53	51
	10	64	65	51	38	71	71	71
	16	86	84	68	50	122	93	91
	25	116	112	93	67	158	122	118
	35	140	137	112	83	190	146	143
	50	174	175	139	—	226	177	178
	70	217	217	173	—	277	217	217
	95	270	263	216	—	333	267	259
	120	311	306	249	—	379	304	298
	150	360	356	288	—	426	346	341
	185	411	402	329	—	481	391	381
	240	498	489	398	—	558	463	453
	300	—	—	—	—	629	522	509
	400	—	—	—	—	713	608	606
	500	—	—	—	—	797	680	680

NOTES:

- Applies to cables with or without earth core, armoured or non-armoured, including neutral screened cables.
- Refer to Tables 3(1), 3(2), 3(3) and 3(4) for cable configurations deemed to have the same current-carrying capacities as those illustrated.
- Derating factors may apply as follows:
 - The current-carrying capacities apply to single circuits. For grouped cable circuits, see Clause 3.5.2 and Tables 22, 24, 25 and 26 for appropriate derating factors.
 - For a single circuit fixed to the underside of a ceiling or similar horizontal surface, see Table 22 for the derating factor to be applied to the current-carrying capacities given in Columns 5 to 7.
 - For a single circuit fixed to unperforated cable tray, see Table 24 for the derating factor to be applied to the current-carrying capacities given in Columns 2 to 4.
 - For ambient temperature and depth of laying factors, see Tables 27 and 28.
- To determine the three-phase voltage drop of these configurations, refer to the appropriate value in Table 42 or Table 48.
- These ratings are based on 40°C ambient air temperature and 25°C ambient soil temperature. For other conditions, see Clause 3.5.3.
- For conductor sizes up to 10mm² in Column 13, the values are based on ratings for wiring in underground wiring enclosures.

TABLE 16
CURRENT-CARRYING CAPACITIES

CABLE TYPE: FLEXIBLE CORDS
INSULATION TYPES: THERMOPLASTIC OR CROSS-LINKED
MAXIMUM CONDUCTOR TEMPERATURE: 60°C
REFERENCE AMBIENT TEMPERATURE: 25°C IN AIR

Conductor size mm ²	Current-carrying capacity A
0.5	3 (See Note 2)
0.75	7.5
1.0	10
1.5	16
2.5	20
4.0	25

NOTES:

- 1 Where a flexible cord is wound on a drum, multiply current-carrying capacity by the appropriate factor, as follows:

Number of layers:	1	2	3	4
Derating factor:	0.76	0.58	0.47	0.40







- 2 Flexible cords having tinsel conductors with a nominal cross-sectional area of 0.5 mm² have a current-carrying capacity of 0.5 A.

- A1 | 3 The current-carrying capacity is based on a cable maximum conductor operating temperature of 60°C in order to limit the surface temperatures for the expected use of such cables. Where flexible cords are used as installation wiring, the current ratings are given in Tables 4 to 15 and 17. (Refer to Clause 3.3.2).

- 4 To determine the three-phase voltage drop, refer to the appropriate value in Table 46, Table 47 or Table 48. To determine the single-phase voltage drop, multiply the three-phase value by 1.155.

TABLE 18
CURRENT-CARRYING CAPACITIES

CABLE TYPE: BARE SINGLE-CORE MIMS CABLES WITH COPPER CONDUCTORS
SHEATH TEMPERATURE: 100°C







1	2	3	4	5	6	7
Conductor size mm ²	Current-carrying capacity, A					
	Vertical spaced—spaced from wall 	Flat horizontal—spaced from wall 	Flat vertical—clipped to wall 	Vertical spaced—spaced from wall 	Trefoil—spaced from wall 	Flat vertical—clipped to wall 
0.6/0.6 kV cables						
1	20	18	16	19	16	15
1.5	26	23	21	25	21	19
2.5	35	31	28	34	28	26
4	47	42	38	45	38	35
1/1 kV cables						
1.5	30	27	24	29	22	22
2.5	40	36	33	39	33	30
4	54	48	43	52	43	40
6	68	62	55	66	55	50
10	93	84	76	90	75	69
16	125	115	100	120	100	92
25	165	150	135	160	135	125
35	205	185	170	200	165	155
50	260	235	210	250	210	190
70	325	295	265	315	265	240
95	380	345	310	365	315	280
120	445	405	360	430	370	330
150	520	470	420	500	430	385
185	610	550	495	590	505	450
240	730	660	590	705	605	540
300	815	735	660	785	690	600
400	1010	915	820	975	855	745

NOTES:

- 1 The current-carrying capacities given in this Table are based on a maximum operating temperature of 100°C for the external surface of the bare copper sheath. The current-carrying capacities of served cables may be 1.1 times higher than these if they are served with a material that is suitable for a copper sheath temperature of 105°C. See Clause 3.2.2 and Table 1 for conditions, where higher cable operating temperatures may be permitted for bare sheathed cables.
- 2 To determine the three-phase voltage drop, refer to the appropriate value in Table 49. To determine the single-phase voltage drop, multiply the three-phase value by 1.155.
- 3 The current-carrying capacities apply to single circuits. For grouped cable circuits see—
 - (a) Clause 3.5.2 and Tables 22 to 26 for derating factors for served cables; and
 - (b) Clause 3.5.2.2(a) for the treatment of unserved cables.
- 4 For earth sheath return system, temperature rises could be higher. Refer to manufacturer.
- 5 These ratings are based on 40°C ambient air temperature. For other conditions, see Clause 3.5.3.

TABLE 19
CURRENT-CARRYING CAPACITIES

CABLE TYPE: BARE MULTICORE MIMS CABLES WITH COPPER CONDUCTORS
SHEATH TEMPERATURE: 100°C

1	2	3	4	5	6	7
Conductor size mm ²	Current-carrying capacity, A					
	Two core— spaced from wall 	Two core— clipped to wall 	Three and four core—spaced from wall 	Three and four core—clipped to wall 	Seven core— spaced from wall 	Seven core— clipped to wall 
0.6/0.6 kV cables						
1	18	16	15	14	11	10
1.5	23	21	20	18	15	14
2.5	32	29	27	26	20	19
4	43	40	—	—	—	—
1/1 kV cables						
1.5	27	25	22	21	16	15
2.5	36	33	30	28	22	20
4	48	44	40	38	30	28
6	61	57	51	48	—	—
10	85	78	71	67	—	—
16	115	105	96	90	—	—
25	150	140	125	120	—	—

NOTES:

- The current-carrying capacities given in this Table are based on a maximum operating temperature of 100°C for the external surface of the bare copper sheath. The current-carrying capacities of served cables may be 1.1 times higher than these if they are served with a material which is suitable for a copper sheath temperature of 105°C. See Clause 3.2.2 and Table 1 for conditions where higher cable operating temperatures may be permitted for bare sheathed cables.
- To determine the three-phase voltage drop, refer to the appropriate value in Table 49. To determine the single-phase voltage drop, multiply the three-phase value by 1.155.
- The current-carrying capacities apply to single circuits. For grouped cable circuits see—
 - Clause 3.5.2 and Tables 22 to 26 for derating factors for served cables; and
 - Clause 3.5.2.2(a) for the treatment of unserved cables.
- For earth sheath return system, temperature rises could be higher. Refer to manufacturer.
- These ratings are based on 40°C ambient air temperature. For other conditions, see Clause 3.5.3.




TABLE 20
CURRENT-CARRYING CAPACITIES

CABLE TYPES: AERIAL CABLES WITH COPPER CONDUCTORS

1	2	3	4	5	6	7	8	9	10
Conductor size (mm ²) or standing (No./mm)	Current-carrying capacity, A								
	Bare conductors			PVC insulated single-core			PVC insulated two-core twisted, single-core neutral screened and two-core or three-core parallel-webbed cable		
	Still air	1 m/s wind	2 m/s wind	Still air	1 m/s wind	2 m/s wind	Still air	1 m/s wind	2 m/s wind
7/1.00	37	74	87	—	—	—	—	—	—
6	38	76	89	35	70	79	30	50	59
7/1.25	49	97	115	—	—	—	—	—	—
10	53	105	123	48	96	109	40	68	80
16	71	139	164	65	127	145	52	90	107
7/1.75	76	148	174	—	—	—	—	—	—
7/2.00	89	174	205	—	—	—	—	—	—
25	96	186	220	88	167	191	68	120	142
35	117	226	267	107	203	232	82	145	171
7/2.75	133	257	303	—	—	—	—	—	—
50	142	272	321	130	242	276	97	173	205
19/1.75	142	272	322	—	—	—	—	—	—
19/2.00	168	321	379	—	—	—	—	—	—
70	179	341	403	164	303	347	119	217	257
7/3.50	181	345	407	—	—	—	—	—	—
7/3.75	197	376	444	—	—	—	—	—	—
95	216	410	484	198	360	413	—	—	—
37/1.75	216	410	485	—	—	—	—	—	—
19/2.75	251	474	560	—	—	—	—	—	—
120	255	481	568	234	423	485	—	—	—
19/3.00	280	528	625	—	—	—	—	—	—
150	290	547	646	267	477	546	—	—	—
185	336	628	742	311	543	622	—	—	—
37/2.50	339	634	750	—	—	—	—	—	—

(continued)

TABLE 20 (continued)

11	12	13	14	15	16	17	18	19	20
Conductor size (mm ²) or standing (No./mm)	Current-carrying capacity, A								
	PVC insulated three-core and four-core twisted and two-core, three-core or four-core neutral screened cable			XLPE insulated two-core twisted cable and ABC			XLPE insulated three-core and four-core twisted cable and ABC		
									
	Still air	1 m/s wind	2 m/s wind	Still air	1 m/s wind	2 m/s wind	Still air	1 m/s wind	2 m/s wind
7/1.00	—	—	—	—	—	—	—	—	—
6	26	48	56	36	56	66	32	54	62
7/1.25	—	—	—	—	—	—	—	—	—
10	36	65	76	48	77	90	44	73	84
16	47	85	100	64	101	119	58	96	111
7/1.75	—	—	—	—	—	—	—	—	—
7/2.00	—	—	—	—	—	—	—	—	—
25	63	113	133	84	135	158	77	127	148
35	76	136	160	—	—	—	—	—	—
7/2.75	—	—	—	—	—	—	—	—	—
50	92	163	192	—	—	—	—	—	—
19/1.75	—	—	—	—	—	—	—	—	—
19/2.00	—	—	—	—	—	—	—	—	—
70	115	204	242	—	—	—	—	—	—
7/3.50	—	—	—	—	—	—	—	—	—
7/3.75	—	—	—	—	—	—	—	—	—
95	—	—	—	—	—	—	—	—	—
37/1.75	—	—	—	—	—	—	—	—	—
19/2.75	—	—	—	—	—	—	—	—	—
120	—	—	—	—	—	—	—	—	—
19/3.00	—	—	—	—	—	—	—	—	—
150	—	—	—	—	—	—	—	—	—
185	—	—	—	—	—	—	—	—	—
37/2.50	—	—	—	—	—	—	—	—	—

NOTES:

- The current-carrying capacities are based on an ambient temperature of 40°C, a maximum conductor temperature of 75°C and exposure to direct sunlight having an intensity of 1000 W/m². In addition the values for bare conductors are based on black (weathered) conductors and the values for insulated conductors are based on the use of black PVC or XLPE.
- Under normal circumstances there will always be some air movement and a minimum rating for 1.0 m/s wind is recommended.
- To determine the three-phase voltage drop of these configurations, refer to the following Tables:
 - For twisted cables, see Table 40.
 - For parallel and webbed cables, see Table 41.
 - For bare and single insulated cables, see Table 50.
- These ratings are based on 40°C ambient air temperature. For other conditions, see Clause 3.5.3.




TABLE 21
CURRENT-CARRYING CAPACITIES

CABLE TYPES: AERIAL CABLES WITH ALUMINIUM CONDUCTORS

1	2	3	4	5	6	7	8	9	10
Conductor size (mm ²) or standing (No./mm)	Current-carrying capacity, A								
	Bare conductors			PVC insulated single-core			PVC insulated two-core twisted, single-core neutral screened and two-core or three-core parallel-webbed cable		
	Still air	1 m/s wind	2 m/s wind	Still air	1 m/s wind	2 m/s wind	Still air	1 m/s wind	2 m/s wind
16	56	109	128	49	97	111	41	71	84
25	76	146	173	67	128	146	53	91	108
35	92	177	209	82	156	178	63	111	132
7/2.50	93	180	213	—	—	—	—	—	—
7/2.75	105	202	239	—	—	—	—	—	—
50	111	214	252	99	186	213	75	134	158
7/3.00	117	225	266	—	—	—	—	—	—
70	141	268	317	126	233	267	92	167	158
7/3.75	156	297	350	—	—	—	—	—	—
95	172	327	386	155	282	323	110	203	243
7/4.50	196	370	438	—	—	—	—	—	—
120	200	378	447	180	326	374	—	—	—
7/4.75	209	395	467	—	—	—	—	—	—
150	228	429	507	206	367	420	—	—	—
19/3.25	244	459	542	—	—	—	—	—	—
185	264	493	583	239	419	479	—	—	—
19/3.50	269	503	595	—	—	—	—	—	—

(continued)

TABLE 21 (continued)

11	12	13	14	15	16	17	18	19	20
Conductor size (mm ²) or standing (No./mm)	Current-carrying capacity, A								
	PVC insulated three-core and four-core twisted and two-core, three-core or four-core neutral screened cable			XLPE insulated two-core twisted cable and ABC			XLPE insulated three-core and four-core twisted cable and ABC		
									
	Still air	1 m/s wind	2 m/s wind	Still air	1 m/s wind	2 m/s wind	Still air	1 m/s wind	2 m/s wind
16	36	66	77	49	78	91	44	74	86
25	48	87	101	64	103	121	59	97	113
35	59	105	123	78	125	147	72	118	137
7/2.50	—	—	—	—	—	—	—	—	—
7/2.75	—	—	—	—	—	—	—	—	—
50	71	126	148	94	151	178	88	142	165
7/3.00	—	—	—	—	—	—	—	—	—
70	89	157	185	116	189	223	110	177	207
7/3.75	—	—	—	—	—	—	—	—	—
95	108	191	229	141	231	274	136	216	257
7/4.50	—	—	—	—	—	—	—	—	—
120	—	—	—	—	—	—	157	249	300
7/4.75	—	—	—	—	—	—	—	—	—
150	—	—	—	—	—	—	179	282	343
19/3.25	—	—	—	—	—	—	—	—	—
185	—	—	—	—	—	—	—	—	—
19/3.50	—	—	—	—	—	—	—	—	—

NOTES:

- The current-carrying capacities are based on an ambient air temperature of 40°C, a maximum conductor temperature of 75°C for PVC or 80°C for XLPE, and exposure to direct sunlight having an intensity of 1000 W/m². In addition the values for bare conductors are based on black (weathered) conductors and the values for insulated conductors are based on the use of black PVC or XLPE.
- Under normal circumstances there will always be some air movement and a minimum rating for 1.0 m/s wind is recommended.
- To determine the three-phase voltage drop of these configurations, refer to the following Tables:
 - For twisted cables, see Table 43.
 - For parallel and webbed cables, see Table 44.
 - For bare and single insulated cables, see Table 51.
- These ratings are based on 40°C ambient air temperature. For other conditions, see Clause 3.5.3.

TABLE 22
DERATING FACTORS FOR BUNCHED CIRCUITS

CABLE TYPES: SINGLE-CORE AND MULTICORE
INSTALLATION CONDITIONS: IN AIR OR IN WIRING ENCLOSURES












1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18
Item No.	Arrangement of cables (see Notes 1 & 2)	Derating factors															
		Number of circuits															
		1	2	3	4	5	6	7	8	9	10	12	14	16	18	20 or more	
1	Bunched in air	1.00	0.87	0.75	0.72	0.70	0.67	—	—	—	—	—	—	—	—	—	—
2	Bunched on a surface or enclosed	1.00	0.80	0.70	0.65	0.60	0.57	0.54	0.52	0.50	0.48	0.45	0.43	0.41	0.39	0.38	
3	Single layer on wall or floor	Touching	1.00	0.85	0.79	0.75	0.73	0.72	0.72	0.71	0.70	0.70	0.70	0.70	0.70	0.70	
4		Spaced (see Notes 5 & 6)	1.00	0.94	0.90	0.90	0.90	0.90	0.90	0.90	0.90	0.90	0.90	0.90	0.90	0.90	
5	Single layer under ceiling	Touching	0.95	0.81	0.72	0.68	0.66	0.64	0.63	0.62	0.61	0.61	0.61	0.61	0.61	0.61	
6		Spaced (see Notes 5 & 6)	0.95	0.85	0.85	0.85	0.85	0.85	0.85	0.85	0.85	0.85	0.85	0.85	0.85	0.85	

NOTES:

- 1 Where the cable in the arrangements shown in Columns 2 and 3 consist of *n* loaded conductors, the conductors may be considered as—
 - (a) $\frac{n}{2}$ groups of two loaded conductors; or
 - (b) $\frac{n}{3}$ groups of three loaded conductors.
- 2 Earthing conductors, lightly loaded neutral conductors of three-phase circuits and conductors subject only to momentary loading, such as control wiring, are not taken into account when considering the number of circuits.
- 3 These factors are based on uniform groups of cables, equally loaded. In accordance with Clause 3.5.6 the factors for circuits subject to intermittent or varying loads may be higher.
- 4 These factors are applicable to numbers of circuits comprising the following:
 - (a) Groups of two, three or four single-core cables.
 - (b) Multicore cables.
 - (c) Cables passing more than once through the same group of cables or wiring enclosures and circuits connected in parallel in accordance with Clause 3.5.2.7.
- 5 ‘Spaced’ means a clearance of one cable diameter between cable surfaces of adjacent cables. Where the cables concerned are not of the same size, the spacing will be based on the largest cable diameter in the adjacent groups.
- 6 No derating factor is applicable for the minimum spacings specified in Clause 3.5.2.2 (c) and Figure 1.

TABLE 23
DERATING FACTORS FOR CIRCUITS

CABLE TYPE: SINGLE-CORE
INSTALLATION CONDITIONS: IN TRAYS, RACKS, CLEATS OR OTHER SUPPORTS IN AIR

1	2	3	4	5	6	7	8
Item No.	Installation		Number of tiers or rows of cable supports	Arrangements of cables in a circuit (see Note 2)	Derating factors		
					Number of circuits per tier or row		
					1	2	3
1	Unperforated trays		1	2 or 3 cables in horizontal formation	0.95	0.85	0.84
2			2		0.92	0.83	0.79
3		(See Note 6)	3		0.91	0.82	0.76
4	Perforated trays		1	2 or 3 cables in horizontal formation	0.97	0.89	0.87
5			2		0.94	0.85	0.81
6		(See Note 6)	3		0.93	0.84	0.79
7	Ladder supports, racks and cleats		1	2 or 3 cables in horizontal formation	1.00	0.95	0.94
8			2		0.95	0.90	0.88
9		(See Note 6)	3		0.95	0.89	0.85
10	Vertical perforated trays		1	2 or 3 cables in vertical formation	0.94	0.85	—
11			(See Note 7)		2	0.92	0.83
12	Unperforated trays		1	2 or 3 cables in horizontal formation	0.98	0.96	0.94
13			2		0.95	0.91	0.87
14			(See Note 6)		3	0.94	0.90
15	Perforated trays		1	2 or 3 cables in horizontal formation	1.00	0.98	0.96
16			2		0.97	0.93	0.89
17			(See Note 6)		3	0.96	0.92
18	Ladder supports		1	2 or 3 cables in horizontal formation	1.00	1.00	1.00
19			2		0.97	0.95	0.93
20			(See Note 6)		3	0.97	0.94
21	Vertical perforated trays		1	2 or 3 cables in vertical formation	1.00	0.91	0.89
22			(See Note 7)		2	1.00	0.90









NOTES:

- 1 D equals the cable outside diameter.
- 2 Earthing conductors, lightly loaded neutral conductors of three-phase circuits and conductors subject only to momentary loading, such as control wiring, shall not be taken into account when considering the number of circuits.

- 3 These derating factors are to be applied to groups of two, three or four single-core cables for which the current-carrying capacity for a single circuit is obtained from Columns 5 to 7 of Tables 4, 5, 7 and 8, Columns 4 and 5 of Tables 6 and 9 and Tables 16 to 19. The factors are also applicable to groups of single-core cables making up parallel circuits in accordance with Clause 3.5.2.7.
- 4 These factors are based on uniform groups of cables, equally loaded. In accordance with Clause 3.5.6, the factors for circuits subject to intermittent or varying loads may be higher.
- 5 These factors are applicable to single layers of cables or trefoil groups, as shown in Column 2. Where there is more than one layer on the same tray or ladder support, Table 22 may be used.
- 6 The vertical spacing of horizontal trays and ladder supports shall be not less than 300 mm (see also Figure 1).
- 7 The horizontal spacing of vertical trays mounted back-to-back shall be not less than 230 mm.
- 8 No derating factor is applicable for the minimum spacings specified in Clause 3.5.2.2 (c) and Figure 1(a).

TABLE 24
DERATING FACTORS FOR CIRCUITS

CABLE TYPE: MULTICORE
INSTALLATION CONDITIONS: IN TRAYS, RACKS, CLEATS OR OTHER SUPPORTS IN AIR

1	2	3	4	5	6	7	8	9	10
Item No.	Installation		Number of tiers or rows of cable supports	Derating factors					
				Number of cables					
				1	2	3	4	6	9
1	Unperforated trays	 Touching (see Note 6)	1	0.97	0.85	0.78	0.75	0.71	0.68
2			0.97	0.84	0.76	0.73	0.68	0.63	
3			0.97	0.83	0.75	0.72	0.66	0.61	
4		 Spaced (see Note 6)	1	0.97	0.96	0.94	0.93	0.90	—
5			0.97	0.95	0.92	0.90	0.86	—	
6			0.97	0.94	0.91	0.89	0.84	—	
7	Perforated trays	 Touching (see Note 6)	1	1.00	0.88	0.82	0.78	0.76	0.73
8			1.00	0.87	0.80	0.76	0.73	0.68	
9			1.00	0.86	0.79	0.75	0.71	0.66	
10		 Spaced (see Note 6)	1	1.00	1.00	0.98	0.95	0.91	—
11			1.00	0.99	0.96	0.92	0.87	—	
12			1.00	0.98	0.95	0.91	0.85	—	
13	Ladder supports, racks and cleats	 Touching (see Note 6)	1	1.00	0.87	0.82	0.80	0.79	0.78
14			1.00	0.86	0.80	0.78	0.76	0.73	
15			1.00	0.85	0.79	0.76	0.73	0.70	
16		 Spaced (see Note 6)	1	1.00	1.00	1.00	1.00	1.00	—
17			1.00	0.99	0.98	0.97	0.96	—	
18			1.00	0.98	0.97	0.96	0.93	—	
19	Vertical perforated trays	 Touching (see Note 7)	1	1.00	0.88	0.82	0.77	0.73	0.72
20			2	1.00	0.88	0.81	0.76	0.72	0.70
21		 Spaced (see Note 7)	1	1.00	0.91	0.89	0.88	0.87	—
22			2	1.00	0.91	0.88	0.87	0.86	—

NOTES:

- 1 D equals the cable outside diameter or in the case of a flat multicore cable the maximum dimension of the cable.
- 2 Earthing conductors, lightly loaded neutral conductors of three-phase circuits and conductors subject only to momentary loading, such as control wiring, shall not be taken into account when considering the number of circuits.
- 3 These derating factors are to be applied to groups of multicore cables for which the current-carrying capacity for a single circuit is obtained from Columns 2 to 4 of Tables 10, 11, 13 and 14, Columns 2 and 3 of Tables 12 and 15 and Tables 16 to 19. The factors are also applicable to groups of multicore cables making up parallel circuits in accordance with Clause 3.5.2.7.
- 4 These factors are applicable to uniform groups of cables, equally loaded. In accordance with Clause 3.5.6 the factors for circuits subject to intermittent or varying loads may be higher.
- 5 These factors are applicable to single layers of cables as shown in Column 2. Where there is more than one layer on the same tray or ladder support, Table 22 may be used.
- 6 The vertical spacing of horizontal trays and ladder supports shall be not less than 300 mm.
- 7 The horizontal spacing of vertical trays mounted back-to-back shall be not less than 230 mm.
- 8 No derating factor is applicable for the minimum spacings specified in Clause 3.5.2.2 (c) and Figure 1(b).

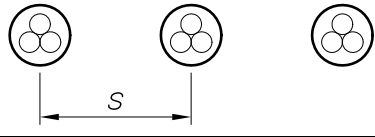
TABLE 25(1)
DERATING FACTORS FOR GROUPS OF CIRCUITS

CABLE TYPE: SINGLE-CORE
INSTALLATION CONDITIONS: BURIED DIRECT IN GROUND

1	2	3	4	5	6	7
Number of circuits						
	Derating factors					
	Touching		Distance (S), m			
	Trefoil	Laid flat	0.15	0.30	0.45	0.60
2	0.78	0.81	0.83	0.88	0.91	0.93
3	0.66	0.70	0.73	0.79	0.84	0.87
4	0.61	0.64	0.68	0.74	0.81	0.85
5	0.56	0.60	0.64	0.73	0.79	0.83
6	0.53	0.57	0.61	0.71	0.78	0.82
7	0.50	0.54	0.59	0.69	0.76	0.82
8	0.49	0.53	0.57	0.68	0.76	0.81
9	0.47	0.51	0.56	0.67	0.75	0.81
10	0.46	0.50	0.55	0.67	0.75	0.80
11	0.44	0.49	0.54	0.66	0.74	0.80
12	0.43	0.48	0.53	0.66	0.74	0.80

TABLE 25(2)
DERATING FACTORS FOR GROUPS OF CIRCUITS

CABLE TYPE: MULTICORE
INSTALLATION CONDITIONS: BURIED DIRECT IN GROUND

1	2	3	4	5	6
Number of cables in group					
	Derating factors				
	Touching	Distance (S), m			
		0.15	0.30	0.45	0.60
2	0.81	0.87	0.91	0.93	0.95
3	0.70	0.78	0.84	0.88	0.90
4	0.63	0.74	0.81	0.86	0.89
5	0.59	0.70	0.78	0.84	0.87
6	0.55	0.68	0.77	0.83	0.87
7	0.52	0.66	0.75	0.82	0.86
8	0.50	0.64	0.75	0.81	0.86
9	0.48	0.63	0.74	0.81	0.85
10	0.47	0.62	0.73	0.80	0.85
11	0.45	0.61	0.73	0.80	0.85
12	0.44	0.60	0.72	0.80	0.84

NOTES:

- 1 For derating factors applicable to other arrangements of single-core and multicore cables laid direct in the ground, refer to ERA Report 69-30 or alternative specifications.
- 2 The derating factors have been determined from the hottest cable in the group and assume that all cables are of the same thermal grade of insulation.

TABLE 26(1)
DERATING FACTORS FOR GROUPS OF CIRCUITS

CABLE TYPE: SINGLE-CORE
INSTALLATION CONDITIONS: IN UNDERGROUND WIRING ENCLOSURES—ENCLOSED SEPARATELY

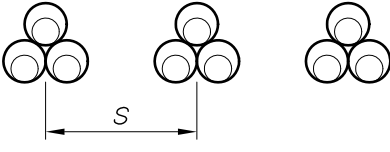
1	2	3	4
Number of circuits			
	Derating factor		
	Touching	Distance (S), m	
		0.45	0.60
2	0.87	0.91	0.93
3	0.78	0.84	0.87
4	0.74	0.81	0.85
5	0.70	0.79	0.83
6	0.69	0.78	0.82
7	0.67	0.76	0.82
8	0.66	0.76	0.81
9	0.65	0.75	0.81
10	0.64	0.75	0.80
11	0.63	0.74	0.80
12	0.63	0.74	0.80

TABLE 26(2)
DERATING FACTORS FOR GROUPS OF CIRCUITS

CABLE TYPES: SINGLE-CORE OR MULTICORE
INSTALLATION CONDITIONS: IN UNDERGROUND WIRING ENCLOSURES—MULTICORE CABLES ENCLOSED SEPARATELY OR MORE THAN ONE SINGLE-CORE CABLE PER WIRING ENCLOSURE

Number of circuits	1	2	3	4	5	
		Derating factor				
		Touching	Distance (S), m			
		0.30	0.45	0.60		
2	0.90	0.93	0.95	0.96		
3	0.83	0.88	0.91	0.93		
4	0.79	0.85	0.89	0.92		
5	0.75	0.83	0.88	0.91		
6	0.73	0.82	0.87	0.90		
7	0.71	0.81	0.86	0.89		
8	0.70	0.80	0.85	0.89		
9	0.68	0.79	0.85	0.89		
10	0.67	0.79	0.85	0.89		
11	0.66	0.78	0.84	0.88		
12	0.66	0.78	0.84	0.88		

NOTE: For derating factors applicable to other arrangements of cables in underground wiring enclosures, refer to ERA Report 69-30 or alternative specifications.

TABLE 27(1)
RATING FACTORS

VARIANCE: AIR AND CONCRETE SLAB AMBIENT TEMPERATURES
INSTALLATION CONDITIONS: CABLES IN AIR OR HEATED CONCRETE SLABS

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22
Conductor temperature °C	Rating factor																				
	Air and concrete slab ambient temperature (See Notes 1, 2 & 3), °C																				
	15	20	25	30	35	40	45	50	55	60	65	70	75	80	85	90	100	110	120	130	140
150	1.11	1.09	1.07	1.04	1.02	1.0	0.98	0.95	0.93	0.90	0.88	0.85	0.83	0.80	0.77	0.74	0.69	0.60	0.52	0.43	0.30
110	1.16	1.13	1.10	1.07	1.04	1.0	0.96	0.93	0.89	0.85	0.80	0.76	0.71	0.65	0.60	0.53	0.38	—	—	—	—
90	1.26	1.20	1.15	1.10	1.05	1.0	0.94	0.88	0.81	0.73	0.65	0.57	0.47	0.34	0.19	—	—	—	—	—	—
80	1.31	1.25	1.19	1.12	1.06	1.0	0.92	0.84	0.76	0.66	0.56	0.45	0.27	—	—	—	—	—	—	—	—
75	1.35	1.28	1.21	1.14	1.07	1.0	0.91	0.82	0.72	0.60	0.49	0.37	—	—	—	—	—	—	—	—	—

NOTES:

- 1 For heated concrete slabs, the ambient temperature shall be taken as the operating temperature of the slab.
- 2 The normal usage of high temperature insulation cables is in ambient air temperatures greater than 40°C, see Table 17.
- 3 For cables with a maximum permissible operating temperature above the normal use temperatures specified in Table 3, derating may not be necessary (see Notes to Table 1 for further details)

TABLE 27(2)
RATING FACTORS

VARIANCE: SOIL AMBIENT TEMPERATURE
INSTALLATION CONDITIONS: CABLES BURIED DIRECT IN GROUND OR IN UNDERGROUND WIRING ENCLOSURES

1	2	3	4	5	6	7	8
Conductor temperature °C	Rating factor						
	Soil ambient temperature, °C						
	10	15	20	25	30	35	40
110	1.08	1.06	1.03	1.0	0.97	0.94	0.91
90	1.11	1.07	1.03	1.0	0.97	0.93	0.89
80	1.13	1.09	1.04	1.0	0.96	0.91	0.85
75	1.14	1.10	1.05	1.0	0.95	0.89	0.83

TABLE 28(1)
RATING FACTORS

CABLE TYPES: SINGLE-CORE OR MULTICORE
VARIANCE: DEPTH OF LAYING
INSTALLATION CONDITIONS: BURIED DIRECT IN GROUND

1	2	3	4
Depth of laying m	Rating factor		
	Conductor size, mm ²		
	Up to 50	Above 50 up to 300	Above 300
0.5	1.00	1.00	1.00
0.6	0.99	0.98	0.97
0.8	0.97	0.96	0.94
1.0	0.95	0.94	0.92
1.25	0.94	0.92	0.90
1.5	0.93	0.91	0.89
1.75	0.92	0.89	0.87
2.0	0.91	0.88	0.86
2.5	0.90	0.87	0.85
3.0 or more	0.89	0.86	0.83

NOTE: The ambient temperature at the surface is to be taken at 40°C and not 25°C as at a depth of 0.5 m.

TABLE 28(2)
RATING FACTORS

CABLE TYPES: SINGLE-CORE OR MULTICORE
VARIANCE: DEPTH OF LAYING
INSTALLATION CONDITIONS: IN UNDERGROUND WIRING ENCLOSURES

1	2	3
Depth of laying m	Rating factor	
	Single-core*	Multicore
0.5	1.00	1.00
0.6	0.98	0.99
0.8	0.95	0.97
1.0	0.93	0.96
1.25	0.90	0.95
1.5	0.89	0.94
1.75	0.88	0.94
2.0	0.87	0.93
2.5	0.86	0.93
3.0 or more	0.85	0.92

* These rating factors apply to single-core cables enclosed separately, or grouped in a single wiring enclosure.

NOTE: The ambient temperature at the surface is to be taken as 40°C and not 25°C as at a depth of 0.5 m. For depth less than 0.5 m, see Table 3(4).

TABLE 29
RATING FACTORS

VARIANCE: THERMAL RESISTIVITY OF THE SOIL (FROM 1.2°C.m/W)
INSTALLATION CONDITIONS: BURIED DIRECT IN GROUND AND IN UNDERGROUND WIRING ENCLOSURES

1	2	3	4	5	6
Thermal resistivity of soil °C.m/W	Rating factor				
	Multicore cable buried direct	Two or three single-core cables buried direct	Multicore cable in a wiring enclosure	Two single-core cables in a wiring enclosure*	Three single-core cables in a wiring enclosure*
0.8	1.09	1.16	1.03	1.06	1.08
0.9	1.07	1.11	1.02	1.04	1.06
1.0	1.04	1.07	1.02	1.03	1.04
1.2	1.00	1.00	1.00	1.00	1.00
1.5	0.92	0.90	0.95	0.94	0.92
2.0	0.81	0.80	0.88	0.86	0.83
2.5	0.74	0.72	0.83	0.80	0.77
3.0	0.69	0.66	0.78	0.75	0.71

* These rating factors apply to single-core cables enclosed separately, or grouped in a single wiring enclosure.

NOTE: See Clause 3.5.5 for additional information on thermal resistivity of soil.

SECTION 4 VOLTAGE DROP

4.1 GENERAL

The provisions of this Section apply to the selection of conductor sizes with regard to voltage drop.

NOTE: AS/NZS 3000 imposes limitations on circuit arrangements in order to restrict excessive voltage drop between supply and load.

Clauses 4.2 and 4.3 describe a simplified method of determining the voltage drop for use with Tables 40 to 50 for applications where only the route length and load current of balanced circuits are known.

Clauses 4.4 and 4.5 describe a more accurate method of determining the voltage drop for use with Tables 30 to 39 where the cable size is known or anticipated.

Clause 4.6 describes a method for determining the voltage drop where unbalanced load current conditions occur.

4.2 DETERMINATION OF VOLTAGE DROP FROM MILLIVOLTS PER AMPERE METRE

The voltage drop (mV/A.m) values given in Tables 40 to 50 are for various cable types and configurations and maximum operating temperatures.

In applying these voltage drop values, the smallest permissible conductor is the smallest that satisfies the following equations:

$$V_c = \frac{1000V_d}{L \times I} \quad \dots 4.2(1)$$

$$V_d = \frac{L \times I \times V_c}{1000} \quad \dots 4.2(2)$$

$$V_p \geq \text{sum of } V_d \text{ on circuit run}$$

where

V_c = the millivolt drop per ampere-metre route length of circuit, as shown in the tables for various conductors, in millivolts per ampere metre (mV/A.m)

NOTES:

- 1 To convert single-phase voltage drop (mV/A.m) values to three-phase values, multiply the single-phase values by $0.866 \left(\frac{\sqrt{3}}{2} \right)$. To convert three-phase values to single-phase

values, multiply the three-phase values by $1.155 \left(\frac{2}{\sqrt{3}} \right)$.

- 2 Paragraph C4 and C7 of AS/NZS 3000:2007 details a simplified method of calculating the voltage drop for PVC cables up to 95 mm², operating at 75°C with maximum values of V_c . The method allows the addition of single phase and three phase percentages.

V_d = actual voltage drop, in volts

V_p = permissible voltage drop on the circuit run, e.g. 5% of supply voltage, in volts

L = route length of circuit, in metres

I = the current to be carried by the cable, in amperes.

The voltage drop values in Tables 40 to 50 may not be applicable under the following conditions:

- (a) Where the cable operating temperature is lower than the maximum temperature permitted for the insulation material. See Clause 4.4 for a method of determining the cable operating temperature for use with the tables.
- (b) Where the load power factor and cable power factor do not give rise to conditions for maximum voltage drop, or the load power factor for larger size conductors varies from 0.8 lagging. See Clause 4.5 for a method of determining the voltage drop where other power factor values are known to be consistent.
- (c) Where out-of-balance load conditions exist. See Clause 4.6 for a method of determining the actual voltage drop on a circuit where out-of-balance loads are known to be consistent.

4.3 DETERMINATION OF VOLTAGE DROP FROM CIRCUIT IMPEDANCE

4.3.1 General

Voltage drop in a circuit represents the vectorial difference in voltage between the origin or supply end and the load end. For the purpose of determining the maximum voltage drop value in Clause 4.2, the voltage drop (V_d) has been related to the impedance of the cables forming the circuit when the power factor of the cable is equal to the power factor of the load, in which case—

$$V_d = IZ_c \quad \dots 4.3(1)$$

where

$$\begin{aligned} V_d &= \text{voltage drop in cable, in volts} \\ I &= \text{current flowing in cable, in amperes} \\ Z_c &= \text{impedance of cable, in ohms} \\ &= \sqrt{(R_c^2 + X_c^2)} \end{aligned}$$

where

$$\begin{aligned} R_c &= \text{cable resistance, in ohms; a function of the material, size and temperature of the conductors} \\ X_c &= \text{cable reactance, in ohms; a function of the conductor shape and cable spacing} \\ &= 0, \text{ for direct current conditions.} \end{aligned}$$

The reactance X_c and resistance R_c of cables is expressed in this Standard as ohms per kilometre, which enables the total impedance Z_c for any given cable route length L to be readily calculated.

Therefore the maximum volt drop in a cable, when the power factor of the cable is equal to the power factor of the load is obtained by multiplying the cable impedance Z_c by the length of cable and the current as follows:

$$V_d = \frac{ILZ_c}{1000} \quad \dots 4.3(2)$$

where

$$\begin{aligned} L &= \text{route length, in metres (see Clause 1.5.6)} \\ V_d &= \text{voltage drop in cable, in volts} \\ Z_c &= \text{impedance of cable, in ohms/km} \end{aligned}$$

4.3.2 Single-phase, two-wire supply system

For a single-phase circuit the impedance of the active and neutral conductors is taken into account. As these conductors are of the same material and generally the same size, the voltage drop on the circuit is twice what it would be for a single cable—

$$V_{d1\phi} = \frac{ILZ_c}{1000} \text{ or } \frac{IL(2Z_c)}{1000} \quad \dots 4.3(3)$$

4.3.3 Three-phase, three-wire or four-wire supply system

For a balanced three-phase circuit no current is flowing in the neutral conductor and at any given instant the current flowing in one active conductor will be balanced by the currents flowing in the other active conductors. The voltage drop per phase to neutral is the voltage drop in one cable and the voltage drop between phases is therefore—

$$V_{d3\phi} = \frac{\sqrt{3} ILZ_c}{1000} \text{ or } \frac{IL(\sqrt{3}Z_c)}{1000} \quad \dots 4.3(4)$$

As the single-phase voltage drop (mV/A.m) values represent $2Z_c$ and the three-phase voltage drop (mV/A.m) values represent $\sqrt{3}Z_c$, then the following conversions may be used:

- (a) Single-phase voltage drop (mV/A.m) value = 1.155 × three-phase voltage drop (mV/A.m) value.
- (b) Three-phase voltage drop (mV/A.m) value = 0.866 × single-phase voltage drop (mV/A.m) value.

4.3.4 Two-phase, three-wire, earthed neutral 120-degree supply system

For a balanced two-phase circuit of this type the current flowing in the neutral conductor will balance the currents flowing in the active conductors. The voltage drop may be assessed on a single-phase basis by summing the voltage drop in one active conductor (IZ_c) with the in-phase component of voltage drop in the neutral ($0.5IZ_c$), i.e.

$$\begin{aligned} V_d &= \frac{ILZ_c + 0.5 ILZ_c}{1000} && \dots 4.3(5) \\ &= \frac{1.5 (ILZ_c)}{1000} \\ &= 0.75 V_{d1\phi} \end{aligned}$$

4.3.5 Single-phase, three-wire, earthed centre-tapped 180-degree supply system

For a balanced single-phase circuit of this type no current is flowing in the neutral or centre-tapped conductor. Therefore the voltage drop on a single-phase basis will only be that associated with the current flowing in one active conductor, i.e.

$$\begin{aligned} V_d &= \frac{ILZ_c}{1000} && \dots 4.3(6) \\ &= 0.5 V_{d1\phi} \end{aligned}$$

4.4 DETERMINATION OF VOLTAGE DROP FROM CABLE OPERATING TEMPERATURE

As described in Clause 3.2.2 and Table 1 of this Standard, the sustained cable current-carrying capacities given in Tables 4 to 19 are based on cables operating at the maximum conductor temperature permitted by the cable insulation material when installed in specified ambient conditions. In many situations, however, the cable operating temperature is considerably less than the maximum figure. Some situations where this will occur are as follows:

- (a) Cables sizes are selected in order not to exceed a certain voltage drop figure.
- (b) Cable sizes are selected for convenience, mechanical strength or short-circuit capacity as required by AS/NZS 3000.
- (c) The ambient air or soil temperatures are consistently below the specified or standard conditions.

The conductor temperature can be estimated using the following equation:

$$\left(\frac{I_0}{I_R}\right)^2 = \frac{\theta_0 - \theta_A}{\theta_R - \theta_A} \quad \dots 4.4(1)$$

where

I_0 = operating current, in amperes

I_R = rated current given in Tables 4 to 21, in amperes

(For cable affected by the presence of certain external influences as detailed in Clauses 3.5.2 to 3.5.8, it will be necessary to correct the rated current given in Tables 4 to 21 by the application of an appropriate rating factor or factors obtained from Tables 22 to 29.)

θ_0 = operating temperature of cable when carrying I_0 , in degrees Celsius

θ_R = operating temperature of the cable when carrying I_R , in degrees Celsius

θ_A = ambient air or soil temperature, in degrees Celsius

The calculated operating temperature (θ_0) is then raised to the nearest temperature 45°C, 60°C, 75°C, 80°C, 90°C or 110°C for use with Tables 34 to 50 to determine the cable a.c. resistance and three-phase voltage drop.

4.5 DETERMINATION OF VOLTAGE DROP FROM LOAD POWER FACTOR

The relationship between the supply and load voltages under different conditions of load power factor is illustrated in the phasor diagrams of Figure 2.

From the phasor diagrams of Figure 2 it can be seen that a larger value of supply voltage is required to maintain a given load voltage when the current is lagging the voltage than when the same current and voltage are in phase. Furthermore, a still smaller supply voltage is required to maintain the given load voltage when the current leads the load voltage.

The voltage drop (IZ_c) is the same in all cases, but because of the different power factors the voltage (IZ_c) is added to the load voltage at a different angle in each case. It can be seen that in the particular instance where the cable power factor and the load power factor are equal, the voltage drop (V_d) is a maximum of IZ_c as discussed in Clause 4.3.

In other situations of load power factor the difference between the magnitudes of the supply voltage (E) and the load voltage (V_L) is smaller. It will be noted that the magnitude of the phasors IR_c and IX_c has been exaggerated with respect to V_L in Figure 2 to illustrate the point. In practice the voltage drop is very much smaller than the supply voltage and the difference between the magnitudes of the supply and load voltages may be approximated by the following equation:

$$E - V_L = I(R_c \cos \theta + X_c \sin \theta) \text{ for lagging p.f.} \quad \dots 4.5(1)$$

$$= I(R_c \cos \theta - X_c \sin \theta) \text{ for leading p.f.} \quad \dots 4.5(2)$$

Therefore for a single-phase system:

$$V_{d1\phi} = IL [2(R_c \cos \theta + X_c \sin \theta)] \quad \dots 4.5(3)$$

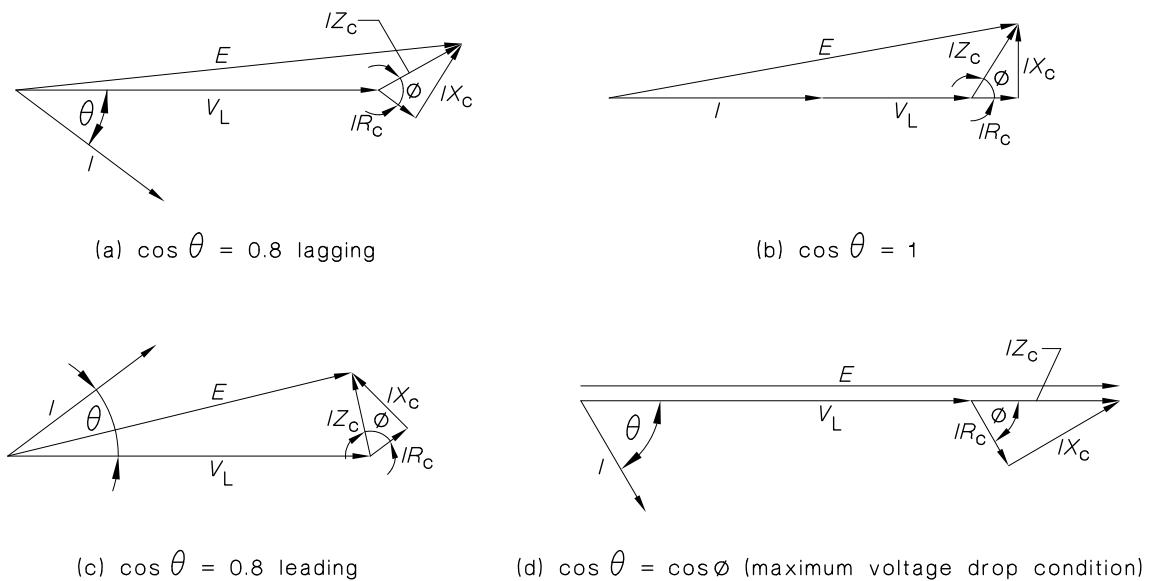
and a three-phase system:

$$V_{d3\phi} = IL [\sqrt{3}(R_c \cos \theta + X_c \sin \theta)] \dots 4.5(4)$$

where

- L = route length of circuit, in metres
- R_c = cable resistance, in ohms per metre
- X_c = cable reactance, in ohms per metre.

Values of R_c and X_c are given in units of ohms per kilometre (Ω/km) in Tables 30 to 39. It will be noted that the influence of skin effect on resistance has been taken into account in the specification of cable resistance values in Tables 38 to 43 and as such are referred to as values of a.c. resistance.



LEGEND:

- I = current flowing in cable
- E = voltage at supply
- V_L = voltage at load
- $V_d = E - V_L$
- $I Z_c$ = voltage drop associated with the impedance of the cable
- $= I \sqrt{(R_c^2 + X_c^2)}$
- $\cos \theta$ = power factor of load
- $\cos \phi$ = power factor of cable

FIGURE 2 PHASOR DIAGRAMS ILLUSTRATING VOLTAGE DROP VARIATION WITH LOAD POWER FACTOR

4.6 DETERMINATION OF VOLTAGE DROP IN UNBALANCED MULTIPHASE CIRCUITS

For unbalanced multiphase circuits, current will be flowing in the neutral conductor as illustrated in the phasor diagram of Figure 3.

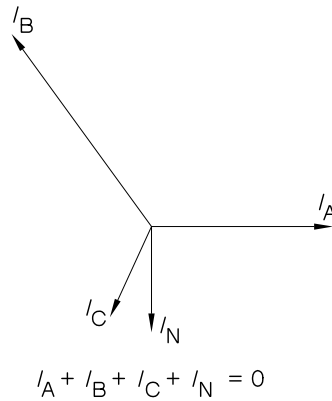


FIGURE 3 PHASOR DIAGRAM OF CURRENTS IN UNBALANCED THREE-PHASE CIRCUIT

A conservative solution to the voltage drop assessment in these situations would be to assume balanced three-phase load conditions and perform calculations using the current flowing in the heaviest-loaded phase. In many cases this will still be necessary if the out-of-balance conditions are inconsistent or intermittent.

However, where the currents in each phase can be shown to be of different magnitudes for consistent periods, voltage drop calculations can be performed on a single-phase basis by geometrically summing the voltage drop in the heaviest loaded phase and the voltage drop in the neutral, as follows:

$$\begin{aligned} V_d &= \text{voltage drop in heaviest loaded active} + \text{voltage drop} \\ &\quad \text{in neutral} \\ &= I_A L_A Z_{cA} + I_N L_N Z_{cN} \end{aligned} \quad \dots 4.6(1)$$

The voltage drop in each conductor can then be assessed with a knowledge of the specific conductor material, size, temperature and length, the magnitude and phase angle of the current flowing in each conductor, and the phase angle of the load by using the appropriate equations given in this Clause.

TABLE 30
REACTANCE (X_c) AT 50 Hz

CABLE TYPE: ALL CABLES EXCLUDING FLEXIBLE CORDS, FLEXIBLE CABLES, MIMS CABLES AND AERIAL CABLES

1	2	3	4	5	6	7	8	9	10	11	12
Conductor size	Reactance (X_c) at 50 Hz, Ω/km										
	Single-core						Multicore				
	Trefoil (or single phase)			Flat touching*			Circular conductors			Shaped conductors	
mm ²	Elastomer	PVC	XLPE	Elastomer	PVC	XLPE	Elastomer	PVC	XLPE	PVC	XLPE
1	0.179	0.168	0.166	0.194	0.184	0.181	0.139	0.119	0.114	—	—
1.5	0.167	0.157	0.155	0.183	0.172	0.170	0.129	0.111	0.107	—	—
2.5	0.153	0.143	0.141	0.168	0.159	0.156	0.118	0.102	0.0988	—	—
4	0.142	0.137	0.131	0.157	0.152	0.146	0.110	0.102	0.0930	—	—
6	0.133	0.128	0.123	0.148	0.143	0.138	0.104	0.0967	0.0887	—	—
10	0.123	0.118	0.114	0.138	0.134	0.129	0.0967	0.0906	0.0840	—	—
16	0.114	0.111	0.106	0.130	0.126	0.122	0.0913	0.0861	0.0805	0.0794	0.0742
25	0.109	0.106	0.102	0.125	0.121	0.118	0.0895	0.0853	0.0808	0.0786	0.0744
35	0.104	0.101	0.0982	0.120	0.117	0.113	0.0863	0.0826	0.0786	0.0761	0.0725
50	0.0988	0.0962	0.0924	0.114	0.111	0.108	0.0829	0.0797	0.0751	0.0734	0.0692
70	0.0941	0.0917	0.0893	0.109	0.107	0.104	0.0798	0.0770	0.0741	0.0710	0.0683
95	0.0924	0.0904	0.0868	0.108	0.106	0.102	0.0790	0.0766	0.0725	0.0706	0.0668
120	0.0889	0.0870	0.0844	0.104	0.102	0.0996	0.0765	0.0743	0.0713	0.0685	0.0657
150	0.0885	0.0868	0.0844	0.104	0.102	0.0996	0.0765	0.0745	0.0718	0.0687	0.0662
185	0.0878	0.0862	0.0835	0.103	0.101	0.0988	0.0762	0.0744	0.0720	0.0686	0.0663
240	0.0861	0.0847	0.0818	0.101	0.0999	0.0970	0.0751	0.0735	0.0709	0.0678	0.0653
300	0.0852	0.0839	0.0809	0.100	0.0991	0.0961	0.0746	0.0732	0.0704	0.0675	0.0649
400	0.0841	0.0829	0.0802	0.0993	0.0982	0.0955	0.0740	0.0728	0.0702	0.0671	0.0647
500	0.0830	0.0820	0.0796	0.0983	0.0973	0.0948	0.0734	0.0723	0.0700	0.0666	0.0645
630	0.0809	0.0800	0.0787	0.0961	0.0952	0.0940	—	—	—	—	—

* These reactance values may also be used as a conservative estimate for cables that are not strictly arranged 'flat touching', e.g. where cables are installed in a wiring enclosure.

TABLE 31
REACTANCE (X_c) AT 50 Hz

CABLE TYPES: FLEXIBLE CORDS AND FLEXIBLE CABLES

1	2	3	4	5	6	7	8	9	10
Conductor size mm ²	Reactance (X_c) at 50 Hz, Ω /km								
	Single-core						Multicore		
	Trefoil (or single phase)			Flat touching*			Circular conductors		
	Elastomer	PVC	XLPE	Elastomer	PVC	XLPE	Elastomer	PVC	XLPE
0.5	0.192	0.180	0.178	0.207	0.195	0.193	0.153	0.131	0.125
0.75	0.179	0.168	0.166	0.194	0.183	0.181	0.142	0.122	0.117
1	0.171	0.161	0.158	0.186	0.176	0.173	0.136	0.116	0.111
1.5	0.160	0.150	0.148	0.176	0.165	0.163	0.127	0.109	0.105
2.5	0.149	0.139	0.137	0.164	0.155	0.153	0.118	0.101	0.0977
4	0.137	0.132	0.126	0.152	0.147	0.141	0.108	0.100	0.0911
6	0.129	0.124	0.119	0.144	0.139	0.134	0.103	0.0954	0.0871
10	0.116	0.112	0.107	0.131	0.127	0.123	0.0936	0.0876	0.0810
16	0.109	0.105	0.101	0.124	0.120	0.116	0.0887	0.0835	0.0779
25	0.104	0.1010	0.0973	0.119	0.116	0.113	0.0871	0.0829	0.0783
35	0.0991	0.0961	0.0930	0.114	0.111	0.108	0.0839	0.0801	0.0761
50	0.0964	0.0938	0.0901	0.112	0.109	0.105	0.0832	0.0799	0.0754
70	0.0917	0.0894	0.0869	0.107	0.105	0.102	0.0800	0.0773	0.0744
95	0.0905	0.0885	0.0849	0.106	0.104	0.100	0.0796	0.0771	0.0729
120	0.0872	0.0854	0.0828	0.102	0.101	0.0980	0.0774	0.0753	0.0723
150	0.0870	0.0853	0.0830	0.102	0.101	0.0982	0.0775	0.0755	0.0728
185	0.0862	0.0847	0.0821	0.101	0.0999	0.0973	0.0771	0.0754	0.0730
240	0.0849	0.0835	0.0808	0.100	0.0988	0.0960	0.0764	0.0749	0.0722
300	0.0842	0.0830	0.0800	0.0994	0.0982	0.0953	0.0761	0.0747	0.0718
400	0.0825	0.0814	0.0788	0.0977	0.0966	0.0941	0.0750	0.0738	0.0714
500	0.0812	0.0803	0.0780	0.0965	0.0955	0.0932	0.0743	0.0732	0.0711
630	0.0797	0.0789	0.0777	0.0950	0.0941	0.0929	—	—	—

* These reactance values may also be used as a conservative estimate for cables that are not strictly arranged 'flat touching', e.g. where cables are installed in a wiring enclosure.

TABLE 32
REACTANCE (X_c) AT 50 Hz

CABLE TYPE: MIMS

Conductor size mm ²	Reactance (X_c) at 50 Hz, Ω /km	
	Single-core (trefoil formation)	Multicore
0.6/0.6 kV cables		
1	0.123	0.0912
1.5	0.116	0.0865
2.5	0.107	0.0814
4	0.101	—
1/1 kV cables		
1.5	0.139	0.1010
2.5	0.128	0.0937
4	0.120	0.0879
6	0.112	0.0835
10	0.104	0.0788
16	0.0976	0.0752
25	0.0927	0.0723
35	0.0889	—
50	0.0854	—
70	0.0827	—
95	0.0804	—
120	0.0785	—
150	0.0772	—
185	0.0784	—
240	0.0768	—
300	0.0777	—
400	0.0784	—

TABLE 33
REACTANCE (X_c) AT 50 Hz

CABLE TYPE: SINGLE-CORE AERIAL WITH BARE OR INSULATED CONDUCTORS

Conductor size (mm ²) or stranding (No./mm)	Reactance (X_c) of 50 Hz, Ω /km*	
	Single phase and trefoil	Three cores in flat formation
7/1.00	0.371	0.385
6	0.368	0.383
7/1.25	0.357	0.371
10	0.352	0.366
16	0.337	0.352
7/1.75	0.336	0.350
7/2.00	0.327	0.342
25	0.317	0.332
35	0.309	0.324
7/2.50	0.313	0.328
7/2.75	0.307	0.322
50	0.300	0.314
19/1.75	0.301	0.315
7/3.00	0.302	0.316
19/2.00	0.292	0.307
70	0.288	0.303
7/3.50	0.292	0.307
7/3.75	0.288	0.302
95	0.278	0.292
37/1.75	0.279	0.293
7/4.50	0.276	0.291
19/2.75	0.272	0.287
120	0.270	0.284
7/4.75	0.273	0.287
19/3.00	0.267	0.282
150	0.263	0.278
19/3.25	0.262	0.276
185	0.256	0.271
19/3.50	0.257	0.272
37/2.50	0.257	0.271

* Values are based on a spacing of 0.4 m.

TABLE 34
a.c. RESISTANCE (R_c) AT 50 Hz

CABLE TYPE: SINGLE-CORE

1	2	3	4	5	6	7	8	9	10
Conductor size mm ²	a.c. resistance (R_c) at 50 Hz, Ω /km								
	Copper*					Aluminium			
	Conductor temperature, °C					Conductor temperature, °C			
	45	60	75	90	110	45	60	75	90
A1 1	23.3	24.5	25.8	27.0	28.7	—	—	—	—
1.5	14.9	15.7	16.5	17.3	18.4	—	—	—	—
2.5	8.14	8.57	9.01	9.45	10.0	—	—	—	—
4	5.06	5.33	5.61	5.88	6.24	—	—	—	—
6	3.38	3.56	3.75	3.93	4.17	—	—	—	—
10	2.01	2.12	2.23	2.33	2.48	—	—	—	—
16	1.26	1.33	1.40	1.47	1.56	2.10	2.22	2.33	2.45
25	0.799	0.842	0.884	0.927	0.984	1.32	1.39	1.47	1.54
35	0.576	0.607	0.638	0.668	0.710	0.956	1.01	1.06	1.11
50	0.426	0.448	0.471	0.494	0.524	0.706	0.745	0.783	0.822
70	0.295	0.311	0.327	0.342	0.363	0.488	0.515	0.542	0.568
95	0.213	0.225	0.236	0.247	0.262	0.353	0.372	0.392	0.411
120	0.170	0.179	0.188	0.197	0.208	0.279	0.295	0.310	0.325
150	0.138	0.145	0.153	0.160	0.169	0.228	0.240	0.253	0.265
185	0.111	0.117	0.123	0.129	0.136	0.182	0.192	0.202	0.212
240	0.0862	0.0905	0.0948	0.0991	0.105	0.140	0.147	0.155	0.162
300	0.0703	0.0736	0.0770	0.0803	0.0846	0.113	0.119	0.125	0.130
400	0.0569	0.0595	0.0620	0.0646	0.0677	0.0890	0.0936	0.0981	0.103
500	0.0467	0.0487	0.0506	0.0525	0.0547	0.0709	0.0744	0.0779	0.0813
630	0.0389	0.0404	0.0418	0.0432	0.0448	0.0571	0.0597	0.0623	0.0649

* For the a.c. resistance of tinned copper conductor, multiply copper value by 1.01.

TABLE 35
a.c. RESISTANCE (R_c) AT 50 Hz

CABLE TYPE: MULTICORE WITH CIRCULAR CONDUCTORS

1	2	3	4	5	6	7	8	9	10
Conductor size	a.c. resistance (R_c) at 50 Hz, Ω /km								
	Copper*					Aluminium			
	Conductor temperature, °C					Conductor temperature, °C			
	mm ²	45	60	75	90	110	45	60	75
1	23.3	24.5	25.8	27.0	28.7	—	—	—	—
1.5	14.9	15.7	16.5	17.3	18.4	—	—	—	—
2.5	8.14	8.57	9.01	9.45	10.0	—	—	—	—
4	5.06	5.33	5.61	5.88	6.24	—	—	—	—
6	3.38	3.56	3.75	3.93	4.17	—	—	—	—
10	2.01	2.12	2.23	2.33	2.48	—	—	—	—
16	1.26	1.33	1.40	1.47	1.56	2.10	2.22	2.33	2.45
25	0.799	0.842	0.884	0.927	0.984	1.32	1.39	1.47	1.54
35	0.576	0.607	0.638	0.669	0.710	0.956	1.01	1.06	1.11
50	0.426	0.449	0.471	0.494	0.524	0.706	0.745	0.784	0.822
70	0.295	0.311	0.327	0.343	0.364	0.488	0.515	0.542	0.569
95	0.214	0.225	0.236	0.248	0.262	0.353	0.373	0.392	0.411
120	0.170	0.179	0.188	0.197	0.209	0.280	0.295	0.310	0.325
150	0.139	0.146	0.153	0.160	0.170	0.228	0.241	0.253	0.265
185	0.112	0.118	0.123	0.129	0.136	0.182	0.192	0.202	0.212
240	0.0870	0.0912	0.0955	0.0998	0.105	0.140	0.148	0.155	0.162
300	0.0712	0.0745	0.0778	0.0812	0.0852	0.113	0.119	0.125	0.131
400	0.0580	0.0605	0.0630	0.0656	0.0685	0.0897	0.0943	0.0988	0.103
500	0.0486	0.0506	0.0525	0.0544	0.0565	0.0730	0.0765	0.0800	0.0835

* For the a.c. resistance of tinned copper conductor, multiply copper value by 1.01.

TABLE 36
a.c. RESISTANCE (R_c) AT 50 Hz

CABLE TYPE: MULTICORE WITH SHAPED CONDUCTORS

1	2	3	4	5	6	7	8	9
Conductor size	a.c. resistance (R_c) at 50 Hz, Ω /km							
	Copper*				Aluminium			
	Conductor temperature, °C				Conductor temperature, °C			
	mm ²	45	60	75	90	45	60	75
16	1.26	1.33	1.40	1.47	2.10	2.22	2.33	2.45
25	0.799	0.842	0.884	0.927	1.32	1.39	1.47	1.54
35	0.576	0.607	0.638	0.669	0.956	1.01	1.06	1.11
50	0.426	0.448	0.471	0.494	0.706	0.745	0.783	0.822
70	0.295	0.311	0.327	0.342	0.488	0.515	0.542	0.568
95	0.213	0.224	0.236	0.247	0.353	0.372	0.392	0.411
120	0.170	0.179	0.187	0.196	0.279	0.295	0.310	0.325
150	0.138	0.145	0.153	0.160	0.228	0.240	0.253	0.265
185	0.111	0.117	0.123	0.128	0.182	0.192	0.202	0.211
240	0.0859	0.0902	0.0945	0.0988	0.139	0.147	0.154	0.162
300	0.0698	0.0732	0.0766	0.0800	0.112	0.118	0.124	0.130
400	0.0563	0.0589	0.0615	0.0641	0.0886	0.0932	0.0978	0.102
500	0.0466	0.0486	0.0506	0.0526	0.0716	0.0752	0.0788	0.0824

* For the a.c. resistance of tinned copper conductor, multiply copper value by 1.01.

TABLE 37
a.c. RESISTANCE (R_c) AT 50 Hz

CABLE TYPES: FLEXIBLE CORDS AND FLEXIBLE CABLES WITH COPPER CONDUCTORS*

1	2	3	4	5	6	7	8	9	10	11
Conductor size mm ²	a.c. resistance (R_c) at 50 Hz, Ω /km									
	Single-core					Multicore				
	Conductor temperature, °C					Conductor temperature, °C				
	45	60	75	90	110	45	60	75	90	110
0.5	42.8	45.1	47.4	49.7	52.8	42.8	45.1	47.4	49.7	52.8
0.75	28.6	30.1	31.6	33.2	35.2	28.6	30.1	31.6	33.2	35.2
1	21.4	22.6	23.7	24.9	26.4	21.4	22.6	23.7	24.9	26.4
1.5	14.6	15.4	16.2	17.0	18.0	14.6	15.4	16.2	17.0	18.0
2.5	8.76	9.23	9.70	10.2	10.8	8.76	9.23	9.70	10.2	10.8
4	5.44	5.73	6.02	6.31	6.70	5.44	5.73	6.02	6.31	6.70
6	3.62	3.82	4.01	4.21	4.47	3.62	3.82	4.01	4.21	4.47
10	2.10	2.21	2.32	2.44	2.59	2.10	2.21	2.32	2.44	2.59
16	1.33	1.40	1.47	1.54	1.64	1.33	1.40	1.47	1.54	1.64
25	0.857	0.903	0.949	0.995	1.06	0.857	0.903	0.949	0.995	1.06
35	0.609	0.641	0.674	0.707	0.750	0.609	0.642	0.674	0.707	0.750
50	0.424	0.447	0.470	0.493	0.523	0.425	0.447	0.470	0.493	0.523
70	0.300	0.316	0.332	0.348	0.369	0.300	0.316	0.332	0.348	0.369
95	0.227	0.240	0.252	0.264	0.280	0.228	0.240	0.252	0.264	0.280
120	0.178	0.188	0.197	0.207	0.219	0.179	0.188	0.198	0.207	0.219
150	0.144	0.151	0.159	0.166	0.176	0.144	0.152	0.159	0.167	0.176
185	0.119	0.125	0.131	0.137	0.145	0.119	0.126	0.132	0.138	0.146
240	0.0912	0.0958	0.100	0.105	0.111	0.0920	0.0965	0.101	0.106	0.111
300	0.0745	0.0780	0.0817	0.0853	0.0898	0.0753	0.0789	0.0825	0.0860	0.0905
400	0.0587	0.0613	0.0640	0.0666	0.0699	0.0597	0.0623	0.0649	0.0675	0.0706
500	0.0487	0.0507	0.0527	0.0548	0.0571	0.0498	0.0518	0.0538	0.0558	0.0580

* For the a.c. resistance of tinned copper conductors, multiply copper value by 1.01.

TABLE 38
a.c. RESISTANCE (R_c) AT 50 Hz

CABLE TYPE: MIMS

1	2	3	4	5	6	7
Conductor size	a.c. resistance (R_c) at 50 Hz, Ω/km					
	Conductor temperature, $^{\circ}\text{C}$					
mm^2	45	60	75	90	100	105
1	18.9	19.9	20.9	21.9	22.6	22.9
1.5	12.7	13.3	14.0	14.7	15.2	15.4
2.5	7.61	8.02	8.43	8.83	9.11	9.24
4	4.76	5.02	5.27	5.53	5.70	5.78
6	3.16	3.33	3.50	3.67	3.79	3.84
10	1.89	1.99	2.09	2.20	2.26	2.30
16	1.19	1.25	1.31	1.38	1.42	1.44
25	0.758	0.799	0.840	0.880	0.907	0.921
35	0.541	0.570	0.599	0.628	0.647	0.657
50	0.379	0.400	0.420	0.440	0.454	0.460
70	0.271	0.286	0.300	0.315	0.325	0.329
95	0.201	0.211	0.222	0.233	0.240	0.243
120	0.160	0.168	0.176	0.185	0.190	0.193
150	0.129	0.135	0.142	0.149	0.153	0.155
185	0.105	0.110	0.116	0.121	0.125	0.127
240	0.0825	0.0866	0.0906	0.0947	0.0975	0.0988
300	0.0674	0.0706	0.0739	0.0771	0.0792	0.0803
400	0.0527	0.550	0.0574	0.0597	0.0613	0.0621

TABLE 39
a.c. RESISTANCE (R_c) AT 50 Hz

CABLE TYPE: SINGLE-CORE AERIAL WITH BARE OR INSULATED CONDUCTORS

1	2	3	4	5	6	7	8	9
Conductor size (mm ²) or stranding (No./mm)	a.c. resistance (R_c) at 50 Hz, Ω /km*							
	Copper				Aluminium			
	Conductor temperature, °C				Conductor temperature, °C			
	45	60	75	80	45	60	75	80
7/1.00	3.57	3.76	3.95	4.02	—	—	—	—
6	3.48	3.67	3.86	3.92	—	—	—	—
7/1.25	2.30	2.42	2.54	2.58	—	—	—	—
10	2.06	2.18	2.29	2.32	—	—	—	—
16	1.30	1.37	1.44	1.46	2.10	2.21	2.32	2.36
7/1.75	1.16	1.23	1.29	1.31	—	—	—	—
7/2.00	0.895	0.943	0.991	1.01	—	—	—	—
25	0.823	0.867	0.911	0.926	1.32	1.39	1.46	1.48
35	0.593	0.625	0.657	0.667	0.953	1.00	1.06	1.07
7/2.50	—	—	—	—	0.915	0.964	1.01	1.03
7/2.75	0.476	0.501	0.527	0.535	0.757	0.797	0.838	0.852
50	0.438	0.462	0.485	0.493	0.704	0.742	0.780	0.792
19/1.75	0.434	0.457	0.481	0.488	—	—	—	—
7/3.00	—	—	—	—	0.636	0.670	0.704	0.716
19/2.00	0.333	0.351	0.369	0.375	—	—	—	—
70	0.303	0.320	0.336	0.341	0.487	0.513	0.539	0.548
7/3.50	0.295	0.310	0.326	0.331	—	—	—	—
7/3.75	0.256	0.270	0.284	0.288	0.407	0.428	0.450	0.457
95	0.226	0.238	0.250	0.254	0.352	0.371	0.389	0.396
37/1.75	0.223	0.235	0.247	0.251	—	—	—	—
7/4.50	—	—	—	—	0.284	0.299	0.314	0.319
19/2.75	0.176	0.186	0.195	0.198	—	—	—	—
120	0.174	0.183	0.193	0.196	0.278	0.293	0.308	0.313
7/4.75	—	—	—	—	0.255	0.269	0.282	0.287
19/3.00	0.148	0.156	0.163	0.166	—	—	—	—
150	0.141	0.149	0.156	0.159	0.227	0.239	0.251	0.255
19/3.25	—	—	—	—	0.201	0.212	0.223	0.227
185	0.113	0.119	0.125	0.127	0.181	0.190	0.200	0.203
19/3.50	—	—	—	—	0.173	0.182	0.191	0.194
37/2.50	0.110	0.116	0.122	0.124	—	—	—	—

* Values are based on a spacing of 0.4 m.

TABLE 40
THREE-PHASE VOLTAGE DROP (V_c) AT 50 Hz

CABLE TYPES: SINGLE-CORE INSULATED AND SHEATHED COPPER CONDUCTORS LAID IN TREFOIL

1	2	3	4	5	6	7	8	9	10	11
Conductor size	Three-phase voltage drop (V_c) at 50 Hz, mV/A.m									
	Conductor temperature, °C									
	45		60		75		90		110	
	mm ²	Max.	0.8 p.f.	Max.	0.8 p.f.	Max.	0.8 p.f.	Max.	0.8 p.f.	Max.
1	40.3	—	42.5	—	44.7	—	46.8	—	49.7	—
1.5	25.9	—	27.3	—	28.6	—	30.0	—	31.9	—
2.5	14.1	—	14.9	—	15.6	—	16.4	—	17.4	—
4	8.77	—	9.24	—	9.71	—	10.2	—	10.8	—
6	5.86	—	6.18	—	6.49	—	6.81	—	7.23	—
10	3.49	—	3.67	—	3.86	—	4.05	—	4.30	—
16	2.20	—	2.31	—	2.43	—	2.55	—	2.70	—
25	1.40	—	1.47	—	1.54	—	1.62	—	1.72	—
35	1.01	—	1.07	—	1.12	—	1.17	—	1.24	—
50	0.757	—	0.795	—	0.834	—	0.872	—	0.924	—
70	0.537	—	0.563	—	0.589	—	0.615	—	0.650	—
95	0.402	—	0.420	—	0.439	—	0.457	—	0.481	—
120	0.332	—	0.345	—	0.359	—	0.373	—	0.392	—
150	0.284	—	0.295	—	0.305	—	0.316	—	0.331	—
185	0.245	0.245	0.253	0.253	0.261	—	0.269	—	0.280	—
240	0.211	0.208	0.216	0.214	0.221	0.220	0.227	0.226	0.235	0.234
300	0.191	0.185	0.195	0.190	0.198	0.195	0.202	0.199	0.208	0.206
400	0.175	0.166	0.178	0.169	0.181	0.173	0.183	0.176	0.187	0.181
500	0.165	0.150	0.166	0.153	0.168	0.156	0.170	0.158	0.172	0.162
630	0.155	0.138	0.156	0.140	0.157	0.142	0.159	0.144	0.160	0.146

NOTE: These V_c values apply to a balanced three-phase circuit in which no current flows in the neutral conductor. To determine the single phase V_c the current in the neutral conductor needs to be considered by

multiplying the three-phase value by $\frac{2}{\sqrt{3}} = 1.155$.

TABLE 41
THREE-PHASE VOLTAGE DROP (V_c) AT 50 Hz

CABLE TYPES: SINGLE-CORE INSULATED AND SHEATHED COPPER CONDUCTORS, LAID FLAT TOUCHING OR IN A WIRING ENCLOSURE

1	2	3	4	5	6	7	8	9	10	11
Conductor size	Three-phase voltage drop (V_c) at 50 Hz, mV/A.m									
	Conductor temperature, °C									
	45		60		75		90		110	
	mm ²	Max.	0.8 p.f.	Max.	0.8 p.f.	Max.	0.8 p.f.	Max.	0.8 p.f.	Max.
1	40.3	—	42.5	—	44.7	—	46.8	—	49.7	—
1.5	25.9	—	27.3	—	28.6	—	30.0	—	31.9	—
2.5	14.1	—	14.9	—	15.6	—	16.4	—	17.4	—
4	8.77	—	9.24	—	9.71	—	10.2	—	10.8	—
6	5.86	—	6.18	—	6.49	—	6.81	—	7.23	—
10	3.49	—	3.68	—	3.86	—	4.05	—	4.30	—
16	2.20	—	2.32	—	2.43	—	2.55	—	2.71	—
25	1.40	—	1.47	—	1.55	—	1.62	—	1.72	—
35	1.02	—	1.07	—	1.12	—	1.18	—	1.25	—
50	0.763	—	0.801	—	0.840	—	0.878	—	0.929	—
70	0.545	—	0.571	—	0.597	—	0.623	—	0.657	—
95	0.413	—	0.431	—	0.449	—	0.467	—	0.491	—
120	0.345	—	0.358	—	0.371	—	0.385	—	0.403	—
150	0.299	0.299	0.309	—	0.319	—	0.330	—	0.344	—
185	0.262	0.261	0.270	0.269	0.277	0.277	0.285	0.285	0.296	0.296
240	0.230	0.224	0.235	0.230	0.240	0.236	0.245	0.242	0.252	0.250
300	0.212	0.201	0.215	0.206	0.219	0.211	0.222	0.215	0.227	0.222
400	0.198	0.181	0.200	0.185	0.202	0.189	0.205	0.192	0.208	0.197
500	0.188	0.166	0.190	0.169	0.191	0.172	0.193	0.174	0.195	0.178
630	0.179	0.153	0.180	0.155	0.181	0.157	0.182	0.159	0.184	0.162

NOTE: These V_c values apply to a balanced three-phase circuit in which no current flows in the neutral conductor. To determine the single phase V_c the current in the neutral conductor needs to be considered by multiplying the three-phase value by $\frac{2}{\sqrt{3}} = 1.155$.

TABLE 42
THREE-PHASE VOLTAGE DROP (V_c) AT 50 Hz

CABLE TYPE: MULTICORE WITH CIRCULAR COPPER CONDUCTORS

1	2	3	4	5	6	7	8	9	10	11
Conductor size	Three-phase voltage drop (V_c) at 50 Hz, mV/A.m									
	Conductor temperature, °C									
	45		60		75		90		110	
mm ²	Max.	0.8 p.f.	Max.	0.8 p.f.	Max.	0.8 p.f.	Max.	0.8 p.f.	Max.	0.8 p.f.
1	40.3	—	42.5	—	44.7	—	46.8	—	49.7	—
1.5	25.9	—	27.3	—	28.6	—	30.0	—	31.9	—
2.5	14.1	—	14.9	—	15.6	—	16.4	—	17.4	—
4	8.77	—	9.24	—	9.71	—	10.2	—	10.8	—
6	5.86	—	6.18	—	6.49	—	6.80	—	7.22	—
10	3.49	—	3.67	—	3.86	—	4.05	—	4.29	—
16	2.19	—	2.31	—	2.43	—	2.55	—	2.70	—
25	1.39	—	1.47	—	1.54	—	1.61	—	1.71	—
35	1.01	—	1.06	—	1.11	—	1.17	—	1.24	—
50	0.751	—	0.790	—	0.829	—	0.868	—	0.920	—
70	0.530	—	0.556	—	0.583	—	0.609	—	0.645	—
95	0.394	—	0.413	—	0.431	—	0.450	—	0.475	—
120	0.323	—	0.337	—	0.351	—	0.366	—	0.385	—
150	0.274	—	0.285	—	0.296	—	0.307	—	0.322	—
185	0.234	—	0.242	—	0.251	—	0.259	—	0.271	—
240	0.198	0.198	0.204	0.204	0.210	0.210	0.216	0.216	0.224	—
300	0.178	0.175	0.182	0.180	0.186	0.185	0.190	0.189	0.196	0.196
400	0.162	0.157	0.165	0.160	0.168	0.164	0.171	0.167	0.175	0.172
500	0.152	0.143	0.154	0.146	0.156	0.148	0.158	0.151	0.160	0.155

NOTE: These V_c values apply to a balanced three-phase circuit in which no current flows in the neutral conductor. To determine the single phase V_c the current in the neutral conductor needs to be considered by multiplying the three-phase value by $\frac{2}{\sqrt{3}} = 1.155$.

TABLE 43
THREE-PHASE VOLTAGE DROP (V_c) AT 50 Hz

CABLE TYPES: SINGLE-CORE INSULATED AND SHEATHED ALUMINIUM CONDUCTORS, LAID IN TREFOIL

1	2	3	4	5	6	7	8	9
Conductor size	Three-phase voltage drop (V_c) at 50 Hz, mV/A.m							
	Conductor temperature, °C							
	45		60		75		90	
	mm²	Max.	0.8 p.f.	Max.	0.8 p.f.	Max.	0.8 p.f.	Max.
16	3.65	—	3.85	—	4.05	—	4.25	—
25	2.30	—	2.42	—	2.55	—	2.67	—
35	1.66	—	1.75	—	1.85	—	1.94	—
50	1.23	—	1.30	—	1.37	—	1.43	—
70	0.860	—	0.906	—	0.952	—	0.997	—
95	0.631	—	0.663	—	0.696	—	0.727	—
120	0.507	—	0.532	—	0.558	—	0.582	—
150	0.422	—	0.443	—	0.463	—	0.482	—
185	0.349	—	0.364	—	0.380	—	0.394	—
240	0.283	—	0.294	—	0.305	—	0.314	—
300	0.243	—	0.251	—	0.260	—	0.266	—
400	0.211	0.209	0.216	0.216	0.222	0.222	0.226	0.226
500	0.188	0.183	0.192	0.188	0.196	0.193	0.197	0.195
630	0.170	0.162	0.173	0.166	0.175	0.169	0.177	0.172

NOTE: These V_c values apply to a balanced three-phase circuit in which no current flows in the neutral conductor. To determine the single phase V_c the current in the neutral conductor needs to be considered by multiplying the three-phase value by $\frac{2}{\sqrt{3}} = 1.155$.

TABLE 44
THREE-PHASE VOLTAGE DROP (V_c) AT 50 Hz

CABLE TYPES: SINGLE-CORE INSULATED AND SHEATHED ALUMINIUM CONDUCTORS, LAID FLAT TOUCHING

1	2	3	4	5	6	7	8	9
Conductor size	Three-phase voltage drop (V_c) at 50 Hz, mV/A.m							
	Conductor temperature, °C							
	45		60		75		90	
	Max.	0.8 p.f.	Max.	0.8 p.f.	Max.	0.8 p.f.	Max.	0.8 p.f.
mm ²								
16	3.65	—	3.85	—	4.05	—	4.25	—
25	2.30	—	2.42	—	2.55	—	2.67	—
35	1.67	—	1.76	—	1.85	—	1.94	—
50	1.24	—	1.30	—	1.37	—	1.44	—
70	0.866	—	0.911	—	0.956	—	1.00	—
95	0.638	—	0.670	—	0.702	—	0.733	—
120	0.515	—	0.540	—	0.565	—	0.589	—
150	0.432	—	0.452	—	0.472	—	0.491	—
185	0.361	—	0.376	—	0.391	—	0.404	—
240	0.297	—	0.308	—	0.319	—	0.327	—
300	0.260	0.259	0.268	0.267	0.276	0.275	0.281	—
400	0.229	0.225	0.235	0.231	0.240	0.238	0.243	0.242
500	0.208	0.199	0.212	0.204	0.216	0.209	0.216	0.211
630	0.192	0.178	0.195	0.181	0.197	0.185	0.198	0.188

NOTE: These V_c values apply to a balanced three-phase circuit in which no current flows in the neutral conductor. To determine the single phase V_c the current in the neutral conductor needs to be considered by multiplying the three-phase value by $\frac{2}{\sqrt{3}} = 1.155$.

TABLE 45
THREE-PHASE VOLTAGE DROP (V_c) AT 50 Hz

CABLE TYPE: MULTICORE CABLES WITH CIRCULAR ALUMINIUM CONDUCTORS

1	2	3	4	5	6	7	8	9	10	11
Conductor size	Three-phase voltage drop (V_c) at 50 Hz, mV/A.m									
	Conductor temperature, °C									
	45		60		75		80		90	
	mm ²	Max.	0.8 p.f.	Max.	0.8 p.f.	Max.	0.8 p.f.	Max.	0.8 p.f.	Max.
16	3.64	—	3.84	—	4.04	—	4.11	—	4.24	—
25	2.29	—	2.42	—	2.54	—	2.59	—	2.67	—
35	1.66	—	1.75	—	1.84	—	1.87	—	1.93	—
50	1.23	—	1.30	—	1.36	—	1.39	—	1.43	—
70	0.856	—	0.902	—	0.948	—	0.966	—	0.993	—
95	0.626	—	0.659	—	0.691	—	0.706	—	0.723	—
120	0.501	—	0.527	—	0.552	—	0.565	—	0.577	—
150	0.416	—	0.436	—	0.457	—	0.468	—	0.476	—
185	0.341	—	0.357	—	0.373	—	—	—	0.388	—
240	0.274	—	0.285	—	0.297	—	—	—	0.307	—
300	0.233	—	0.242	—	0.251	—	—	—	0.258	—
400	0.200	0.200	0.206	0.206	0.212	—	—	—	0.216	—
500	0.178	0.176	0.182	0.181	0.186	0.185	—	—	0.189	0.189

NOTES:

- 1 For aerial bundled cables (ABC) use XLPE single-core, trefoil figures.
- 2 These V_c values apply to a balanced three-phase circuit in which no current flows in the neutral conductor. To determine the single phase V_c the current in the neutral conductor needs to be considered by multiplying the three-phase value by $\frac{2}{\sqrt{3}} = 1.155$.

TABLE 46
THREE-PHASE VOLTAGE DROP (V_c) AT 50 Hz

CABLE TYPES: SINGLE-CORE FLEXIBLE CORDS AND FLEXIBLE CABLES, LAID IN TREFOIL

1	2	3	4	5	6	7	8	9	10	11
Conductor size	Three-phase voltage drop (V_c) at 50 Hz, mV/A.m									
	Conductor temperature, °C									
	45		60		75		90		110	
	mm ²	Max.	0.8 p.f.	Max.	0.8 p.f.	Max.	0.8 p.f.	Max.	0.8 p.f.	Max.
0.5	74.2	—	78.2	—	82.2	—	86.1	—	91.4	—
0.75	49.5	—	52.1	—	54.8	—	57.4	—	61.0	—
1	37.1	—	39.1	—	41.1	—	43.1	—	45.7	—
1.5	25.3	—	26.7	—	28.0	—	29.4	—	31.2	—
2.5	15.2	—	16.0	—	16.8	—	17.6	—	18.7	—
4	9.42	—	9.92	—	10.4	—	10.9	—	11.6	—
6	6.28	—	6.62	—	6.95	—	7.29	—	7.74	—
10	3.64	—	3.83	—	4.03	—	4.22	—	4.48	—
16	2.31	—	2.43	—	2.56	—	2.68	—	2.84	—
25	1.50	—	1.57	—	1.65	—	1.73	—	1.84	—
35	1.07	—	1.12	—	1.18	—	1.24	—	1.31	—
50	0.754	—	0.792	—	0.831	—	0.869	—	0.921	—
70	0.543	—	0.569	—	0.596	—	0.622	—	0.658	—
95	0.424	—	0.443	—	0.463	—	0.483	—	0.509	—
120	0.344	—	0.358	—	0.373	—	0.388	—	0.408	—
150	0.291	—	0.302	—	0.313	—	0.325	—	0.340	—
185	0.254	—	0.263	—	0.272	—	0.280	—	0.293	—
240	0.215	0.214	0.221	0.221	0.227	0.227	0.233	0.233	0.242	0.242
300	0.194	0.190	0.198	0.195	0.203	0.200	0.207	0.205	0.213	0.212
400	0.175	0.166	0.178	0.170	0.180	0.174	0.183	0.178	0.187	0.183
500	0.164	0.151	0.165	0.154	0.167	0.157	0.169	0.160	0.172	0.164
630	0.154	0.137	0.155	0.139	0.156	0.141	0.157	0.143	0.159	0.146

NOTE: These V_c values apply to a balanced three-phase circuit in which no current flows in the neutral conductor. To determine the single phase V_c the current in the neutral conductor needs to be considered by multiplying the three-phase value by $\frac{2}{\sqrt{3}} = 1.155$.

TABLE 48
THREE-PHASE VOLTAGE DROP (V_c) AT 50 Hz

CABLE TYPES: MULTICORE FLEXIBLE CORDS AND FLEXIBLE CABLES

1	2	3	4	5	6	7	8	9	10	11
Conductor size	Three-phase voltage drop (V_c) at 50 Hz, mV/A.m									
	Conductor temperature, °C									
	45		60		75		90		110	
mm ²	Max.	0.8 p.f.	Max.	0.8 p.f.	Max.	0.8 p.f.	Max.	0.8 p.f.	Max.	0.8 p.f.
0.5	74.2	—	78.2	—	82.2	—	86.1	—	91.4	—
0.75	49.5	—	52.1	—	54.8	—	57.4	—	61.0	—
1	37.1	—	39.1	—	41.1	—	43.1	—	45.7	—
1.5	25.3	—	26.7	—	28.0	—	29.4	—	31.2	—
2.5	15.2	—	16.0	—	16.8	—	17.6	—	18.7	—
4	9.42	—	9.92	—	10.4	—	10.9	—	11.6	—
6	6.28	—	6.62	—	6.95	—	7.29	—	7.74	—
10	3.64	—	3.83	—	4.03	—	4.22	—	4.48	—
16	2.31	—	2.43	—	2.55	—	2.68	—	2.84	—
25	1.49	—	1.57	—	1.65	—	1.73	—	1.84	—
35	1.06	—	1.12	—	1.18	—	1.23	—	1.31	—
50	0.749	—	0.788	—	0.827	—	0.866	—	0.917	—
70	0.537	—	0.564	—	0.591	—	0.618	—	0.654	—
95	0.418	—	0.437	—	0.457	—	0.477	—	0.504	—
120	0.337	—	0.352	—	0.367	—	0.383	—	0.403	—
150	0.283	—	0.295	—	0.306	—	0.318	—	0.334	—
185	0.246	—	0.255	—	0.264	—	0.273	—	0.286	—
240	0.207	0.206	0.213	0.213	0.219	0.219	0.225	—	0.234	—
300	0.185	0.183	0.189	0.188	0.194	0.193	0.198	0.198	0.205	0.204
400	0.165	0.160	0.168	0.164	0.171	0.167	0.174	0.171	0.178	0.176
500	0.154	0.145	0.156	0.148	0.158	0.151	0.160	0.154	0.163	0.158

NOTE: These V_c values apply to a balanced three-phase circuit in which no current flows in the neutral conductor. To determine the single phase V_c the current in the neutral conductor needs to be considered by

multiplying the three-phase value by $\frac{2}{\sqrt{3}} = 1.155$.

TABLE 49
THREE-PHASE VOLTAGE DROP (V_c) AT 50 Hz

CABLE TYPES: SINGLE-CORE AND MULTICORE MIMS, LAID IN TREFOIL

1	2	3	4	5	6	7	8	9	10	11	12	13
Conductor size	Three-phase voltage drop (V_c) at 50 Hz, mV/A.m											
	Conductor temperature, °C											
	45		60		75		90		100		105	
	Max.	0.8 p.f.	Max.	0.8 p.f.	Max.	0.8 p.f.	Max.	0.8 p.f.	Max.	0.8 p.f.	Max.	0.8 p.f.
mm ²												
0.6/0.6 kV Cables												
1	32.8	—	34.6	—	36.3	—	38.1	—	39.1	31.4	39.7	31.9
1.5	21.9	—	23.0	—	24.2	—	25.4	—	26.3	21.2	26.7	21.5
2.5	13.1	—	13.8	—	14.5	—	15.2	—	15.8	12.7	16.0	12.9
4	8.20	—	8.64	—	9.08	—	9.52	—	9.87	8.00	10.01	8.11
1/1 kV Cables												
1.5	21.9	—	23.0	—	24.2	—	25.4	—	26.3	21.2	26.7	21.5
2.5	13.1	—	13.8	—	14.5	—	15.2	—	15.8	12.8	16.0	12.9
4	8.20	—	8.64	—	9.08	—	9.52	—	9.87	8.02	10.01	8.13
6	5.46	—	5.77	—	6.05	—	6.34	—	6.57	5.37	6.65	5.44
10	3.30	—	3.47	—	3.65	—	3.83	—	3.92	3.24	3.99	3.30
16	2.06	—	2.17	—	2.28	—	2.39	—	2.47	2.07	2.50	2.10
25	1.32	—	1.39	—	1.46	—	1.53	—	1.58	1.35	1.60	1.37
35	0.949	—	0.999	—	1.05	—	1.10	—	1.13	0.99	1.15	1.00
50	0.672	—	0.706	—	0.741	—	0.775	—	0.800	0.718	0.810	0.726
70	0.491	—	0.515	—	0.539	—	0.563	—	0.581	0.536	0.588	0.542
95	0.375	—	0.393	—	0.410	—	0.427	—	0.438	0.416	0.443	0.420
120	0.307	—	0.320	—	0.333	—	0.346	—	0.356	0.345	0.361	0.349
150	0.260	—	0.270	—	0.280	—	0.290	—	0.297	0.292	0.300	0.295
185	0.228	—	0.236	—	0.243	—	0.251	—	0.256	0.255	0.258	0.257
240	0.195	0.194	0.201	0.200	0.206	0.206	0.211	0.211	0.215	0.215	0.217	0.217
300	0.178	0.173	0.181	0.178	0.185	0.182	0.189	0.187	0.192	0.190	0.194	0.192
400	0.163	0.154	0.166	0.157	0.168	0.161	0.170	0.164	0.172	0.166	0.173	0.168

NOTE: These V_c values apply to a balanced three-phase circuit in which no current flows in the neutral conductor. To determine the single phase V_c the current in the neutral conductor needs to be considered by multiplying the three-phase value by $\frac{2}{\sqrt{3}} = 1.155$.

TABLE 50
THREE-PHASE VOLTAGE DROP (V_c) AT 50 Hz

CABLE TYPE: AERIAL WITH BARE OR INSULATED COPPER CONDUCTORS

1	2	3	4	5	6	7	8	9
Conductor size (mm ²) or stranding (No./mm)	Three-phase voltage drop (V_c) at 50 Hz, mV/A.m							
	Conductor temperature, °C							
	45		60		75		80	
	Max	0.8 p.f	Max	0.8 p.f	Max	0.8 p.f	Max	0.8 p.f
7/1.00	6.22	—	6.55	—	6.88	—	6.99	—
6	6.06	—	6.39	—	6.71	—	6.82	—
7/1.25	4.02	—	4.23	—	4.45	—	4.52	—
10	3.63	—	3.82	—	4.01	—	4.07	—
16	2.32	—	2.44	—	2.55	—	2.59	—
7/1.75	2.10	—	2.20	—	2.31	—	2.34	—
7/2.00	1.65	—	1.73	—	1.81	—	1.83	—
25	1.53	—	1.60	—	1.67	—	1.69	—
35	1.16	—	1.21	—	1.26	—	1.27	—
7/2.75	0.981	—	1.02	—	1.06	—	1.07	—
50	0.920	—	0.954	—	0.988	—	1.00	—
19/1.75	0.915	—	0.948	—	0.982	—	0.993	—
19/2.00	0.768	0.765	0.791	0.790	0.815	0.815	0.823	0.823
70	0.725	0.720	0.745	0.742	0.767	0.765	0.774	0.772
7/3.50	0.719	0.712	0.738	0.734	0.758	0.756	0.765	0.763
7/3.75	0.667	0.654	0.683	0.673	0.700	0.692	0.705	0.698
95	0.620	0.601	0.633	0.618	0.647	0.635	0.652	0.640
37/1.75	0.619	0.599	0.632	0.616	0.646	0.632	0.650	0.638
19/2.75	0.562	0.527	0.571	0.540	0.580	0.553	0.584	0.558
120	0.556	0.521	0.565	0.534	0.574	0.547	0.577	0.551
19/3.00	0.529	0.482	0.535	0.493	0.542	0.504	0.545	0.508
150	0.517	0.469	0.523	0.479	0.530	0.490	0.532	0.493
185	0.485	0.422	0.489	0.431	0.493	0.439	0.495	0.442
37/2.50	0.484	0.419	0.488	0.427	0.492	0.435	0.493	0.438

NOTE: These V_c values apply to a balanced three-phase circuit in which no current flows in the neutral conductor. To determine the single phase V_c the current in the neutral conductor needs to be considered by multiplying the three-phase value by $\frac{2}{\sqrt{3}} = 1.155$.

TABLE 51
THREE-PHASE VOLTAGE DROP (V_c) AT 50 Hz

CABLE TYPE: AERIAL WITH BARE OR INSULATED ALUMINIUM CONDUCTORS

1	2	3	4	5	6	7	8	9
Conductor size (mm²) or stranding (No./mm)	Three-phase voltage drop (V_c) at 50 Hz, mV/A.m							
	Conductor temperature, °C							
	45		60		75		80	
	Max.	0.8 p.f.	Max.	0.8 p.f.	Max.	0.8 p.f.	Max.	0.8 p.f.
16	3.68	—	3.87	—	4.07	—	4.13	—
25	2.35	—	2.47	—	2.59	—	2.63	—
35	1.74	—	1.82	—	1.91	—	1.93	—
7/2.50	1.68	—	1.76	—	1.84	—	1.86	—
7/2.75	1.41	—	1.48	—	1.55	—	1.57	—
50	1.33	—	1.39	—	1.45	—	1.47	—
7/3.00	1.22	—	1.27	—	1.33	—	1.35	—
70	0.980	—	1.02	—	1.06	—	1.07	—
7/3.75	0.863	—	0.894	—	0.925	—	0.936	—
95	0.776	0.776	0.802	—	0.829	—	0.837	—
7/4.50	0.686	0.680	0.705	0.701	0.725	0.722	0.731	0.729
120	0.671	0.666	0.690	0.686	0.709	0.707	0.715	0.714
7/4.75	0.647	0.637	0.664	0.656	0.680	0.675	0.686	0.681
150	0.601	0.587	0.615	0.604	0.630	0.621	0.635	0.627
19/3.25	0.572	0.551	0.584	0.566	0.596	0.581	0.600	0.586
185	0.543	0.516	0.552	0.530	0.563	0.543	0.566	0.547
19/3.50	0.537	0.507	0.546	0.520	0.555	0.533	0.559	0.537

NOTE: These V_c values apply to a balanced three-phase circuit in which no current flows in the neutral conductor. To determine the single phase V_c the current in the neutral conductor

needs to be considered by multiplying the three-phase value by $\frac{2}{\sqrt{3}} = 1.155$.

SECTION 5 SHORT - CIRCUIT PERFORMANCE

5.1 GENERAL

This Section is applicable to the short-circuit maximum temperature rating of electric cables having a rated voltage not exceeding 0.6/1 kV. Guidance is given on the following aspects:

- (a) Maximum permissible short-circuit temperatures for cable—
 - (i) insulating materials;
 - (ii) outer jacket and bedding materials; and
 - (iii) conductor and metallic sheath materials and components.
- (b) The influence of the method of installation on the temperature limit.
- (c) The calculation of the permissible short-circuit current in the current-carrying components of the cable.

5.2 FACTORS GOVERNING THE APPLICATION OF THE TEMPERATURE LIMITS

The short-circuit temperatures given in Clause 5.5 are the actual temperatures of the current-carrying component as limited by the adjacent materials in the cable and are valid for short-circuit durations of up to 5 s. These temperatures will only be obtained in practice if non-adiabatic heating is assumed (that is, an appropriate allowance for heat loss into the dielectric during the short circuit is made) when calculating the allowable short-circuit current for a given time (not longer than 5 s). The use of the adiabatic method (that is, when heat loss from the current-carrying component during the short circuit is neglected) gives short-circuit currents that are on the safe side. The 5-second period quoted is the limit for the temperatures quoted to be valid, not for the application of the adiabatic calculation method. The time limit for the use of the adiabatic method has a different definition, being a function of both the short-circuit duration and the cross-sectional area of the current-carrying component.

For thermoplastic insulating materials the limits must be applied with caution when the cables are either directly buried or securely clamped when in air. Local pressure due to clamping or the use of an installation radius less than 8 times the cable outside diameter, especially for cables that are rigidly restrained, can lead to high deforming forces under short-circuit conditions. Where these conditions cannot be avoided it is suggested that the limit be reduced by 10°C. The limits quoted are based on average hardness grades of PVC and some adjustment may be necessary for other grades, especially those compounded for improved low-temperature properties.

NOTES:

- 1 Caution should be exercised when using the limits recommended for thermosetting materials on large conductors because the high mechanical forces combined with any residual characteristics could result in deformation sufficient to cause failure.
- 2 Caution may be needed with total cross-sectional areas in the region of 1000 mm² when using the conductor temperatures specified for impregnated paper, cross-linked polyethylene (XLPE) and ethylene propylene rubber (EPR) insulation and the cable is sheathed with a lower-temperature material.
- 3 Information on the short-circuit performance of MIMS cable is not included in this Standard and reference should be made to manufacturer's recommendations.

5.3 CALCULATION OF PERMISSIBLE SHORT-CIRCUIT CURRENTS

The following adiabatic method, which neglects heat loss, is accurate enough for calculating permissible conductor and metallic sheath short-circuit currents for the majority of practical cases and any error is on the safe side. However, for thin screens the adiabatic method indicates much higher temperature rises than actually occur in practice and thus must be used with some discretion.

The generalized form of the adiabatic temperature rise equation, which is applicable to any starting temperature, is as follows:

$$I^2t = K^2S^2 \quad \dots 5.3(1)$$

where

- I* = short-circuit current (r.m.s. over duration), in amperes
- t* = duration of short circuit, in seconds
- K* = constant depending on the material of the current-carrying component, the initial temperature and the final temperature

NOTE: Refer to Table 52 for values of constant (*K*).

- S* = cross-sectional area of the current-carrying component, in square millimetres.

NOTE: For conductors and metallic sheaths, it is sufficient to take the nominal cross-sectional area but in the case of screens, this quantity requires careful consideration.

TABLE 52
VALUES OF CONSTANT *K* FOR DETERMINATION OF PERMISSIBLE SHORT-CIRCUIT CURRENTS

Constant (<i>K</i>)														
Initial temperature of conductor °C	Final temperature of conductor, °C													
	Copper						Aluminium				Lead		Steel	
	140	150	160	220	250	350	140	150	160	250	150	200	150	200
130	37.2	52.2	63.6	106	121	155	24.6	34.5	42.0	79.6	9.5	17.3	18.9	34.1
125	45.7	58.6	68.9	109	123	158	30.2	38.7	45.5	81.5	10.7	17.9	21.2	35.4
110	65.3	74.9	83.2	119	132	164	43.2	49.5	55.0	87.1	13.7	19.9	27.1	39.3
90	85.6	93.1	99.9	131	143	173	56.6	61.5	66.0	94.5	17.0	22.3	33.7	44.1
85	90.1	97.3	104	134	146	176	59.5	64.3	68.6	96.3	17.8	22.9	35.2	45.3
80	94.4	101	108	137	149	178	62.4	67.0	71.1	98.1	18.5	23.5	36.7	46.4
75	98.7	105	111	140	151	180	65.2	69.6	73.6	99.9	19.2	24.0	38.2	47.6
70	103	109	115	143	154	182	68.0	72.2	76.0	102	19.9	24.6	39.6	48.8
65	107	113	119	146	157	185	70.7	74.7	78.4	104	20.6	25.2	41.0	49.9
60	111	117	122	149	159	187	73.3	77.2	80.8	105	21.3	25.7	42.4	51.0
55	115	120	126	152	162	189	75.8	79.6	83.1	107	22.0	26.3	43.7	52.2
50	118	124	129	155	165	192	78.4	82.0	85.5	109	22.7	26.9	45.1	53.3
45	122	128	133	158	168	194	80.9	84.4	87.7	111	23.3	27.4	46.4	54.4
40	126	131	136	160	170	196	83.3	86.8	90.0	113	24.0	28.0	47.7	55.6
35	130	135	140	163	173	199	85.8	89.1	92.3	114	24.6	28.5	49.1	56.7
30	133	138	143	166	176	201	88.2	91.5	94.5	116	25.3	29.1	50.4	57.8
25	137	142	146	169	179	204	90.6	93.8	96.8	118	25.9	29.6	51.7	59.0

5.4 INFLUENCE OF METHOD OF INSTALLATION

When it is intended to make full use of the short-circuit limits of a cable, consideration should be given to the influence of the method of installation. An important aspect concerns the extent and nature of the mechanical restraint imposed on the cable. Longitudinal expansion of a cable during a short circuit can be significant and when this expansion is restrained the resultant forces are considerable.

Where cables are installed in air, provision should be made so that expansion may be absorbed uniformly along the length by snaking rather than permitting it to be relieved by excessive movement at a few points only. Fixings should be spaced sufficiently far apart to permit lateral movement of multicore cables or groups of single-core cables.

Where cables are buried directly in the ground, or must be restrained by frequent fixing, provision should be made to accommodate the resulting longitudinal forces on terminations and joint boxes. Sharp bends should be avoided because the longitudinal forces are translated into radial pressures at bends in the cable route and these may damage thermoplastic components of the cable such as insulation and sheaths. Attention is drawn to the minimum bending radius recommended for the type of cable. For cables in air, it is also desirable to avoid fixings at a bend, which may cause local pressure on the cable.

In determining the short-circuit stresses that will be imposed on a cable, the characteristics of the protective devices used shall be considered.

5.5 MAXIMUM PERMISSIBLE SHORT-CIRCUIT TEMPERATURES

5.5.1 General

Taking into account the recommendation given in Clause 5.2, the temperature values given in Tables 52 to 54 are—

- (a) the actual temperatures of the current-carrying components; and
- (b) the limits specified for short-circuits of up to 5 s duration.

5.5.2 Insulating materials

The temperature limits given in Table 53 are for all types of conditions when the insulating materials specified are in contact with conductors.

TABLE 53
TEMPERATURE LIMITS FOR INSULATING
MATERIALS IN CONTACT WITH CONDUCTORS

Material	Temperature limit °C
Thermoplastic: LLDPE, PE, V-75, HFI-75-TP, TPE-75, V-90, HFI-90-TP, TP 90 and V-90HT	
—up to and including 300 mm ²	160
—greater than 300 mm ²	140
Cross-linked elastomeric: R-EP-90, R-CPE-90, R-HF-90, R-CSP-90, R-HF-110, and R-E-110	250
Cross-linked polyolefin: X-90, X-90UV, X-HF-90 and X-HF-110	250
High temperature: R-S-150 and Type 150 fibrous	350

5.5.3 Outer sheath and bedding materials

The temperature limits given in Table 54 are for the outer sheath and bedding materials comprising a continuous screen/sheath or a complete layer of armour wires. These temperatures are for materials where there are no electrical or other requirements necessary, i.e. screen/sheath/armour temperature limits when in contact with the outer sheath materials but thermally separated from the insulation by layers of suitable material of sufficient thickness. If thermal separation is not provided, the temperature limits of the insulation should be used if it is lower than that of the sheath.

TABLE 54
TEMPERATURE LIMITS FOR OUTER SHEATH
AND BEDDING MATERIALS

Material	Temperature limit °C
Thermoplastic	200
Polyethylene	150
High density polyethylene	180
Polychloroprene, chlorosuphonated polyethylene and similar	200

5.5.4 Conductor and metallic sheath materials and components

The temperature limits specified in Table 55 apply to the conductor and metallic sheath materials and components.

NOTE: Limitations of materials in contact with these metals should also be considered.

TABLE 55
TEMPERATURE LIMITS FOR CONDUCTOR AND METALLIC SHEATH
MATERIALS AND COMPONENTS

Metals	Condition	Temperature limit °C
Copper and aluminium	Conductor only*	†
	Welded joint	†
	Exothermic welded joint	250‡
	Soldered joint	160
	Compression (mechanical deformation) joint	250‡
	Mechanical (bolted) joint	§
Lead		170
Lead alloy		200
Steel		†

* Includes concentric neutral conductors.

† Limited by the material with which it is in contact.

‡ Temperature of adjacent conductor, actual joint will be at a lower temperature.

§ Refer to manufacturer's recommendations.

APPENDIX A

EXAMPLES OF THE SELECTION OF CABLES TO SATISFY
CURRENT-CARRYING CAPACITY, VOLTAGE DROP AND
SHORT-CIRCUIT PERFORMANCE REQUIREMENTS

(Informative)

A1 EXAMPLE 1**A1.1 Problem**

An underground 1500 A three-phase circuit is to be made up of parallel circuits of 400 mm² V-75 single-core insulated and sheathed copper cables. Determine the minimum number of active conductors required for each of the following forms of installation:

- All cables in one conduit or duct.
- Each parallel circuit comprising three cables in one conduit or duct.
- Each parallel circuit comprising a trefoil group of single-way underground ducts.
- Each parallel circuit comprising a trefoil group of three cables buried direct.

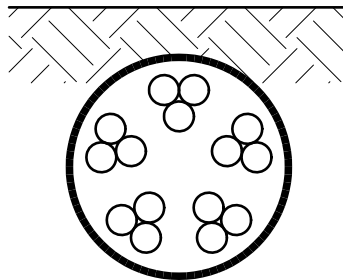
A1.2 Solution

Assuming that the conditions specified in Clause 3.4 apply, i.e. soil ambient temperature, thermal resistivity and depth of laying, the following methods would satisfy the load requirements, if the voltage drop is acceptable:

- A1 | (a) *Method A—Single conduit or duct* Current-carrying capacity of single 400 mm² circuit = 492 A (Table 7, Column 24).

From the derating factors of Table 22, which vary according to the number of enclosed circuits, it can be shown that five parallel circuits of 400 mm² conductors, as illustrated, are required.

- A1 | The current-carrying capacity of the arrangement is—
492 × 5 × 0.6 = 1476 A

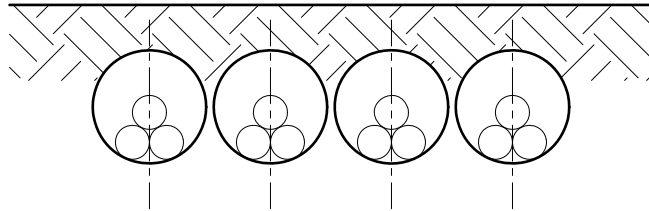


- A1 | (b) *Method B—Groups of conduits or ducts* Current-carrying capacity of single 400 mm² circuit = 492 A (Table 7, Column 24).

From the derating factors of Table 26(2) for groups of underground enclosures, it can be shown that four conduits or ducts, each containing a circuit of 400 mm² conductors and touching, as illustrated, are required.

The current-carrying capacity of the arrangement is—

A1 | $492 \times 4 \times 0.79 = 1554.7$



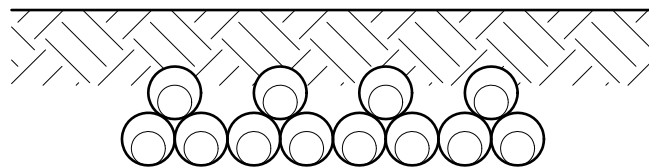
(c) *Method C—Trefoil groups of single-way underground ducts*

A1 | Current-carrying capacity of single 400 mm² circuit = 553 A (Table 7, Column 27).

From the derating factors of Table 26(1) for groups of underground enclosures, it can be shown that four trefoil groups of single-way underground ducts, each group representing a circuit of 400 mm² conductors, as illustrated, are required.

The current-carrying capacity of the arrangement—

A1 | $553 \times 4 \times 0.74 = 1636.9$ A

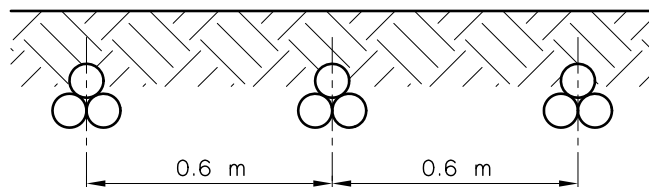


(d) *Method D—Trefoil groups of cable buried direct* Current-carrying capacity of single 400 mm² circuit = 593 A (Table 7, Column 22).

From the derating factors of Table 25(1) for groups of single-core cables buried direct, it can be shown that three trefoil groups of single-core cables, each group representing a circuit of 400 mm² conductors and spaced apart, as illustrated, are required.

The current-carrying capacity of the arrangement is—

A1 | $593 \times 3 \times 0.87 = 1547.7$ A



A1.3 Comparison of different methods

Each of the four methods of installation described in Paragraph A1.2 provide a satisfactory solution to the circuit design problem where the number of 400 mm² active conductors are to be kept to a minimum for a given installation method. However, in doing so the following factors that may determine the system to be selected are highlighted:

- (a) *Number of cables* Method A leads to the largest number of cables.
- (b) *Number of enclosures* Method C requires twelve enclosures (excluding neutral) whilst Method D requires none.

- (c) *Size of enclosures* The enclosures in Method C need only be sufficient to accommodate one conductor. However, the single enclosure in Method A will need to be considerably larger.
- (d) *Size of excavated trench* Methods A, B and C require relatively small trench widths in comparison to Method D.
- (e) *Provision for additional load* Methods A, B and C have provision for a further load increase of between 150 and 250 A. Method D would be operating at near maximum load.

The relative importance of these different factors for a particular installation will, in general, determine the cable arrangement selected.

A2 EXAMPLE 2

A2.1 Problem

If 12 loaded single-core conductors are run through a wiring enclosure what derating factor should be applied?

A2.2 Solution

The applicable derating factors could be determined from Table 22. If it is a three-phase circuit, then 12/3 is 4 groups, i.e. 4 circuits, and a derating factor of 0.65 could be applied. If the circuits are single-phase, there would be 6 circuits and therefore a derating factor of 0.57 could be applied.

Applying these derating factors for, say, V-75 insulated 4 mm² conductors, from Table 7 a three-phase current-carrying capacity is 28 A while the single-phase value from Table 4 is 32 A.

A1

A1

Using the three-phase approach, $28 \times 0.65 = 18.2$ A.

Using the single-phase approach, $32 \times 0.57 = 18.2$ A.

Note that these methods result in approximately the same answer.

A3 EXAMPLE 3

A3.1 Problem

A three-phase circuit is to supply a load of 125 A per phase. It is proposed to use two V-75 insulated and sheathed four-core cables bunched together on a surface in a confined ceiling space where the ambient air temperature is 50°C.

Determine—

- (a) the minimum conductor size; and
- (b) the maximum route length of the circuit if a voltage drop of 3% is permitted on the circuit;

for both aluminium and copper conductors.

A3.2 Solution

The solution is as follows:

- (a) *Minimum cable size:*

Derating factor for bunching = 0.8 (Table 22, Column 5)

Derating factor for 50°C ambient = 0.82 (Table 27(1), Column 9)

Minimum current-carrying capacity of two parallel cables—

$$125 \times \frac{1}{0.8} \times \frac{1}{0.82} = 190.5 \text{ A}$$

or 95.25 A per cable.

From Columns 5, 6 and 7 of Table 13, the minimum size of the two cables making up the circuit are—

Aluminium—50 mm²

Copper—35 mm²

(b) *Maximum route length:*

With the same length and disposition of the two cables throughout the circuit, balanced current flow between the parallel cables can be expected.

Assuming worst case conditions of cable operating temperature and load power factor, the simplified method of Clause 4.2 may be used to determine the maximum route length of the circuit (L), in metres, by substitution of the 62.5 A load current for each cable and 3 % (12.45 V) permissible voltage drop in the following equation:

$$L = \frac{1000 \times V_d}{I \times V_c}$$

The values of V_c are obtained from Table 42 for copper and Table 45 for aluminium and result in the following maximum route lengths:

$$\text{Aluminium} \quad \frac{1000 \times 12.45}{62.5 \times 1.36} = 146.5 \text{ m}$$

$$\text{Copper} \quad \frac{1000 \times 12.45}{62.5 \times 1.11} = 179.5 \text{ m}$$

A4 EXAMPLE 4

A4.1 Problem

Six four-core V-75 insulated and sheathed copper cables are arranged touching in a single horizontal row on a perforated cable tray for the supply of six identical 22 kW motors which have a full-load current of 45 A per phase and are installed at distances of 40 m, 55 m, 90 m, 135 m, 180 m and 225 m from the origin of the cable tray. Determine the minimum conductor size if a voltage drop of 2.4 % (10 V) is permitted for each cable.

A4.2 Solution

The selection of conductor size in this instance must satisfy both the current-carrying capacity requirement, including the effect of the cables being grouped, and the voltage drop limitation.

The cable sizes required to satisfy the voltage drop restriction are assessed using the formula of Clause 4.2, the actual load current of 45 A, the permissible voltage drop, V_d , of 10 V and the three-phase voltage drop figures of Table 42. The results of these calculations, the current-carrying capacity given in Table 13 and its ratio to the load current, are as follows:

Cable	Length m	Maximum F_c mV/A.m	Minimum cable size mm ²	Maximum current- carrying capacity A	Ratio of actual load current to max. current-carrying capacity of cable
A	40	5.56	10	51	0.88
B	55	4.04	10	51	0.88
C	90	2.47	16	68	0.66
D	135	1.65	25	91	0.49
E	180	1.23	35	110	0.41
F	225	0.98	50	135	0.33

Because of voltage drop limitations, cables C to F are substantially larger than required to meet the maximum current-carrying capacity requirements. As a result the contribution of these cables to the effects of mutual heating will be small, in the case of cables E and F, almost negligible.

An examination of the derating factors for groups of multicore cables on perforated trays given in Table 24 would indicate that a factor of 0.76 (Column 9) would apply if all six cables in the group were loaded to achieve the same conductor temperature. Although these conditions do not exist for all cables in this example, the application of this factor will give a conservative but practical solution, as follows:

$$\text{Minimum current-carrying capacity required of cables} = 45 \times \frac{1}{0.76} = 59.2 \text{ A}$$

$$\text{Minimum cable size} = 16 \text{ mm}^2 \text{ (Table 13, Column 5)}$$

As expected, only cables A and B are affected and therefore the recommended minimum cable sizes for the cables A, B, C, D, E and F will be 16 mm², 16 mm², 16 mm², 25 mm², 35 mm² and 50 mm² respectively.

NOTE: The actual derating factor in this situation may be closer to 0.82, the derating factor for three cables on a tray, which allows for restricted ventilation to cables nested in the middle of others. Alternative arrangements of the cables, e.g. spacing cables A and B, which operate at a higher temperature, away from each other and others in the group, may also give rise to less onerous derating factors and smaller cable sizes.

A5 EXAMPLE 5

A5.1 Problem

Five single-phase circuits of two-core flat V-75 insulated and sheathed cables are fixed to a wall. Where the continuous loading of the cables is assessed as 16, 20, 25, 32, and 40 A, determine the minimum cable sizes required where the cables are in one of the following conditions:

- Condition A—spaced apart in a single layer in accordance with Clause 3.5.2.2(c) and Figure 1.
- Condition B—spaced apart in a single layer by a distance of one cable diameter between adjacent cables.
- Condition C—touching in a single layer.
- Condition D—bunched together.

A5.2 Solution

The solution is as follows:

- For installation condition A to avoid derating because of grouping, Clause 3.5.2.2(c) and Figure 1 require a minimum vertical spacing between adjacent cables 6 times the diameter of the largest cable in the group.

- (b) For condition B, the derating factor = 0.90 (Table 22, Column 8)
- (c) For condition C, the derating factor = 0.73 (Table 22, Column 8)
- (d) For condition D, the derating factor = 0.60 (Table 22, Column 8)

The minimum conductor sizes determined from Column 5 of Table 13 are as follows:

Load A	Cable size, mm ²			
	Spaced 6 diameters	Spaced 1 diameter	Touching single layer	Bunched
16	1.5	1.5	2.5	2.5
20	2.5	2.5	4	4
25	2.5	4	4	6
32	4	6	6	10
40	6	6	10	16

A6 EXAMPLE 6

A6.1 Problem

A single-phase circuit comprises two 16 mm² copper single-core sheathed cables with V-75 insulation installed unenclosed on a wall for the supply of a 55 A resistive load.

Determine which single-phase voltage drop values will apply when the cable is operating in—

- (a) an ambient air temperature of 40°C; or
- (b) an ambient air temperature of 25°C

A6.2 Solution

From Table 4 it will be noted that the cable current-carrying capacity of this configuration is 72 A in an ambient air temperature of 40°C. Equation 4.4(1) may therefore be solved directly for cable operating temperature (θ_0) where the ambient air temperature is 40°C but requires some correction to the rated current (I_R) before application to an ambient air temperature of 25°C. Appropriate calculations are as follows:

- (a) *Ambient air temperature 40°C*

$$\left(\frac{55}{72}\right)^2 = \frac{\theta_0 - 40}{75 - 40}$$

$$\theta_0 = 60.4^\circ\text{C, say } 60^\circ\text{C}$$

The three-phase voltage drop for this cable configuration and operating temperature obtained from Table 41 is 2.32 mV/A.m. The single-phase value is then determined in accordance with Clause 4.3.3(a).

$$\begin{aligned} \text{Single-phase voltage drop value} &= 1.155 \times 2.32 \\ &= 2.68 \text{ mV/A.m.} \end{aligned}$$

- (b) *Ambient air temperature 25°C* The correction factor for operation in a 25°C ambient air temperature is used to determine the maximum current that will give rise to the maximum operating temperature of 75°C.

Correction factor = 1.21 (from Table 27)

$$\left(\frac{55}{72 \times 1.21}\right)^2 = \frac{\theta_0 - 25}{75 - 25}$$

$$\theta_0 = 44.9^\circ\text{C, say } 45^\circ\text{C}$$

The three-phase voltage drop for this cable configuration and operating temperature obtained from Table 41 is 2.20 mV/A.m. The single-phase value is then determined in accordance with Clause 4.3.3(a)—

$$\begin{aligned}\text{Single-phase voltage drop value} &= 1.155 \times 2.20 \\ &= 2.54 \text{ mV/A.m.}\end{aligned}$$

A7 EXAMPLE 7

A7.1 Problem

A three-phase circuit comprises $3 \times 150 \text{ mm}^2$ single-core copper V-75 sheathed active conductors and a $1 \times 70 \text{ mm}^2$ single-core copper V-75 sheathed neutral conductor bunched together in free air. Assuming an ambient air temperature of 40°C and the same length of 150 m for all conductors, determine the maximum voltage drop when the magnitude and phase angle of the currents in the respective active conductors are as follows:

$$\begin{aligned}I_A &= 195 \angle 0^\circ \\ I_B &= 300 \angle 120^\circ \\ I_C &= 230 \angle 240^\circ\end{aligned}$$

A7.2 Solution

It is not necessary in this example to take into account the load power factor as the maximum voltage drop conditions are assumed where load power factor and cable power factor are equal. The voltage drop in each cable will then be equal to ILZ_c .

The 300 A load current in phase B is, according to Table 7, close to the maximum permissible for such an arrangement and consequently the conductor operating temperature may be assessed as 75° for the application of Table 40 corresponding to a three-phase voltage drop of 0.305 mV/A.m.

The voltage drop on phase B conductor alone is therefore—

$$\begin{aligned}V_{dB} &= I_B L_B Z_{cB} \\ &= 300 \angle 120^\circ \times 150 \times \frac{0.305}{\sqrt{3}} \times \frac{1}{1000} \\ &= 7.924 \angle 120^\circ\end{aligned}$$

The current flowing in the neutral is determined from the relationship—

$$\begin{aligned}I_A + I_B + I_C + I_N &= 0 \\ I_A + I_B + I_C &= 195 \angle 0^\circ + 300 \angle 120^\circ + 230 \angle 240^\circ \\ &= 195 + (-150 + j259.8) + (-115 - j199.2)\text{A} \\ &= -70 + j60.6 \\ \therefore I_N &= 70 - j60.6 \\ &= 92.6 \angle -40.9^\circ\text{A}\end{aligned}$$

The operating temperature of the neutral may then be determined in accordance with Clause 4.4 and the rated figure given in Table 7, i.e.

$$\left(\frac{92.6}{185}\right)^2 = \frac{\theta_0 - 40}{75 - 40}$$

$\theta_0 = 49^\circ\text{C}$, say 60°C allowing for contact with conductors operating at higher temperatures.

From Table 40 and a conductor temperature of 60°C the three-phase voltage drop is given as 0.563 mV/A.m .

The voltage drop on the neutral conductor alone is therefore—

$$\begin{aligned} V_{dN} &= I_N L_N Z_{cN} \\ &= 92.6 \angle -40.9^\circ \text{V} \times 150 \times \frac{0.563}{\sqrt{3}} \times \frac{1}{1000} \\ &= 4.515 \angle -40.9^\circ \text{V} \end{aligned}$$

The maximum single-phase voltage drop is therefore—

$$\begin{aligned} V_d &= V_{dB} - V_{dN} = 7.924 \angle 120^\circ - 4.515 \angle -40.9^\circ \\ &= -3.962 + j7.862 - 3.413 + j2.956 \\ &= -7.375 + j9.818 \\ &= 12.28 \angle 120.9^\circ \text{V} \end{aligned}$$

A8 EXAMPLE 8

A8.1 Problem

Select the minimum size conductor based on thermal consideration, for a copper cable with compression joints connected to a supply where protection is provided by an air circuit-breaker with a clearance time of 1 s and a breaking capacity of 10 kA.

Calculate the minimum conductor size for the following two types of cable:

- PVC insulated.
- XLPE insulated.

A8.2 Solution

The solution is as follows:

- PVC insulated*
 - To find the value of constant (K) the initial conductor temperature and the final conductor temperature must be known.
For PVC it is assumed that the initial operating temperature is 75°C (for V-75, V-90 and V-90HT). From Table 53, and assuming that the cable is smaller than 300 mm^2 , the final operating temperature can be selected as 160°C . From Table 52 the value of K can be selected as 111 for a copper conductor.
 - As the circuit-breaker protecting the circuit is rated at 10 kA breaking capacity, we can assume a value of 10 000 A for I .
 - As the clearance time of the circuit-breaker is 1 s, it can be assumed that the value of t , which is the total time the fault current is flowing, is also 1 s.
- Rearranging Equation 5.3(1) we get—

$$S = \sqrt{\left(\frac{I^2 t}{K^2}\right)}$$

Substituting the values for I , t and K , the minimum cross-section area is calculated as—

$$S = \sqrt{\frac{(10\,000)^2 \times 1}{(111)^2}}$$

$$= 90.1 \text{ mm}^2$$

Therefore, the minimum cable size would be 95 mm².

(b) *XLPE insulation*

Using the same process as in Item (a) the following steps are taken:

- (i) Initial operating temperature for X-90 insulation (assumed maximum)..... 90°C
 Final operating temperature from X-90 insulation (from Table 53)..... 250°C
 Value of constant (*K*) from Table 52143
- (ii) Value of short-circuit current (*I*) 10 000 A
- (iii) Value of time (*t*) is..... 1 s

$$S = \sqrt{\left(\frac{I^2 t}{K^2}\right)}$$

$$2 = \sqrt{\frac{(10\,000)^2 \times 1}{(143)^2}}$$

$$= 69.9 \text{ mm}^2$$

Therefore, the minimum cable size would be 70 mm².

APPENDIX B
LIST OF TABLES
(Informative)

Table	Title	Page
1	Limiting temperatures for insulated cables	14
2	Reduction factors for harmonic currents in 4- and 5-core cables	27
3(1)	Schedule of installation methods for cables deemed to have the same current-carrying capacity and cross-references to applicable derating tables—Unenclosed in air	28
3(2)	Schedule of installation methods for cables deemed to have the same current-carrying capacity and cross-references to applicable derating tables—Enclosed	30
3(3)	Schedule of installation methods for cables deemed to have the same current-carrying capacity and cross-references to applicable derating tables—Buried direct in the ground	32
3(4)	Schedule of installation methods for cables deemed to have the same current-carrying capacity and cross-references to applicable derating tables—Underground wiring enclosures	33
4	Current-carrying capacities Cable type: Two single-core Insulation type: Thermoplastic	34
5	Current-carrying capacities Cable type: Two single-core Insulation types: X-90, X-HF-90, R-EP-90, R-CPE-90 or R-CSP-90	37
6	Current-carrying capacities Cable type: Two single-core Insulation types: R-HF-110, R-E-110 or X-HF-110	40
7	Current-carrying capacities Cable type: Three single-core Insulation type: Thermoplastic	42
8	Current-carrying capacities Cable type: Three single-core Insulation types: X-90, X-HF-90, R-EP-90, R-CPE-90 or R-CSP-90	45
9	Current-carrying capacities Cable type: Three single-core Insulation types: R-HF-110, R-E-110 or X-HF-110	48
10	Current-carrying capacities Cable type: Two-core sheathed Insulation type: Thermoplastic	50
11	Current-carrying capacities Cable type: Two-core sheathed Insulation types: X-90, X-HF-90, R-EP-90, R-CPE-90 or R-CSP-90	53
12	Current-carrying capacities Cable type: Two-core sheathed Insulation types: R-HF-110, R-E-110 or X-HF-110	56
13	Current-carrying capacities Cable types: Three-core and four-core Insulation type: Thermoplastic	58
14	Current-carrying capacities Cable types: Three-core and four-core Insulation types: X-90, X-HF-90, R-EP-90, R-CPE-90 or R-CSP-90	61

Table	Title	Page
15	Current-carrying capacities Cable types: Three-core and four-core sheathed Insulation types: R-HF-110, R-E-110 or X-HF-110	64
16	Current-carrying capacities Cable type: Flexible cords Insulation types: Thermoplastic or cross-linked	66
17	Current-carrying capacities Cable types: Cables and flexible cords Insulation types: R-S-150, Type 150 fibrous or 150°C rated fluoropolymer	67
18	Current-carrying capacities Cable type: Bare single-core MIMS cables with copper conductors	68
19	Current-carrying capacities Cable type: Bare multicore MIMS cables with copper conductors	69
20	Current-carrying capacities Cable types: Aerial cables with copper conductors	70
21	Current-carrying capacities Cable types: Aerial cables with aluminium conductors	72
22	Derating factors for bunched circuits Cable types: Single-core and multicore Installation conditions: In air or in wiring enclosures	74
23	Derating factors for circuits Cable type: Single-core Installation conditions: In trays, racks, cleats or other supports in air	75
24	Derating factors for circuits Cable type: Multicore Installation conditions: In trays, racks, cleats or other supports in air	77
25(1)	Derating factors for groups of circuits Cable type: Single-core Installation conditions: Buried direct in ground	79
25(2)	Derating factors for groups of circuits Cable type: Multicore Installation conditions: Buried direct in ground	80
26(1)	Derating factors for groups of circuits Cable type: Single-core Installation conditions: In underground wiring enclosures—Enclosed separately	81
26(2)	Derating factors for groups of circuits Cable types: Single-core or multicore Installation conditions: In underground wiring enclosures—Multicore cables enclosed separately or more than one single-core cable per wiring enclosure	82
27(1)	Rating factors Variance: Air and concrete slab ambient temperatures Installation conditions: Cables in air or heated concrete slabs	83
27(2)	Rating factors Variance: Soil ambient temperatures Installation conditions: Cables buried direct in ground or in underground wiring enclosures	83
28(1)	Rating factors Cable types: Single-core or multicore Variance: Depth of laying Installation conditions: Buried direct in ground	84
28(2)	Rating factors Cable types: Single-core or multicore Variance: Depth of laying Installation conditions: In underground wiring enclosures	84

Table	Title	Page
29	Rating factors Variance: Thermal resistivity of the soil (from 1.2°C.m/W) Installation conditions: Buried direct in ground and in underground wiring enclosures	85
30	Reactance at 50 Hz Cable type: All cables excluding flexible cords, flexible cables, MIMS cables and aerial cables	92
31	Reactance at 50 Hz Cable types: Flexible cords and flexible cables	93
32	Reactance at 50 Hz Cable type: MIMS	94
33	Reactance at 50 Hz Cable type: Single-core aerial with bare or insulated conductors	95
34	a.c. resistance at 50 Hz Cable type: Single-core	96
35	a.c. resistance at 50 Hz Cable type: Multicore with circular conductors	97
36	a.c. resistance at 50 Hz Cable type: Multicore with shaped conductors	97
37	a.c. resistance at 50 Hz Cable types: Flexible cords and flexible cables with copper conductors	98
38	a.c. resistance at 50 Hz Cable type: MIMS	99
39	a.c. resistance at 50 Hz Cable type: Single-core aerial with bare or insulated conductors	100
40	Three-phase voltage drop (V_c) at 50 Hz Cable types: Single-core insulated and sheathed copper conductors laid in trefoil	101
41	Three-phase voltage drop (V_c) at 50 Hz Cable types: Single-core insulated and sheathed copper conductors, laid flat touching or in a wiring enclosure	102
42	Three-phase voltage drop (V_c) at 50 Hz Cable type: Multicore with circular copper conductors	103
43	Three-phase voltage drop (V_c) at 50 Hz Cable types: Single-core insulated and sheathed aluminium conductors, laid in trefoil	104
44	Three-phase voltage drop (V_c) at 50 Hz Cable types: Single-core insulated and sheathed aluminium conductors, laid flat touching	105
45	Three-phase voltage drop (V_c) at 50 Hz Cable type: Multicore cables with circular aluminium conductors	106
46	Three-phase voltage drop (V_c) at 50 Hz Cable types: Single-core flexible cords and flexible cables, laid in trefoil	107
47	Three-phase voltage drop (V_c) at 50 Hz Cable types: Single-core flexible cords and flexible cables, laid flat touching or in a wiring enclosure	112
48	Three-phase voltage drop (V_c) at 50 Hz Cable types: Multicore flexible cords and flexible cables	109
49	Three-phase voltage drop (V_c) at 50 Hz Cable types: Single-core and multicore MIMS, laid in trefoil	110
50	Three-phase voltage drop (V_c) at 50 Hz Cable type: Aerial with bare or insulated copper conductors	111
51	Three-phase voltage drop (V_c) at 50 Hz Cable type: Aerial with bare or insulated aluminium conductors	112
52	Values of constant K for determination of permissible short-circuit currents	114
53	Temperature limits for insulating materials in contact with conductors	115

Table	Title	Page
54	Temperature limits for outer sheath and bedding materials	116
55	Temperature limits for conductor and metallic sheath materials and components	116
D1	Load current sharing and low magnetic field configurations	131

APPENDIX C

EXAMPLES OF THE APPLICATION OF REDUCTION FACTORS FOR HARMONIC CURRENTS

(Informative)

Consider a three-phase circuit with a design load of 35 A to be installed using four-core PVC insulated cable clipped to a wall.

From Table 13, a 6 mm² cable with copper conductors has a current-carrying capacity of 37 A and hence is suitable if harmonics are not present in the circuit.

If 20% third harmonic is present then a reduction factor of 0.86 is applied and the design load becomes:

$$\frac{35}{0.86} = 41 \text{ A}$$

For this load a 10 mm² cable is suitable.

If 44% third harmonic is present the cable size selection is based on the neutral current which is:

$$35 \times 0.44 \times 3 = 46.2 \text{ A}$$

and a reduction factor of 0.86 is applied, leading to a design load of:

$$\frac{46.2}{0.86} = 53.7 \text{ A}$$

For this load, a 16 mm² cable is suitable.

If 50% third harmonic is present the cable size is again selected on the basis of the neutral current, which is:

$$35 \times 0.5 \times 3 = 52.5 \text{ A}$$

In this case, the reduction factor is 1 and a 16 mm² cable is suitable.

All the above cable selections are based on the current-carrying capacity of the cable only. Voltage drop and other aspects of design have not been considered.

APPENDIX D


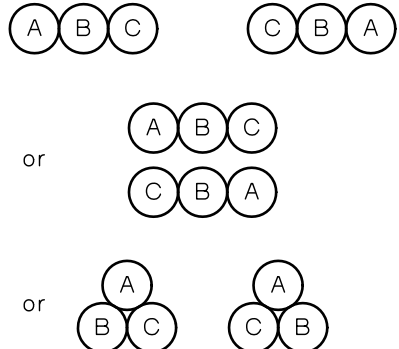

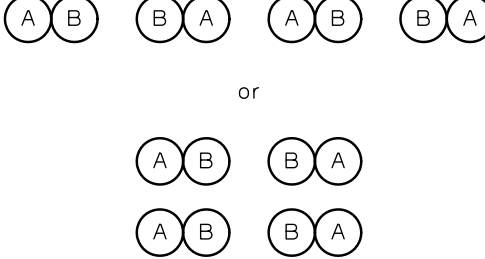
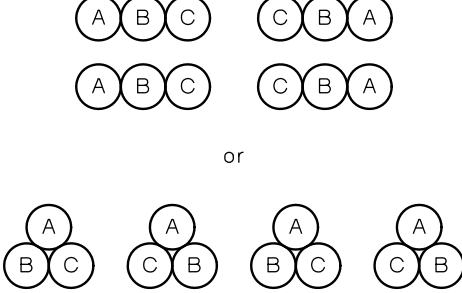
RECOMMENDED CIRCUIT CONFIGURATIONS FOR THE INSTALLATION OF SINGLE-CORE CABLES IN PARALLEL

(Informative)

TABLE D1

LOAD CURRENT SHARING CONFIGURATION

A1

Mode	Two-phase	Three-phase
Two conductors per phase		
Three conductors per phase	Not recommended	
Four conductors per phase		

NOTES:

- 1 Neutral conductors are to be located so as to not disturb the symmetry of the groups as illustrated.
- 2 Non-symmetrical configuration may cause unequal distribution of current between conductors. Provision should be made to maintain the recommended configurations to avoid these problems.

AMENDMENT CONTROL SHEET

AS/NZS 3008.1.1:2009

Amendment No. 1 (2011)

CORRECTION

SUMMARY: This Amendment applies to Clauses 3.3.2 and 4.4, Tables 3(1), 6, 7, 8, 9, 10, 12, 13, 15, 16 and 34, and Appendices A and D.

Published on 15 August 2011.

Standards Australia

Standards Australia is an independent company, limited by guarantee, which prepares and publishes most of the voluntary technical and commercial standards used in Australia. These standards are developed through an open process of consultation and consensus, in which all interested parties are invited to participate. Through a Memorandum of Understanding with the Commonwealth government, Standards Australia is recognized as Australia's peak national standards body.

Standards New Zealand

The first national Standards organization was created in New Zealand in 1932. The Standards Council of New Zealand is the national authority responsible for the production of Standards. Standards New Zealand is the trading arm of the Standards Council established under the Standards Act 1988.

Australian/New Zealand Standards

Under a Memorandum of Understanding between Standards Australia and Standards New Zealand, Australian/New Zealand Standards are prepared by committees of experts from industry, governments, consumers and other sectors. The requirements or recommendations contained in published Standards are a consensus of the views of representative interests and also take account of comments received from other sources. They reflect the latest scientific and industry experience. Australian/New Zealand Standards are kept under continuous review after publication and are updated regularly to take account of changing technology.

International Involvement

Standards Australia and Standards New Zealand are responsible for ensuring that the Australian and New Zealand viewpoints are considered in the formulation of international Standards and that the latest international experience is incorporated in national and Joint Standards. This role is vital in assisting local industry to compete in international markets. Both organizations are the national members of ISO (the International Organization for Standardization) and IEC (the International Electrotechnical Commission).

Visit our web sites

www.standards.org.au

www.standards.co.nz

www.standards.com.au



GPO Box 476 Sydney NSW 2001
Phone (02) 9237 6000
Fax (02) 9237 6010
Email mail@standards.org.au
Internet www.standards.org.au
SAI Global Customer Service
Phone 13 12 42
Fax 1300 65 49 49
Email sales@saiglobal.com



Level 10 Radio New Zealand House
155 The Terrace Wellington 6011
(Private Bag 2439 Wellington 6140)
Phone (04) 498 5990
Fax (04) 498 5994
Customer Services (04) 498 5991
Information Service (04) 498 5992
Email snz@standards.co.nz
Internet www.standards.co.nz

This page has been left intentionally blank.